
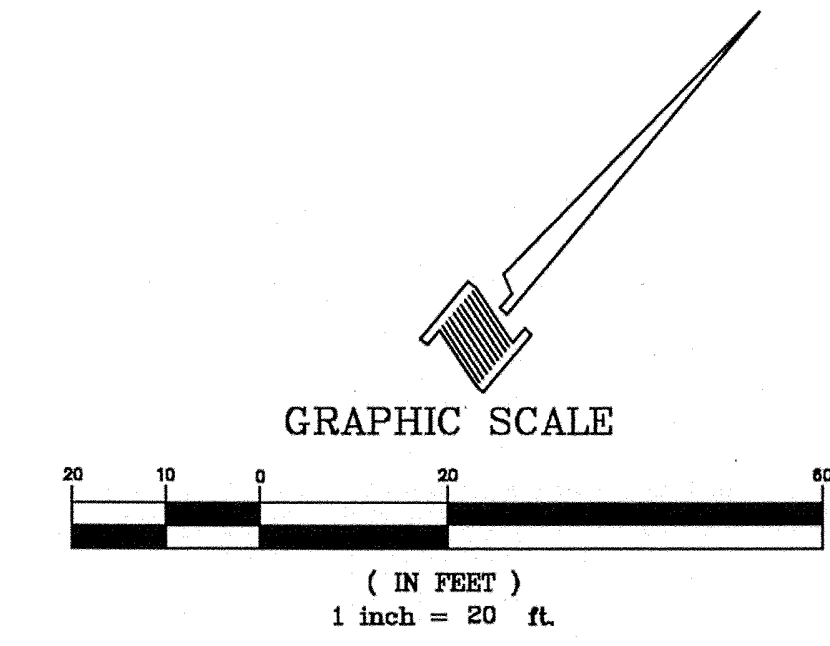


MATCHLINE SEE SHT 1/3

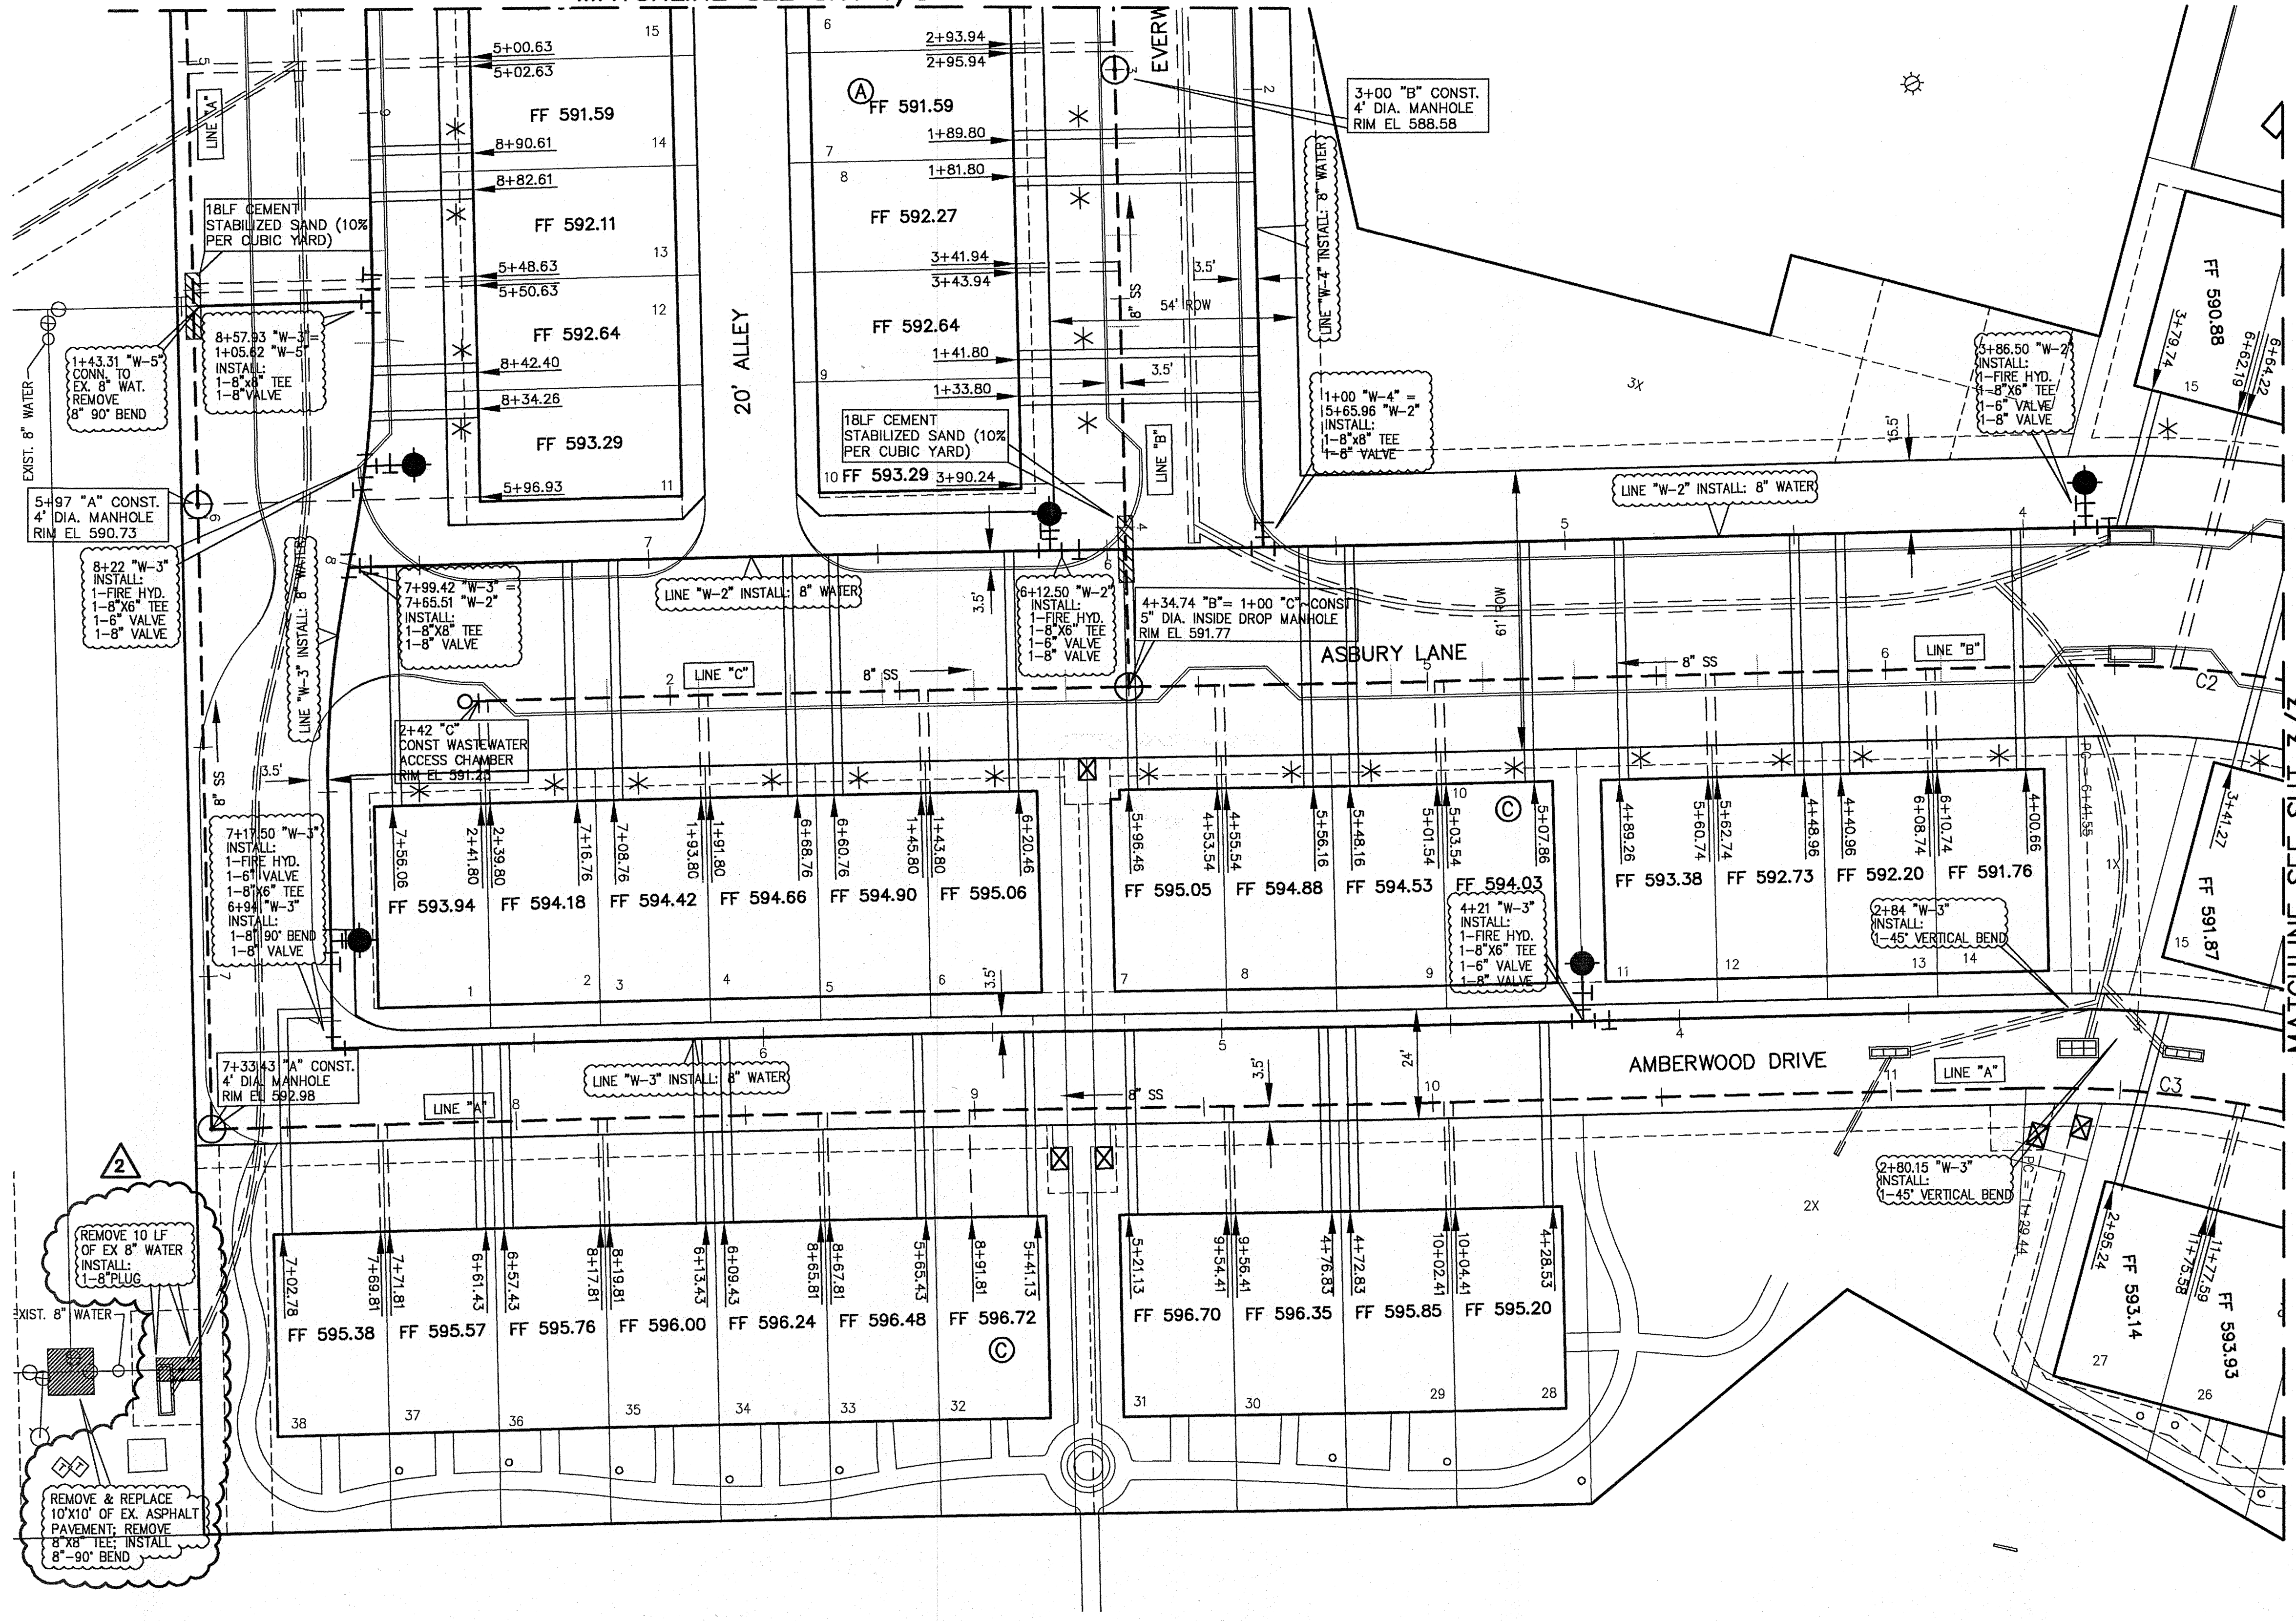

**WATER SERVICE SCHEDULE**

TYPE	SIZE	NO.
DOM.	1"	73
FIRE	1.5"	73
IRRIG.	2"	2
IRRIG.	1"	1
IRRIG.	1.5"	1

**Legend**

- Prop San. Sewer
- Prop Manhole
- Prop wvac
- San Sewer Flow Direction
- Prop Water
- Prop Fire Hydrant
- Exist. San. Sewer
- Exist. Manhole
- Exist. Clean-out
- Exist. Water
- Exist. Fire Hydrant
- Fire Water Service
- Electric Transformer

**SANITARY SEWER SERVICES**

TYPE	SIZE	NO.
PVC	4"	73


**CURVE TABLE**

CURVE	DELTA	RADIUS	TANGENT	LENGTH	CHORD
C1	11°16'25"	250.00'	24.67'	49.19'	S35°34'52"E 49.11'
C2	16°04'22"	250.00'	35.30'	70.13'	S56°49'06"W 69.90'
C3	16°04'22"	250.00'	35.30'	70.13'	S56°49'06"W 69.90'

**BENCHMARKS:**  
 CITY OF ADDISON BENCHMARK NO. 13:  
 SQUARE CUT ON THE BACK OF CURB AT THE CENTER OF AN  
 INLET AT THE SOUTHEAST CORNER OF BELTLINE ROAD AND  
 SURVEYOR BOULEVARD.  
 ELEVATION = 594.94'

CITY OF ADDISON BENCHMARK NO. 18:  
 SQUARE CUT ON COSERV ELECTRIC VAULT AT THE NORTHEAST  
 CORNER OF BELTLINE ROAD AND MIDWAY ROAD.  
 ELEVATION = 627.93'

THESE CONSTRUCTION PLANS WERE PREPARED  
 UNDER THE RESPONSIBLE SUPERVISION OF J.  
 CASEY ROSS, LICENSED PROFESSIONAL ENGINEER  
 NO. 97272  
*J. Casey Ross 2/8/08*

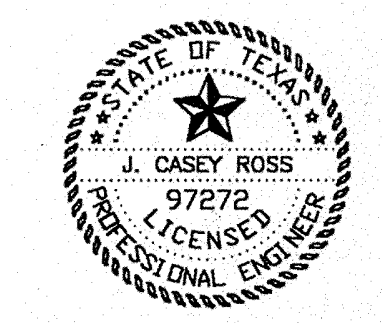

NO.	DATE	BY	REVISION
1	1/24/08	JCR	REVISED FIRE SERVICES TO 1.5"
2	2/08/08	JCR	ADDED REMOVAL OF EXISTING 8" WATER LINE

**WATER & SANITARY SEWER PLAN**  
**ASBURY CIRCLE**  
 TOWN OF ADDISON  
 DALLAS COUNTY, TEXAS

**DOWDEY, ANDERSON & ASSOCIATES, INC.**  
 5225 Village Creek Drive, Suite 200 Plano, Texas 75093 972-931-0694

DESIGN	DRAWN	CHECKED	DATE	SCALE	JOB	SHEET
TMD	TMD	JCR	10/13/2006	1" = 20'	06010	2