



I.D. (IN.)	T (IN.)	C 11.25°			C 22.50°			E (FT.)
		FT.	FT.	FT.	FT.	FT.	FT.	
4.68	0.4	1.5	1.5	1.5	0.9			
10.12	0.5	1.5	1.5	1.5	1.2			
16.18	0.6	1.5	1.5	1.5	1.6			
20	0.7	1.5	1.5	1.5	1.8			
24	0.9	1.5	1.5	1.5	2.1			
30	2.9	1.5	1.5	1.5	2.6			
36	4.5	1.5	1.5	1.5	3.3			
42	5.0	1.5	1.5	1.5	3.8			
48	5.5	2.0	3.0	4.3				
54	6.0	2.3	3.4	4.8				
60	6.5	2.5	3.8	5.3				
66	6.8	2.8	4.1	5.7				
72	7.5	3.0	4.5	6.3				
78	7.5	3.3	4.9	6.7				
84	8.0	3.5	5.3	7.2				
90	8.5	3.8	5.6	7.7				
96	9.0	4.0	6.0	8.2				

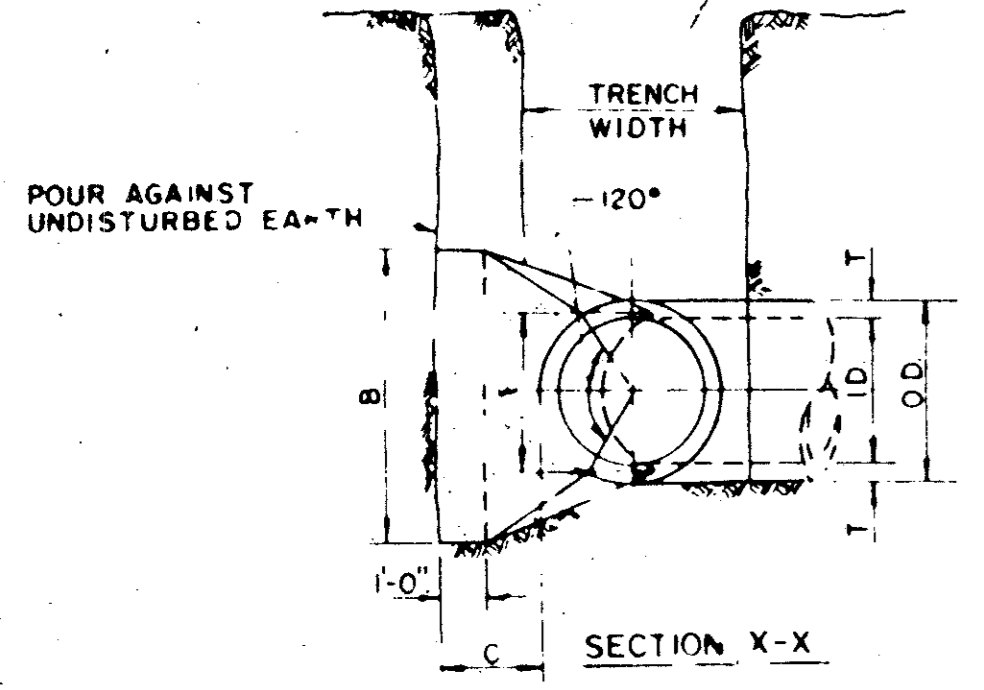

I.D. (IN.)	G (FT.)	Δ = 11.25°						Δ = 22.50°					
		THRUST (TONS)	A (FT.)	B (FT.)	VOL. (CY)	A (FT.)	B (FT.)	VOL. (CY)	THRUST (TONS)	A (FT.)	B (FT.)	VOL. (CY)	
4.68	0.4	10	10	1.5	0.1	10	10	0.1	4.68	0.8	2.0	1.5	0.1
10.12	0.6	22	15	1.5	0.1	10	10	0.1	10.12	1.1	4.4	2.0	0.3
16.18	0.8	50	20	2.5	0.3	15	20	0.2	16.18	1.6	9.9	3.0	0.6
20	0.9	62	20	3.5	0.4	15	30	0.3	20	1.8	12.3	3.5	0.7
24	1.1	89	30	3.0	0.5	15	30	0.3	24	2.2	17.7	4.0	0.8
30	1.4	104	30	3.5	0.6	20	35	0.4	30	2.7	20.7	5.0	1.0
36	1.7	150	35	4.5	0.9	20	40	0.5	36	3.3	29.8	5.5	1.3
42	1.9	20.4	45	5.0	1.5	2.5	50	0.8	42	3.8	40.5	7.0	2.0
48	2.2	26.6	45	6.0	2.0	3.0	60	1.1	48	4.4	52.9	8.0	2.8
54	2.5	33.7	60	6.0	3.0	3.0	60	1.4	54	4.9	67.0	9.0	4.0
60	2.7	41.6	60	7.0	3.8	3.0	70	1.8	60	5.5	82.7	9.5	5.3
66	3.0	50.3	65	8.0	3.1	3.5	80	2.7	66	6.0	100.1	10.5	6.0
72	3.3	59.9	75	8.0	4.0	4.0	80	3.7	72	6.6	119.1	11.0	7.6
78	3.6	70.2	80	9.0	6.1	4.0	90	3.9	78	7.1	139.8	12.0	8.0
84	3.8	81.5	85	10.0	10.3	4.5	100	5.3	84	7.6	162.1	13.0	8.5
90	4.1	93.5	95	10.0	12.2	5.0	100	6.3	90	8.2	186.1	14.0	9.0
96	4.4	106.4	100	11.0	15.0	5.0	110	7.4	96	8.7	211.7	15.0	9.5



HORIZONTAL BEND THRUST BLOCK

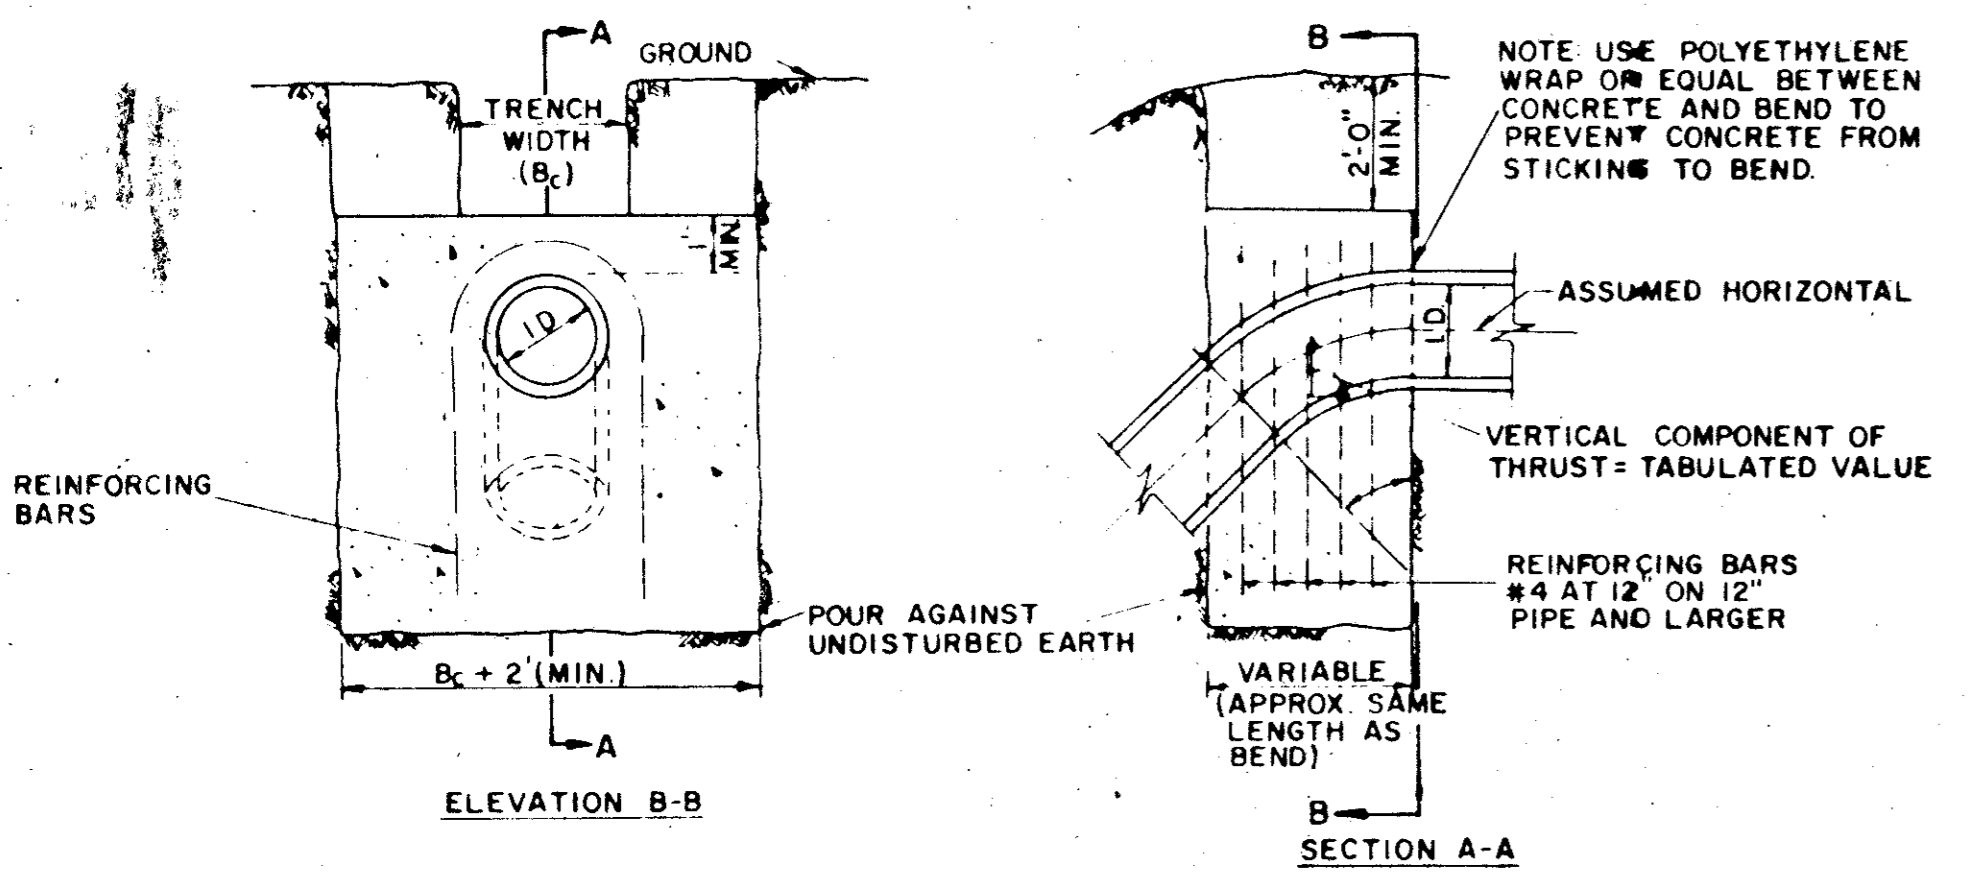

I.D. (IN.)	THRUST (TONS)	11.25°		22.50°		30°		45°		67.50°		90°		I.D. (IN.)
		THRUST (TONS)	VOL. (CY)	THRUST (TONS)	VOL. (CY)	THRUST (TONS)	VOL. (CY)	THRUST (TONS)	VOL. (CY)	THRUST (TONS)	VOL. (CY)	THRUST (TONS)	VOL. (CY)	
4.68	1.0	0.5	2.0	1.0	2.5	1.3	3.6	1.8	4.6	2.3	5.0	2.5	4.68	
10.12	2.2	1.1	4.3	2.2	5.7	2.8	8.0	4.0	10.5	5.2	11.3	5.7	10.12	
16.18	5.0	2.5	9.7	4.9	12.7	6.4	18.0	9.0	23.5	11.8	25.5	12.7	16.18	
20	6.1	3.1	12.0	6.0	15.7	7.9	22.2	11.1	29.2	14.5	31.4	15.7	20	
24	8.2	4.4	17.3	8.7	22.6	11.3	32.0	16.0	41.8	20.9	45.2	22.4	24	
30	10.5	5.2	20.3	10.1	26.5	13.3	37.5	18.8	49.0	24.5	53.1	26.5	30	
36	14.9	7.5	29.2	14.6	38.2	19.1	54.0	27.0	70.5	35.3	76.4	38.2	36	
42	20.3	10.1	39.8	19.9	52.0	26.0	73.5	36.7	96.0	48.0	104.0	52.0	42	
48	26.5	13.2	51.9	26.0	67.9	33.9	96.0	48.0	124.0	62.7	136.0	67.9	48	
54	33.5	16.8	65.7	32.9	85.9	42.9	122.0	60.7	159.0	79.4	172.0	85.9	54	
60	41.4	20.7	81.2	40.6	106.0	53.0	150.0	75.0	194.0	98.0	212.0	106.0	60	
66	50.1	25.0	98.2	49.1	128.0	64.2	182.0	90.7	237.0	119.0	257.0	128.0	66	
72	59.6	29.8	117.0	58.4	153.0	76.3	216.0	108.0	282.0	141.0	305.0	153.0	72	
78	69.9	35.0	137.0	68.6	179.0	90.0	254.0	127.0	331.0	164.0	358.0	179.0	78	
84	81.1	40.5	159.0	79.5	208.0	104.0	294.0	147.0	384.0	192.0	416.0	208.0	84	
90	93.1	46.5	183.0	91.3	239.0	119.0	337.0	169.0	441.0	221.0	477.0	239.0	90	
96	106.0	53.0	208.0	104.0	272.0	136.0	384.0	192.0	502.0	251.0	543.0	272.0	96	

GENERAL NOTES FOR ALL THRUST BLOCKS
 1. All Calculations Are Based On Internal Pressure Of 200 PSI For 24" I.D. Pipe And Smaller And 150 PSI On 30" I.D. And Larger.
 2. Volumes Of Vertical Bend Thrust Blocks Are Net Volumes Of Concrete To Be Furnished. The Corresponding Weight Of The Concrete (Class F) Is Equal To Or Greater Than The Vertical Component Of Thrust On The Vertical Bend.
 3. Wall Thickness (T) Assumed Here For Estimating Purposes Only.
 4. Concrete For Blocking Shall Be Class B Concrete.
 5. Dimensions May Be Varied As Required By Field Conditions Where And As Directed By The Engineer. The Volume Of Concrete Blocking Shall Not Be Less Than Shown Here.


VERTICAL BEND THRUST BLOCK

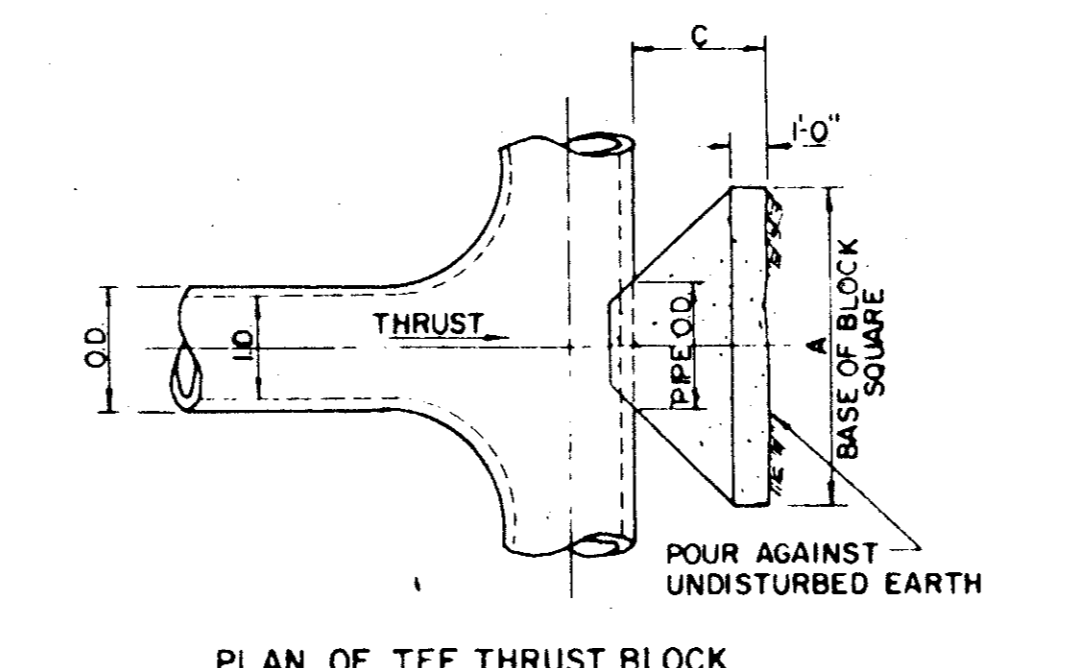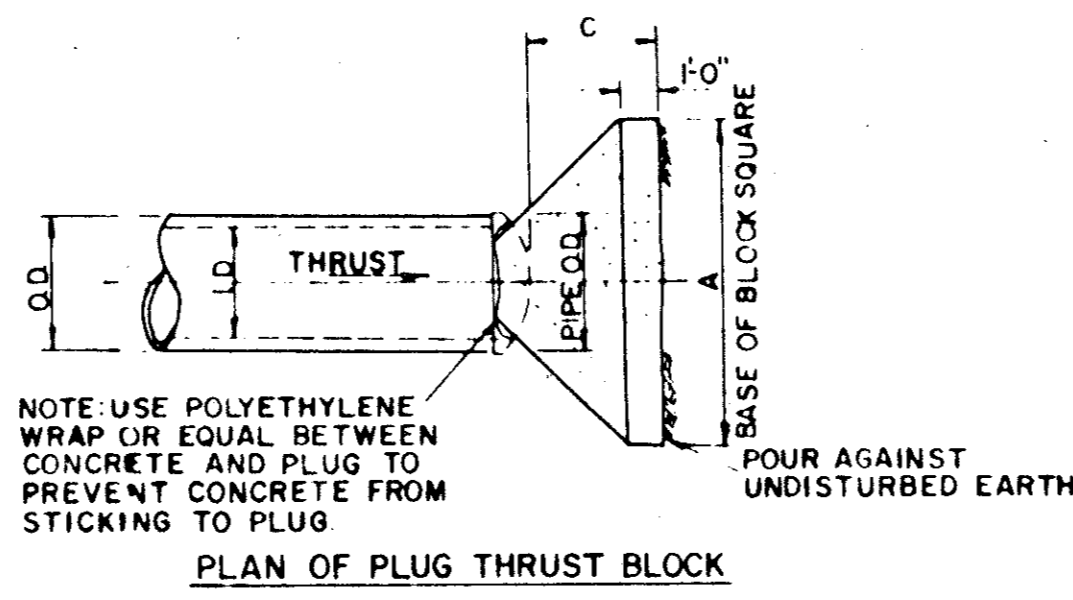


I.D. (IN.)	THRUST (TONS)	C (FT.)	EARTH		ROCK	
			A (FT.)	VOL. (CY)	A (FT.)	VOL. (CY)
4.68	5.1	1.5	2.5	0.3	2.0	0.2
10.12	11.3	1.5	3.5	0.6	2.5	0.3
16.18	25.5	2.0	5.5	1.6	4.0	0.9
20	31.5	2.0	6.0	1.7	4.0	0.9
24	45.2	2.5	7.0	2.1	5.0	1.1
30	53.0	3.0	7.5	2.4	5.5	1.2
36	76.3	4.0	9.0	3.1	6.5	1.6
42	104.0	4.5	10.5	3.6	7.5	1.8
48	136.0	5.0	12.0	4.1	8.5	2.1
54	172.0	5.5	13.5	4.6	9.5	2.3
60	212.0	6.0	15.0	5.1	10.5	2.5
66	257.0	6.5	16.5	5.6	11.5	2.7
72	305.0	7.5	17.5	6.2	12.5	2.9
78	358.0	8.0	19.0	6.8	13.5	3.1
84	416.0	8.5	20.5	7.3	14.5	3.3
90	477.0	9.0	22.0	7.7	15.5	3.5
96	543.0	9.5	23.5	8.1	16.5	3.7

PLUG & TEE THRUST BLOCK

TYPICAL VALVE SETTING AND BOX

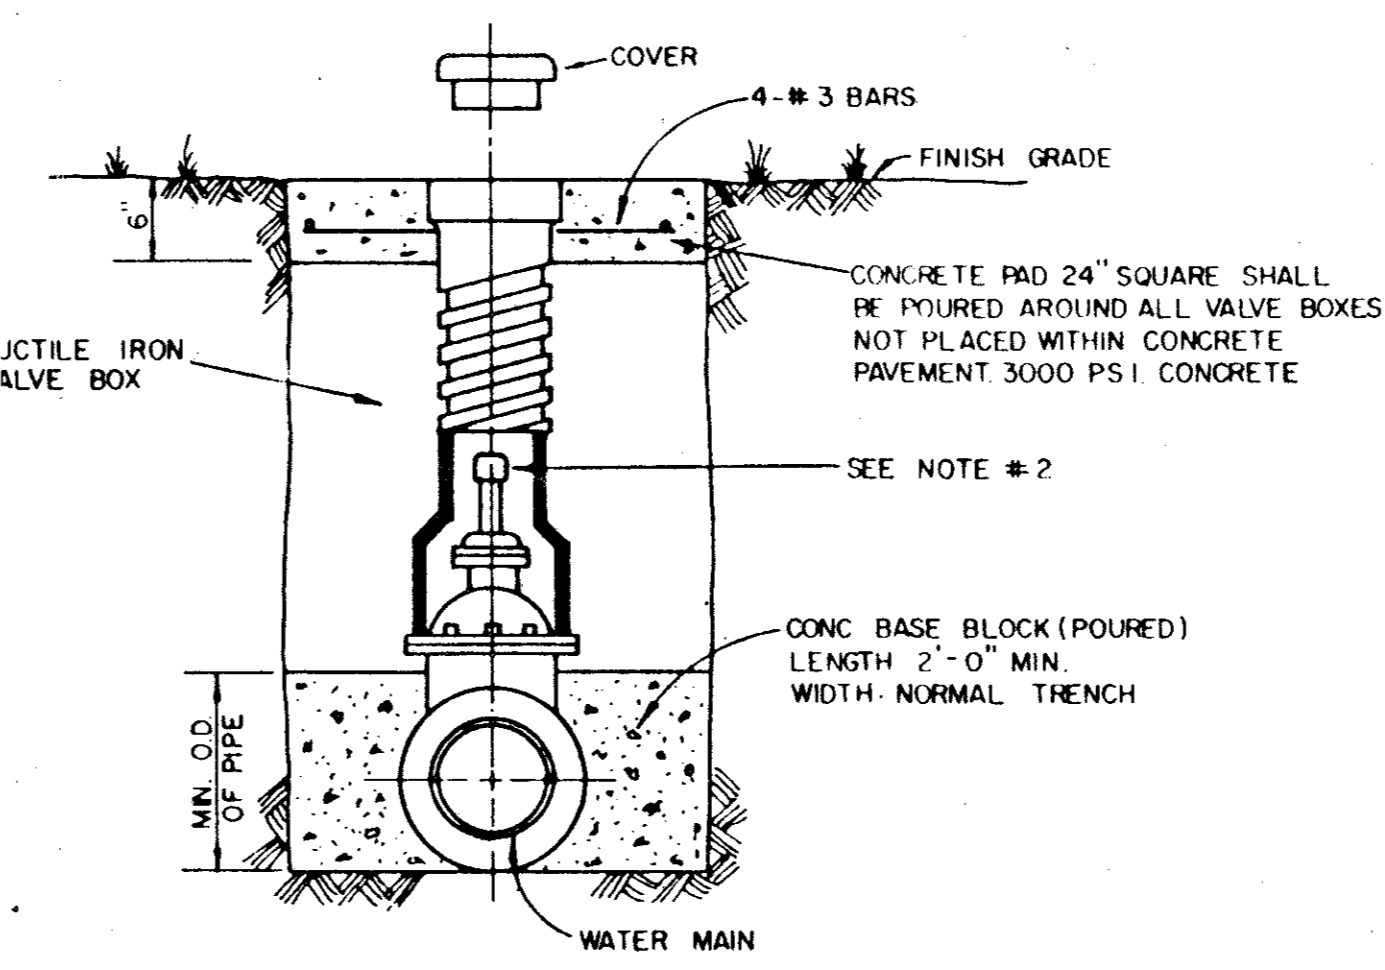

NOTE:
 1. GATE VALVES SHALL BE IN ACCORDANCE WITH AWWA STANDARD C-509-80 OR LATEST THEREOF ALL VALVES SHALL BE "MUELLER" OR APPROVED EQUAL.
 2. A PERMANENTLY ATTACHED VALVE EXTENSION STEM SHALL BE REQUIRED FOR ANY VALVE THATS OPERATING NUT IS LOCATED IN EXCESS OF 4 FEET BELOW THE TOP OF VALVE BOX. THIS EXTENSION SHALL BE OF SUFFICIENT LENGTH TO INSURE THAT ITS TOP IS WITHIN 4" OF VALVE BOX LID MANUFACTURED VALVE STACK DUCTILE IRON PIPE TO BE USED FOR EXTENSION GREATER THAN 4'-0" BELL END OF STACK TO BE FITTED OVER VALVE. VALVE AND VALVE STACK IS TO BE POLY WRAPPED.
 3. VALVES SHALL BE OF DUCTILE IRON W/RUBBER ENCAPSULATED DISK BODY BOLTS SHALL BE STAINLESS STEEL OF SAME SIZE ON EACH VALVE.

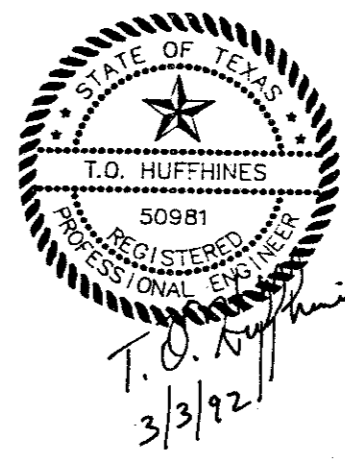

TOWN OF ADDISON, TEXAS
 DEPARTMENT OF ENGINEERING
STANDARD CONSTRUCTION DETAILS
THRUST BLOCKS