

St. Louis & Southwestern R.R.

CONCRETE ENCASUREMENT TO BE USED WHEN PROPOSED  
SANITARY SEWER CROSES EXISTING WATER OR  
SANITARY SEWER MAINS

35 L.F. TO BE PLACED BY OTHER THAN OPEN CUT.

15' Easement For 54" City of Dallas Water Main

RODEWAY INN AND JOJO'S PLUMBING  
CONNECTIONS BY OTHERS

0100 Line A - Conn.  
To Exist. 4' Ø Std. M.H.


STATION 0+60 CONSTRUCT 6" STUBOUT  
CONNECT TO EXISTING 5" PRIVATE SEWER  
LATERAL. PLUG DOWNSTREAM 5" PRIVATE  
SEWER LATERAL AND ABANDON

Sanitary Sewer Curve Data

Δ = 20°  
R = 150'  
L = 52.36'  
T = 26.52'

- NOTE: 1. All work to be performed in accordance with City of Addison Standards and Specifications
2. Sanitary Sewer line embedment shall be 6" sand cushion on all sides of pipe. Remaining trench shall be backfilled and compacted with "select" material in accordance with City of Addison Standards and Specifications.
3. Sanitary Sewer Cleanouts shall have 18" X 18" X 6" Concrete pad poured around top.

BENCH MARK: "□" cut in top of curb at N.W. corner of parking for Gulf Oil Company Service Station at S.W. corner of Midway Road and Belt Line Road  
ELEV: 624.32

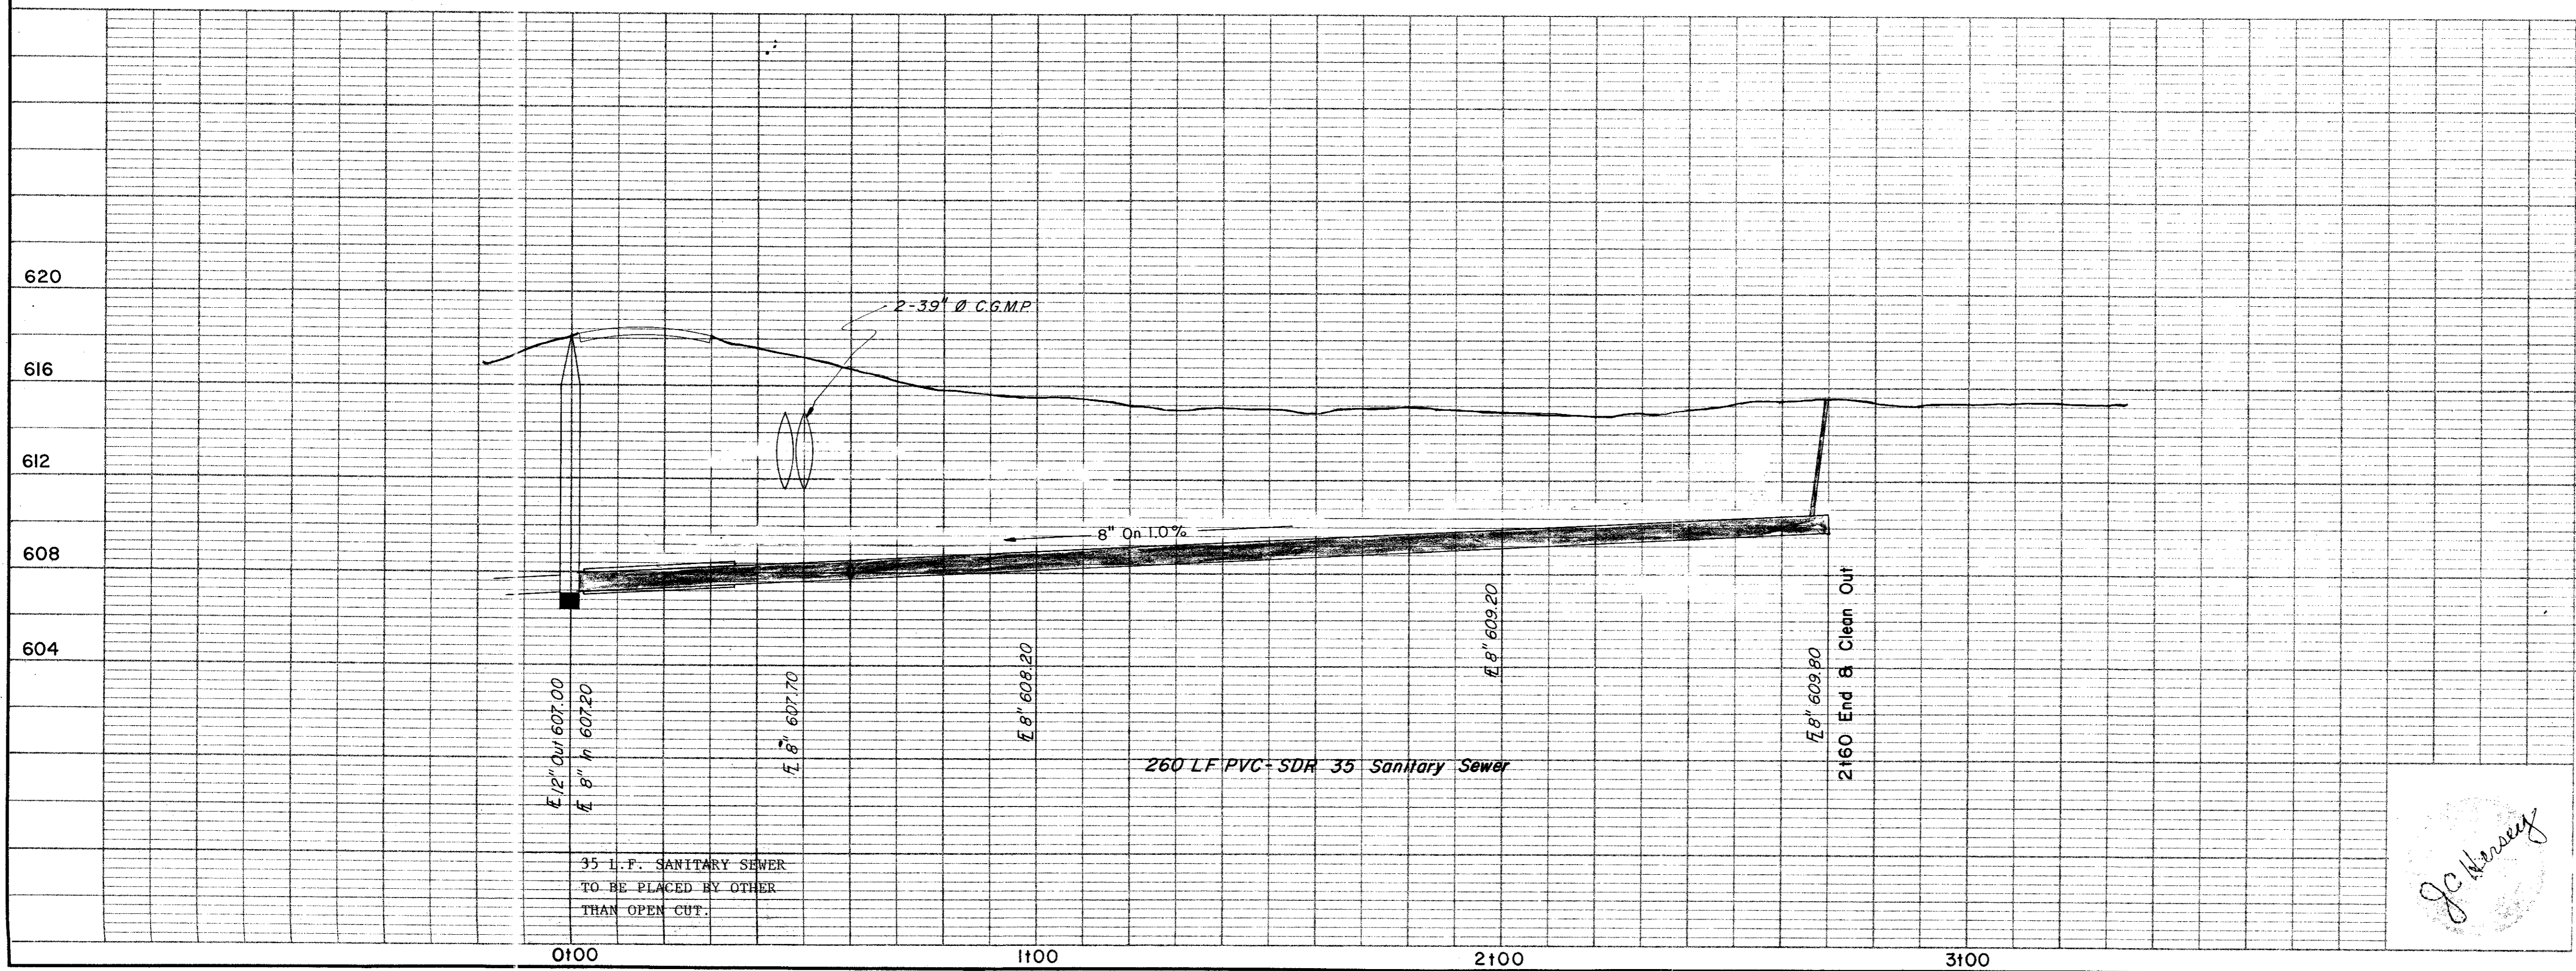

CITY OF ADDISON  
APPROVED  
FOR CONSTRUCTION  
BUILDING DEPARTMENT  
DATE: 6-29-80  
CONTRACTOR IS HEREBY INSTRUCTED TO EXERCISE CARE IN MEETING OR EXCEEDING ALL REQUIREMENTS OF BOTH NATIONAL AND LOCAL CODES AND ORDINANCES APPLICABLE TO HIS WORK. APPROVAL OF THESE DRAWINGS SHALL NOT BE CONSTRUED TO RELIEVE RESPONSIBILITY OR LIABILITY TO SUCH CODES.

*J.C. Hersey*

NO.	REVISION	BY	DATE
<b>SANITARY SEWER MAIN</b> <b>ROADWAY INN</b> ADDISON, DALLAS COUNTY, TEXAS <b>HERSEY AND ASSOCIATES</b> CONSULTING ENGINEERS DALLAS, TEXAS			
DESIGNED - J.C.H.	DRAWN - S.M.M.	DATE - 2/5/80	
APPROVED - J.C.H.	CHECKED - J.C.H.	SCALE - AS NOTED	SHEET 1 OF 1