



- NOTES: 1. FOR STRUCTURAL NOTES & DETAILS, SEE SHEET 34 OF 44.  
 2. WALL & ROOF SLAB REINFORCING STEEL NOT SHOWN FOR CLARITY.  
 3. ALL OPENINGS TO HAVE EXTRA REINFC STEEL AS SHOWN IN DETAIL 3 ON SHEET 34 OF 44.  
 4. ALL HOOKS SHOWN TO BE STANDARD A.C.I. HOOKS.  
 5. STEEL REINFC LAP LENGTHS AS SHOWN IN DETAIL 1 ON SHEET 34 OF 44.


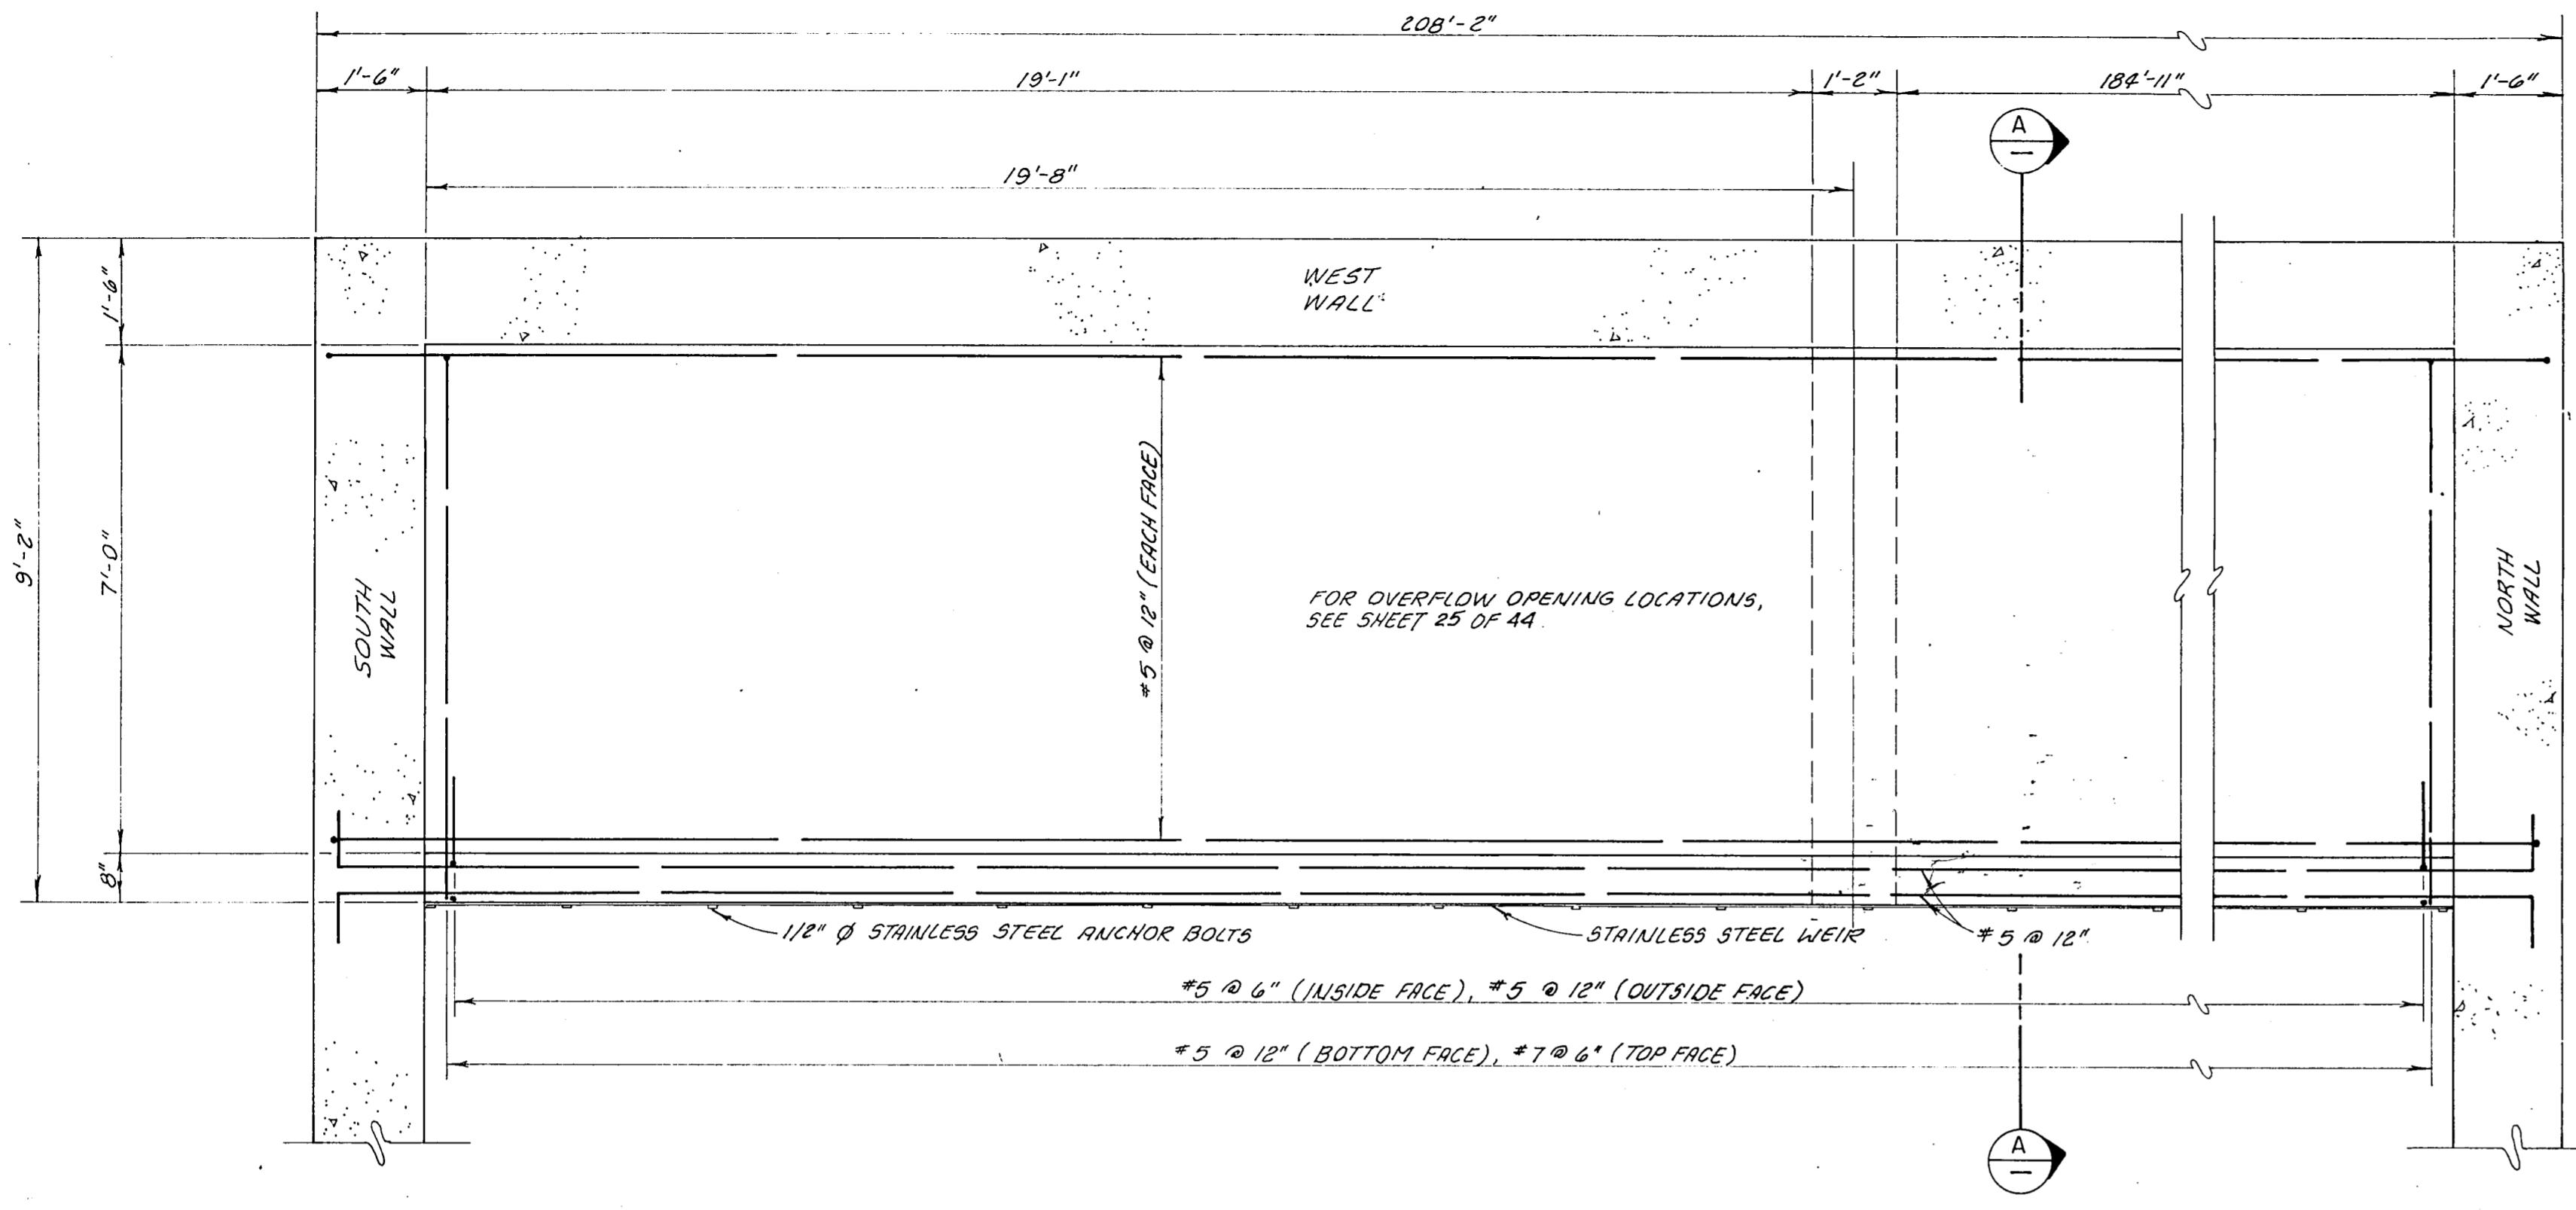


**PLAN OVERFLOW WEIR**  
 SCALE: 1/2" = 1'-0"



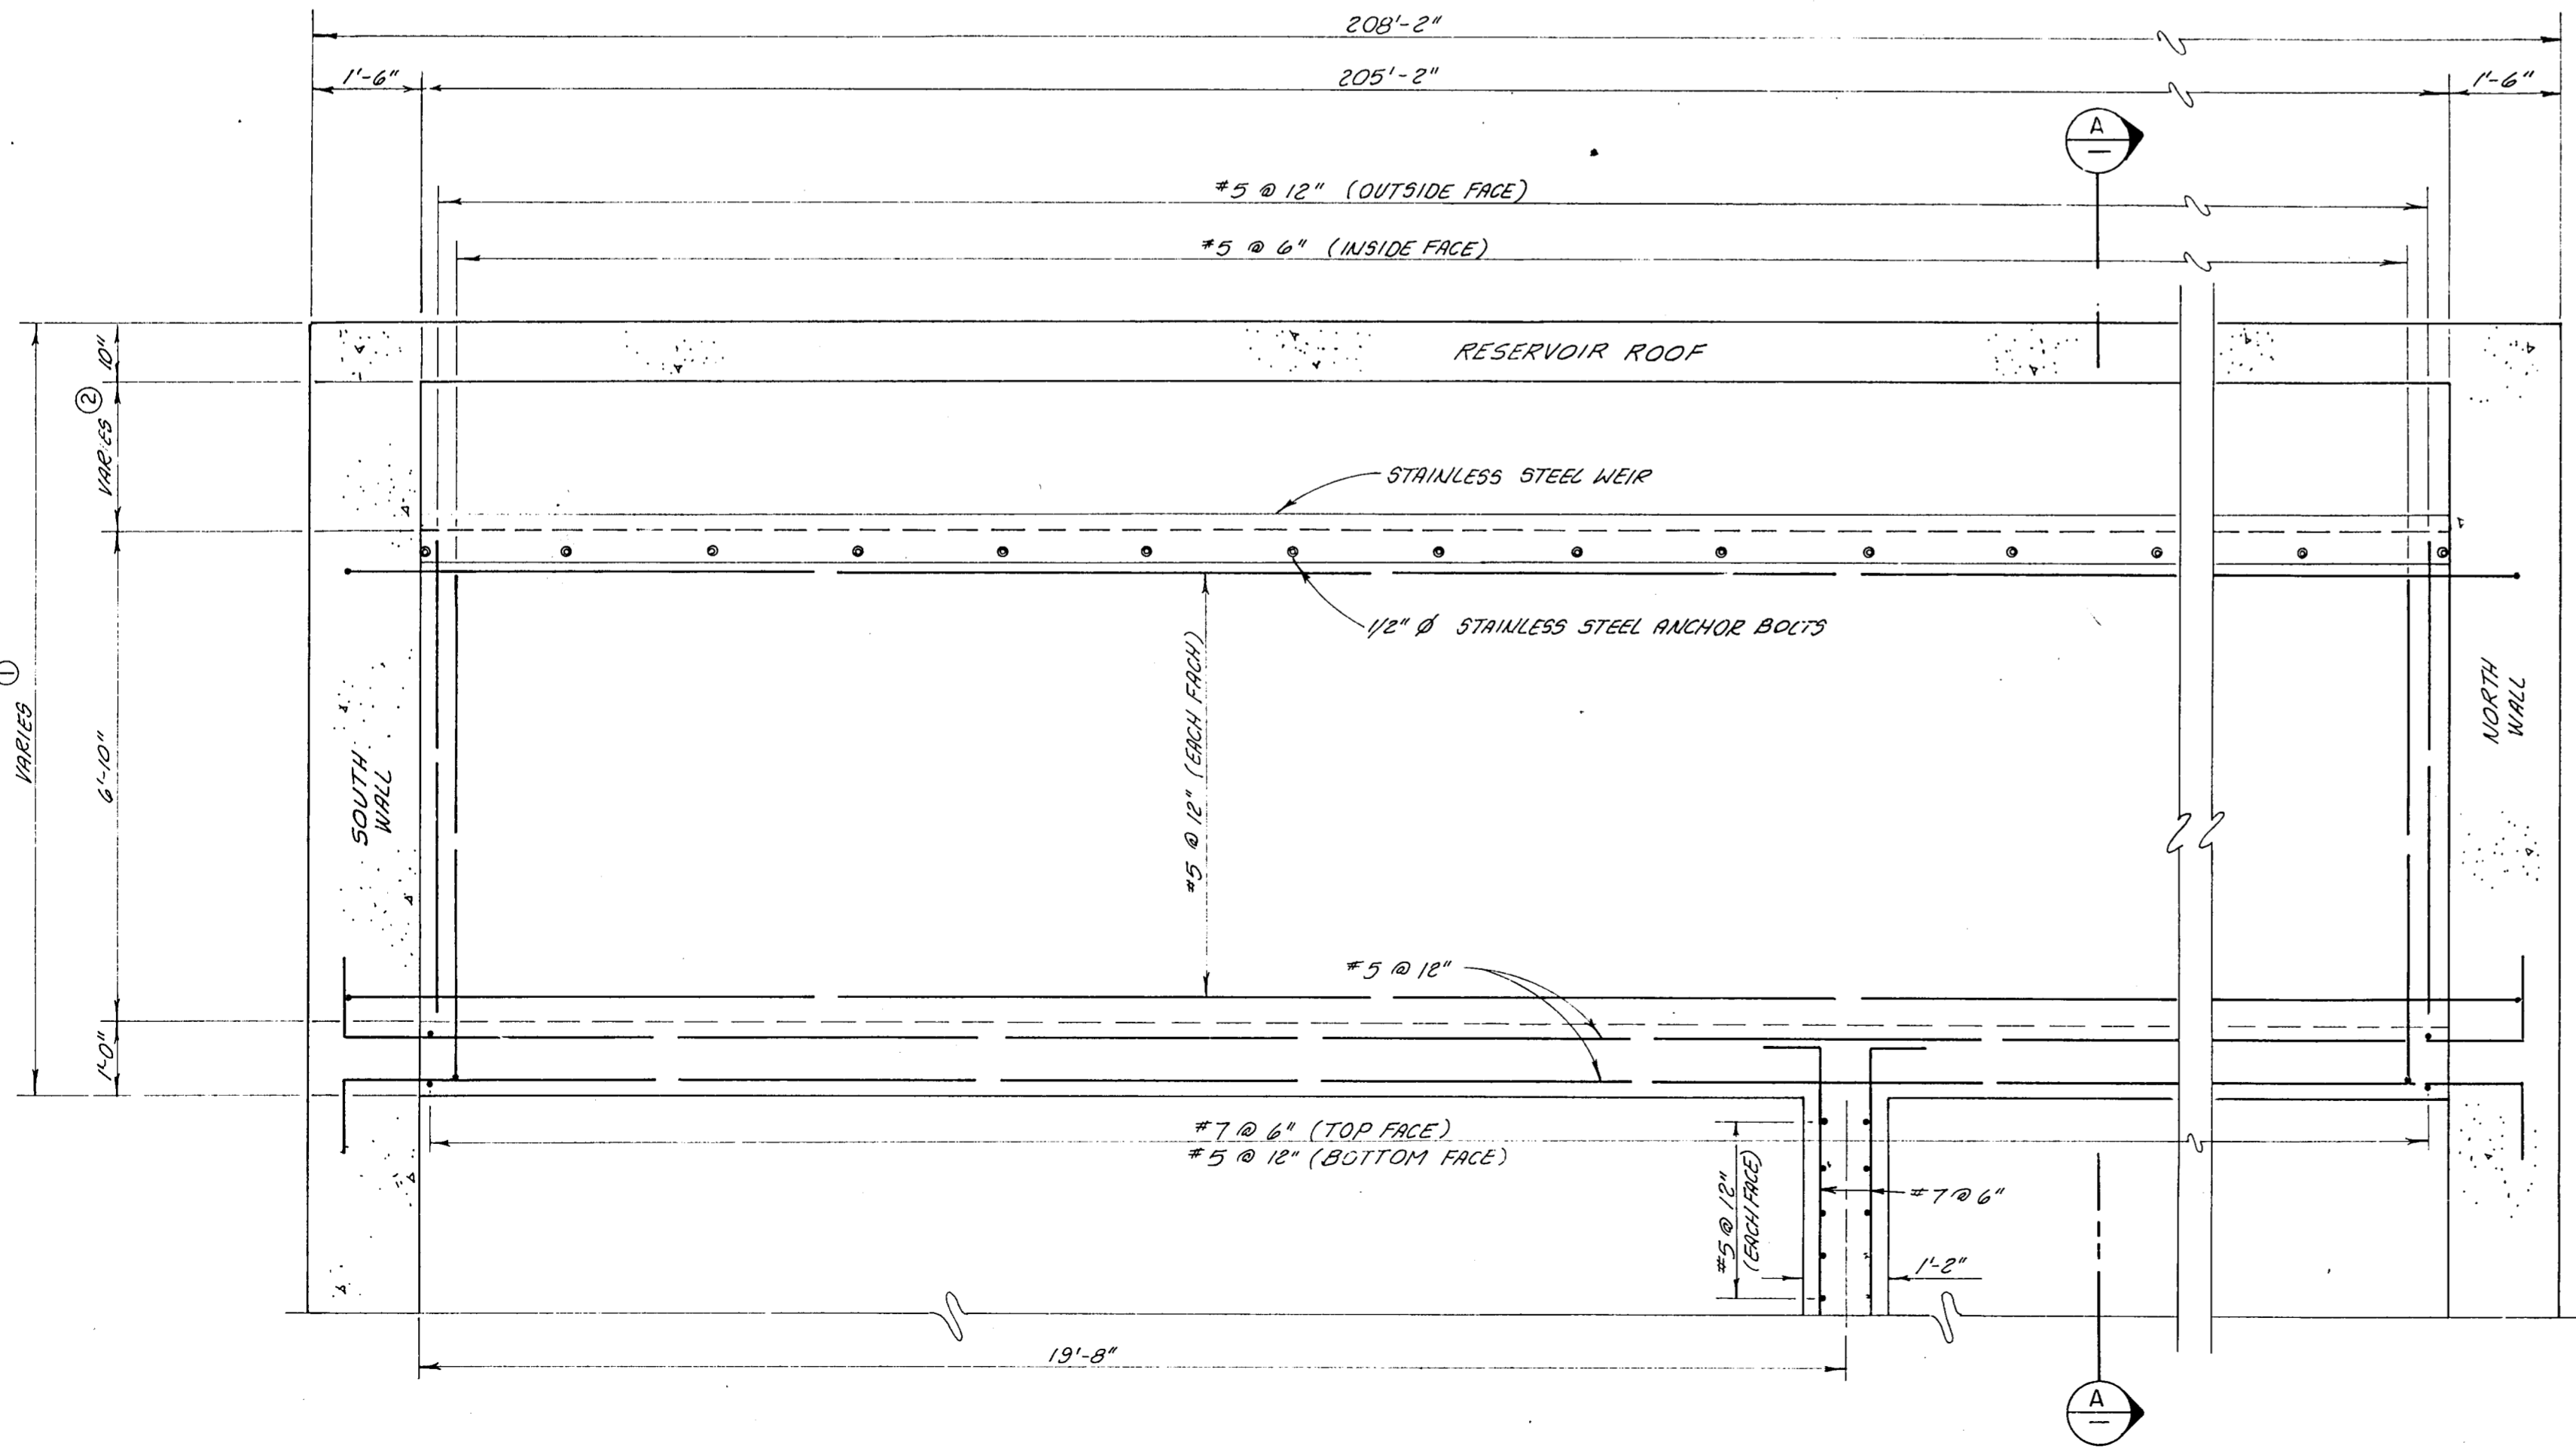


**ELEVATION OVERFLOW WEIR**  
 SCALE: 1/2" = 1'-0"

	①	②	③
NORTH WALL	13'-0"	4'-4"	11'-2"
SOUTH WALL	10'-10"	2'-2"	9'-0"

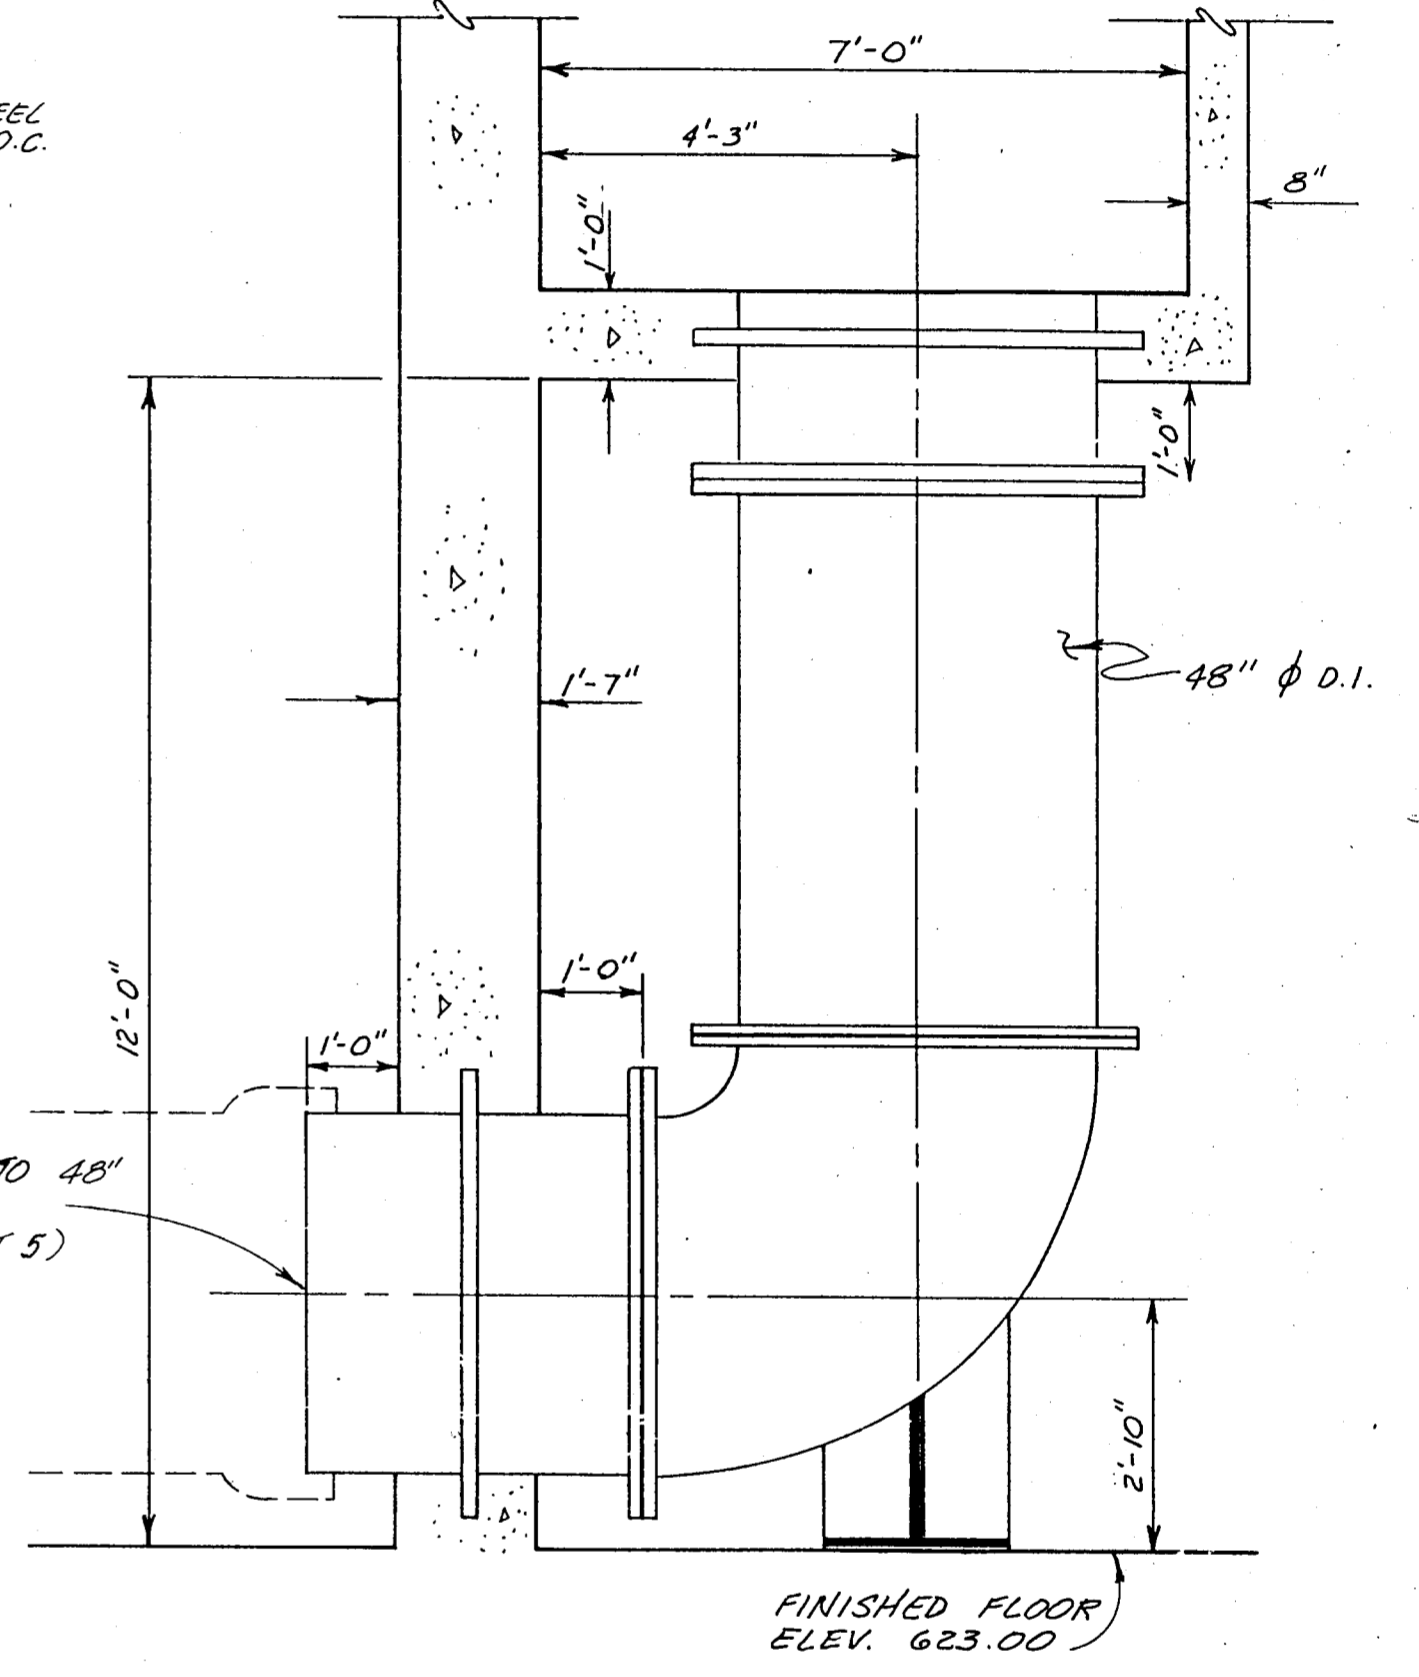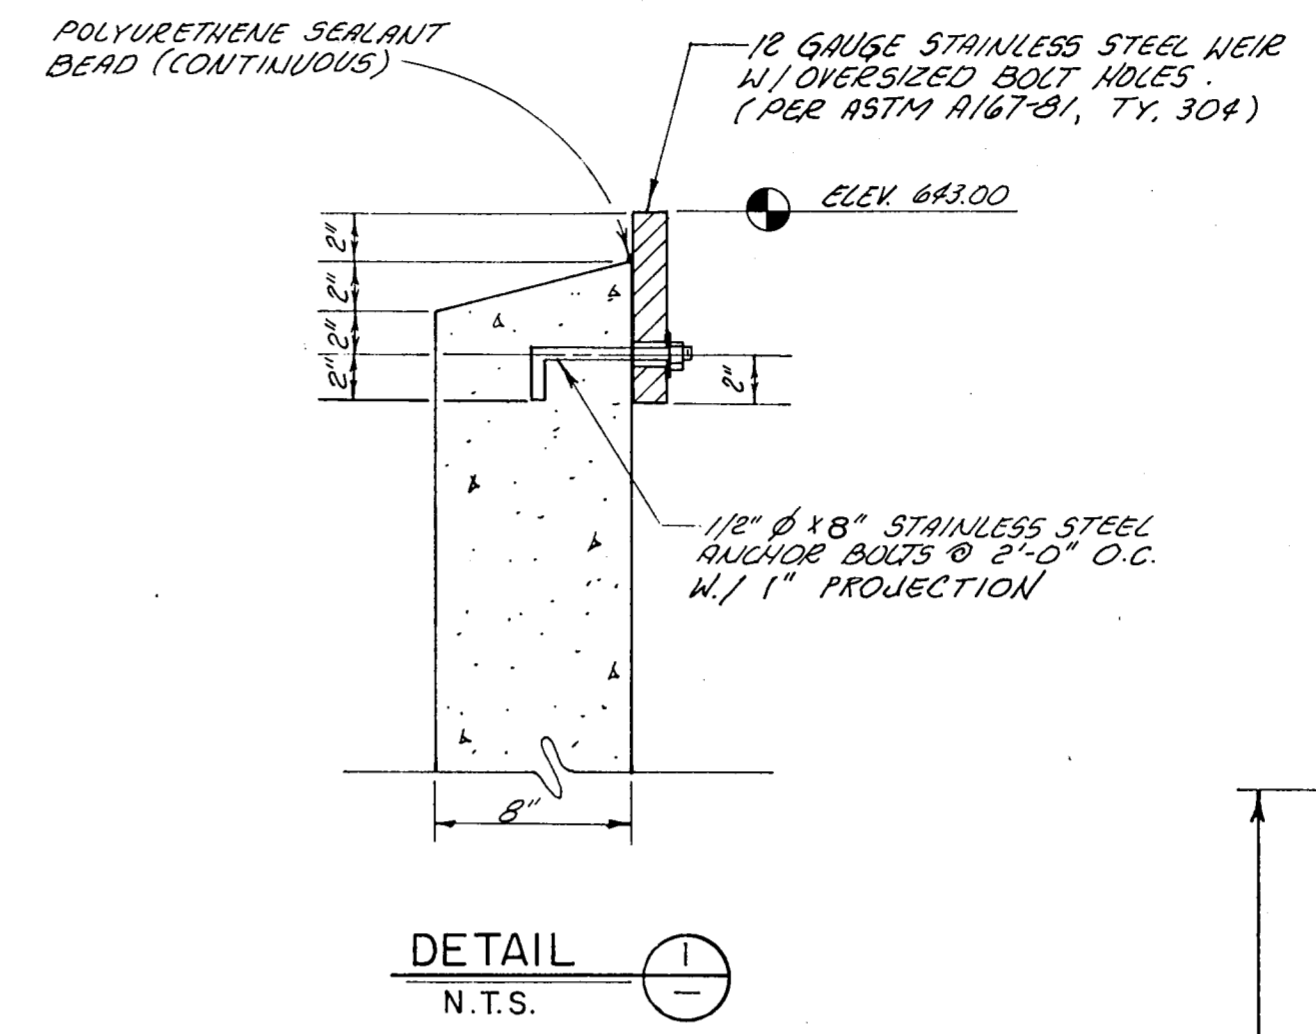

**OVERFLOW DETAIL 2**  
 N.T.S.

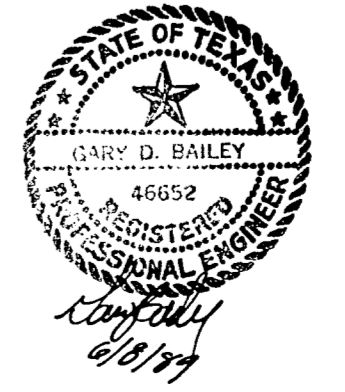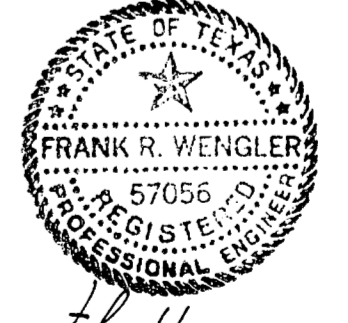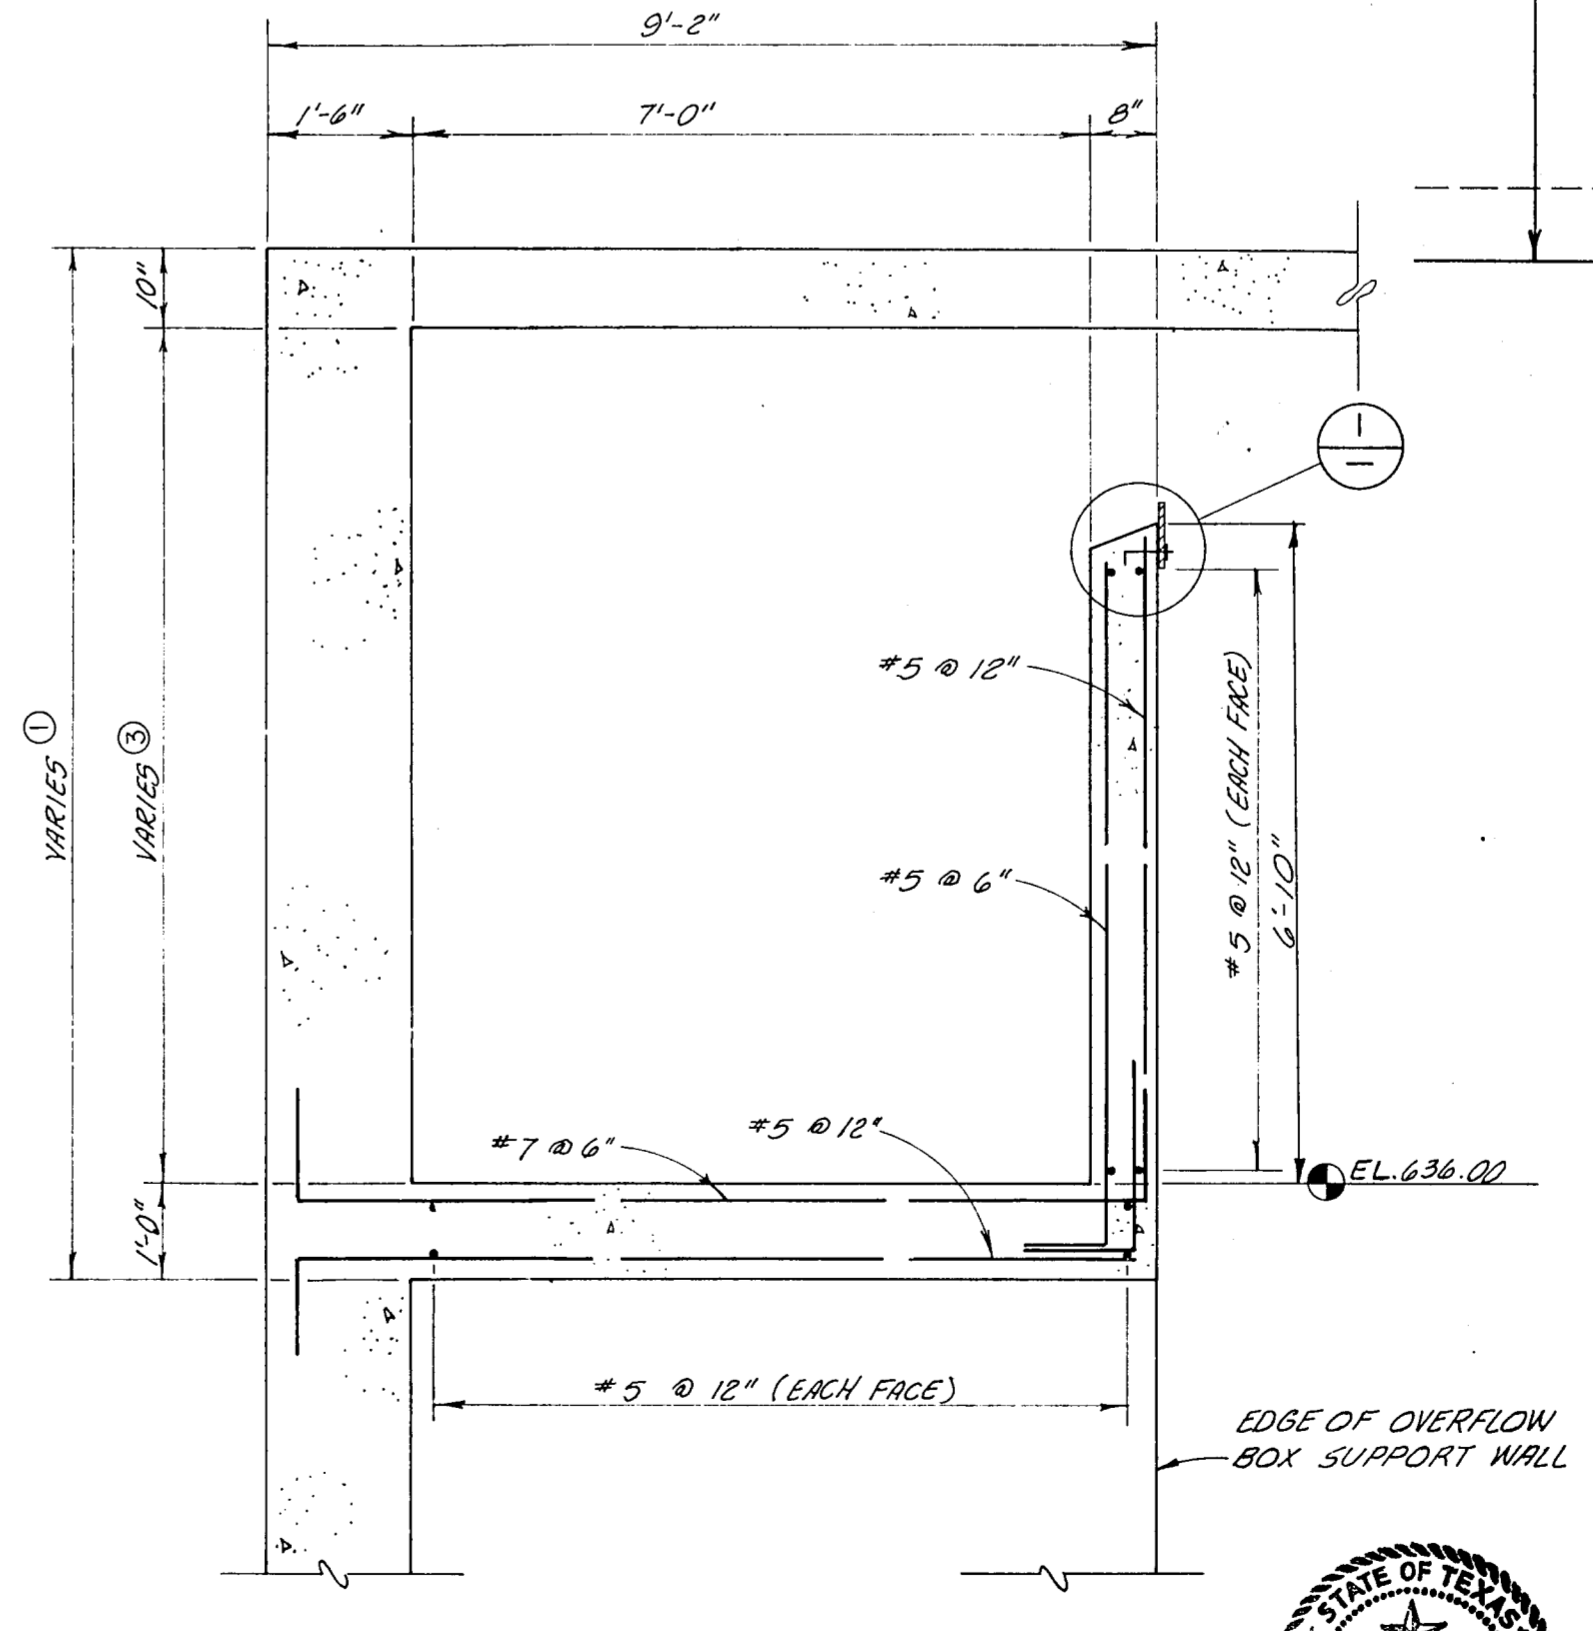

NO.	DATE	REVISION	APPROVED
BELTWOOD RESERVOIR EXPANSION RESERVOIR - OVERFLOW DETAILS			
DALLAS WATER UTILITIES CITY OF DALLAS, TEXAS TurnerCollie & Braden Inc.			
DESIGN	F.R.W.	CONTRACT NO.	89-79
DRAWN	C.A.		31
TRACED		FILE NO.	630 Q 700 F
CHECKED			OF 44
DATE	5/89		