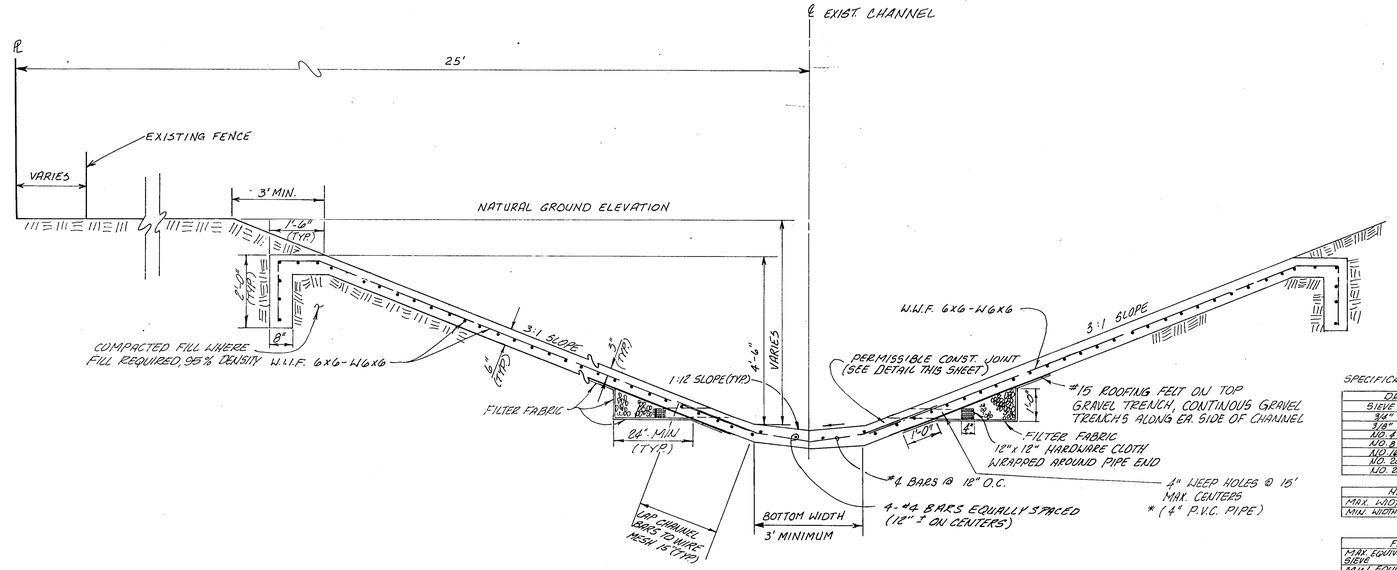

SECTION (A/5)
SCALE: 1/2"= 1'-0"
(STA. 3+60 TO STA. 4+20)

SPECIFICATION FOR:

DRAIN GRAVEL	
SIEVE SIZE	% PASSER
3/4"	100
3/8"	85 - 100
NO. 4	15 - 100
NO. 8	0 - 50
NO. 16	0 - 15
NO. 20	0 - 5
NO. 200	0 - 5

HARDWARE CLOTH	
MAX. WIDTH OF MESH OPENING	1/8"
MIN. WIDTH OF MESH OPENING	1/16"

FILTER FABRIC	
MAX. EQUIVALENT OPENING SIEVE	NO. 70 SIEVE
MIN. EQUIVALENT OPENING SIEVE	NO. 100 SIEVE

* P.V.C. PIPE SHALL BE SCHEDULE 40

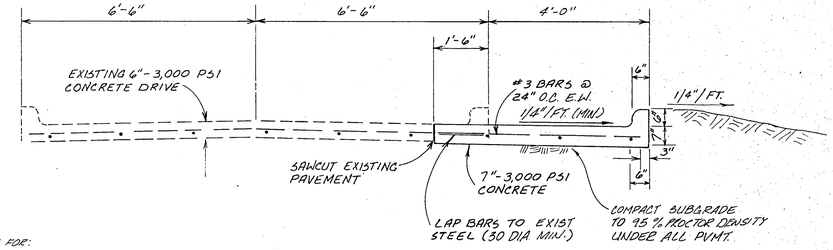

SECTION (D/TYP)
SCALE: 1/2"= 1'-0"

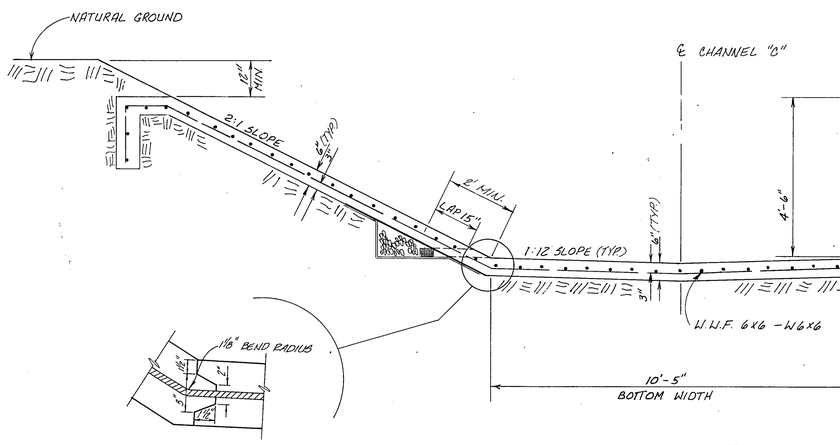

PERMISSIBLE CONSTRUCTION JOINT
N.T.S.

SECTION (C/5)
SCALE: 1/2"=1'-0"

◎ 3/4" TRANSVERSE EXPANSION JOINT TO BE PROVIDED AT 80' C-C. (MAX.) SEE SHT. 4 FOR CONSTRUCTION DETAILS. WATERSTOP NOT REQUIRED.

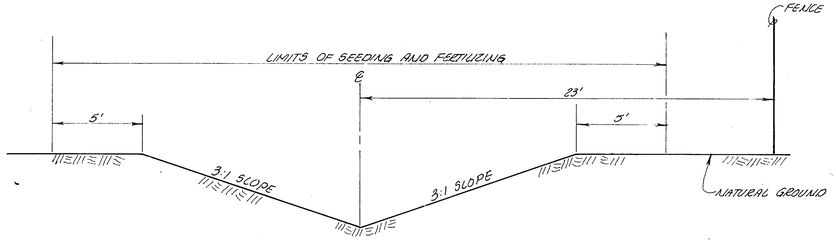

SECTION (B/5)
SCALE: 1/4"= 1'-0"

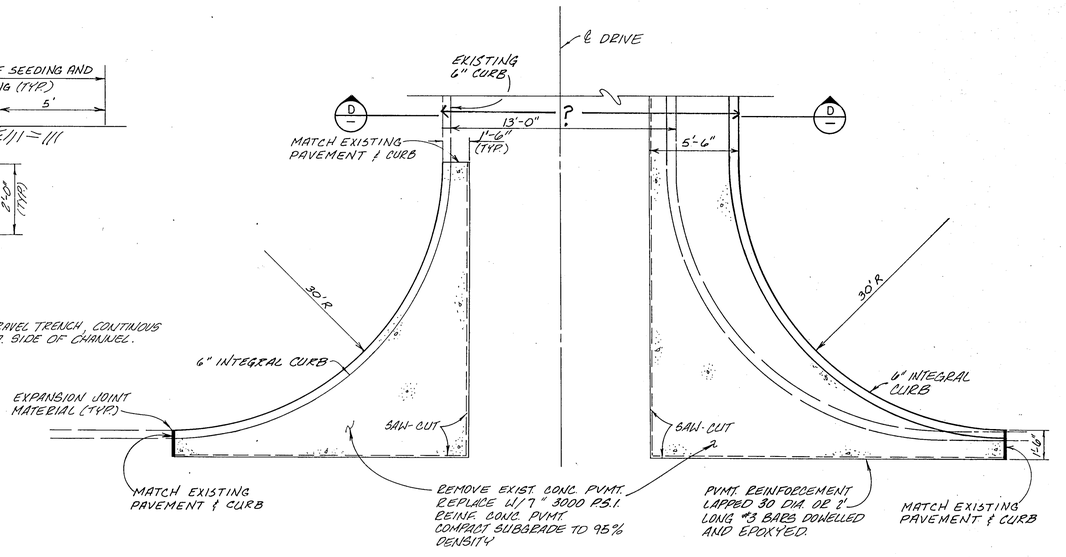

ENTRANCE DRIVE DETAIL
N.T.S.

STATE OF TEXAS
MICHAEL A. BURNS
59990
REGISTERED PROFESSIONAL ENGINEER
6/9/89

NO.	DATE	REVISION	APPROVED

BELTWOOD RESERVOIR EXPANSION

PAVING AND DRAINAGE DETAILS

DALLAS WATER UTILITIES
CITY OF DALLAS, TEXAS

Turner Collie & Braden Inc.

DESIGN	M.A.B.	CONTRACT NO. 89-79	SHEET NO. 6
DRAWN	C.A.		
TRACED		FILE NO 630Q700F	OF 44
CHECKED			
DATE	5/89		