


ALL PIPING, VALVES, FITTINGS, ETC. SHALL BE UL LISTED FOR FIRE SPRINKLER SYSTEM APPLICATIONS. BE IN COMPLIANCE WITH NFPA 13, AND BE INSTALLED IN ACCORDANCE TO NFPA 13, THE AUTHORITY HAVING JURISDICTION AND CITY OF ADDISON.





FIRE SPRINKLER RISER DETAIL
NO SCALE

GENERAL NOTES

- A. DESIGN AND INSTALL NEW FIRE SPRINKLER SYSTEM IN ACCORDANCE TO THE LATEST ADDITION OF NFPA 13 AND AUTHORITY HAVING JURISDICTION.
- B. ALL FIRE SPRINKLER HEADS SHALL BE QUICK RESPONSE, CONCEALED TYPE, WITH HEAD COVER PAINTED AS DIRECTED BY ARCHITECT.
- C. PROVIDE FIRE SPRINKLER COVERAGE IN ACCORDANCE TO NFPA 13 AND THE LOCAL AUTHORITY HAVING JURISDICTION IN ALL AREAS OF THE BUILDING UNLESS SPECIFICALLY NOTED OTHERWISE.
- D. SPRINKLER COVERAGE SHALL INCLUDE ABOVE CEILING ATTIC SPACE.

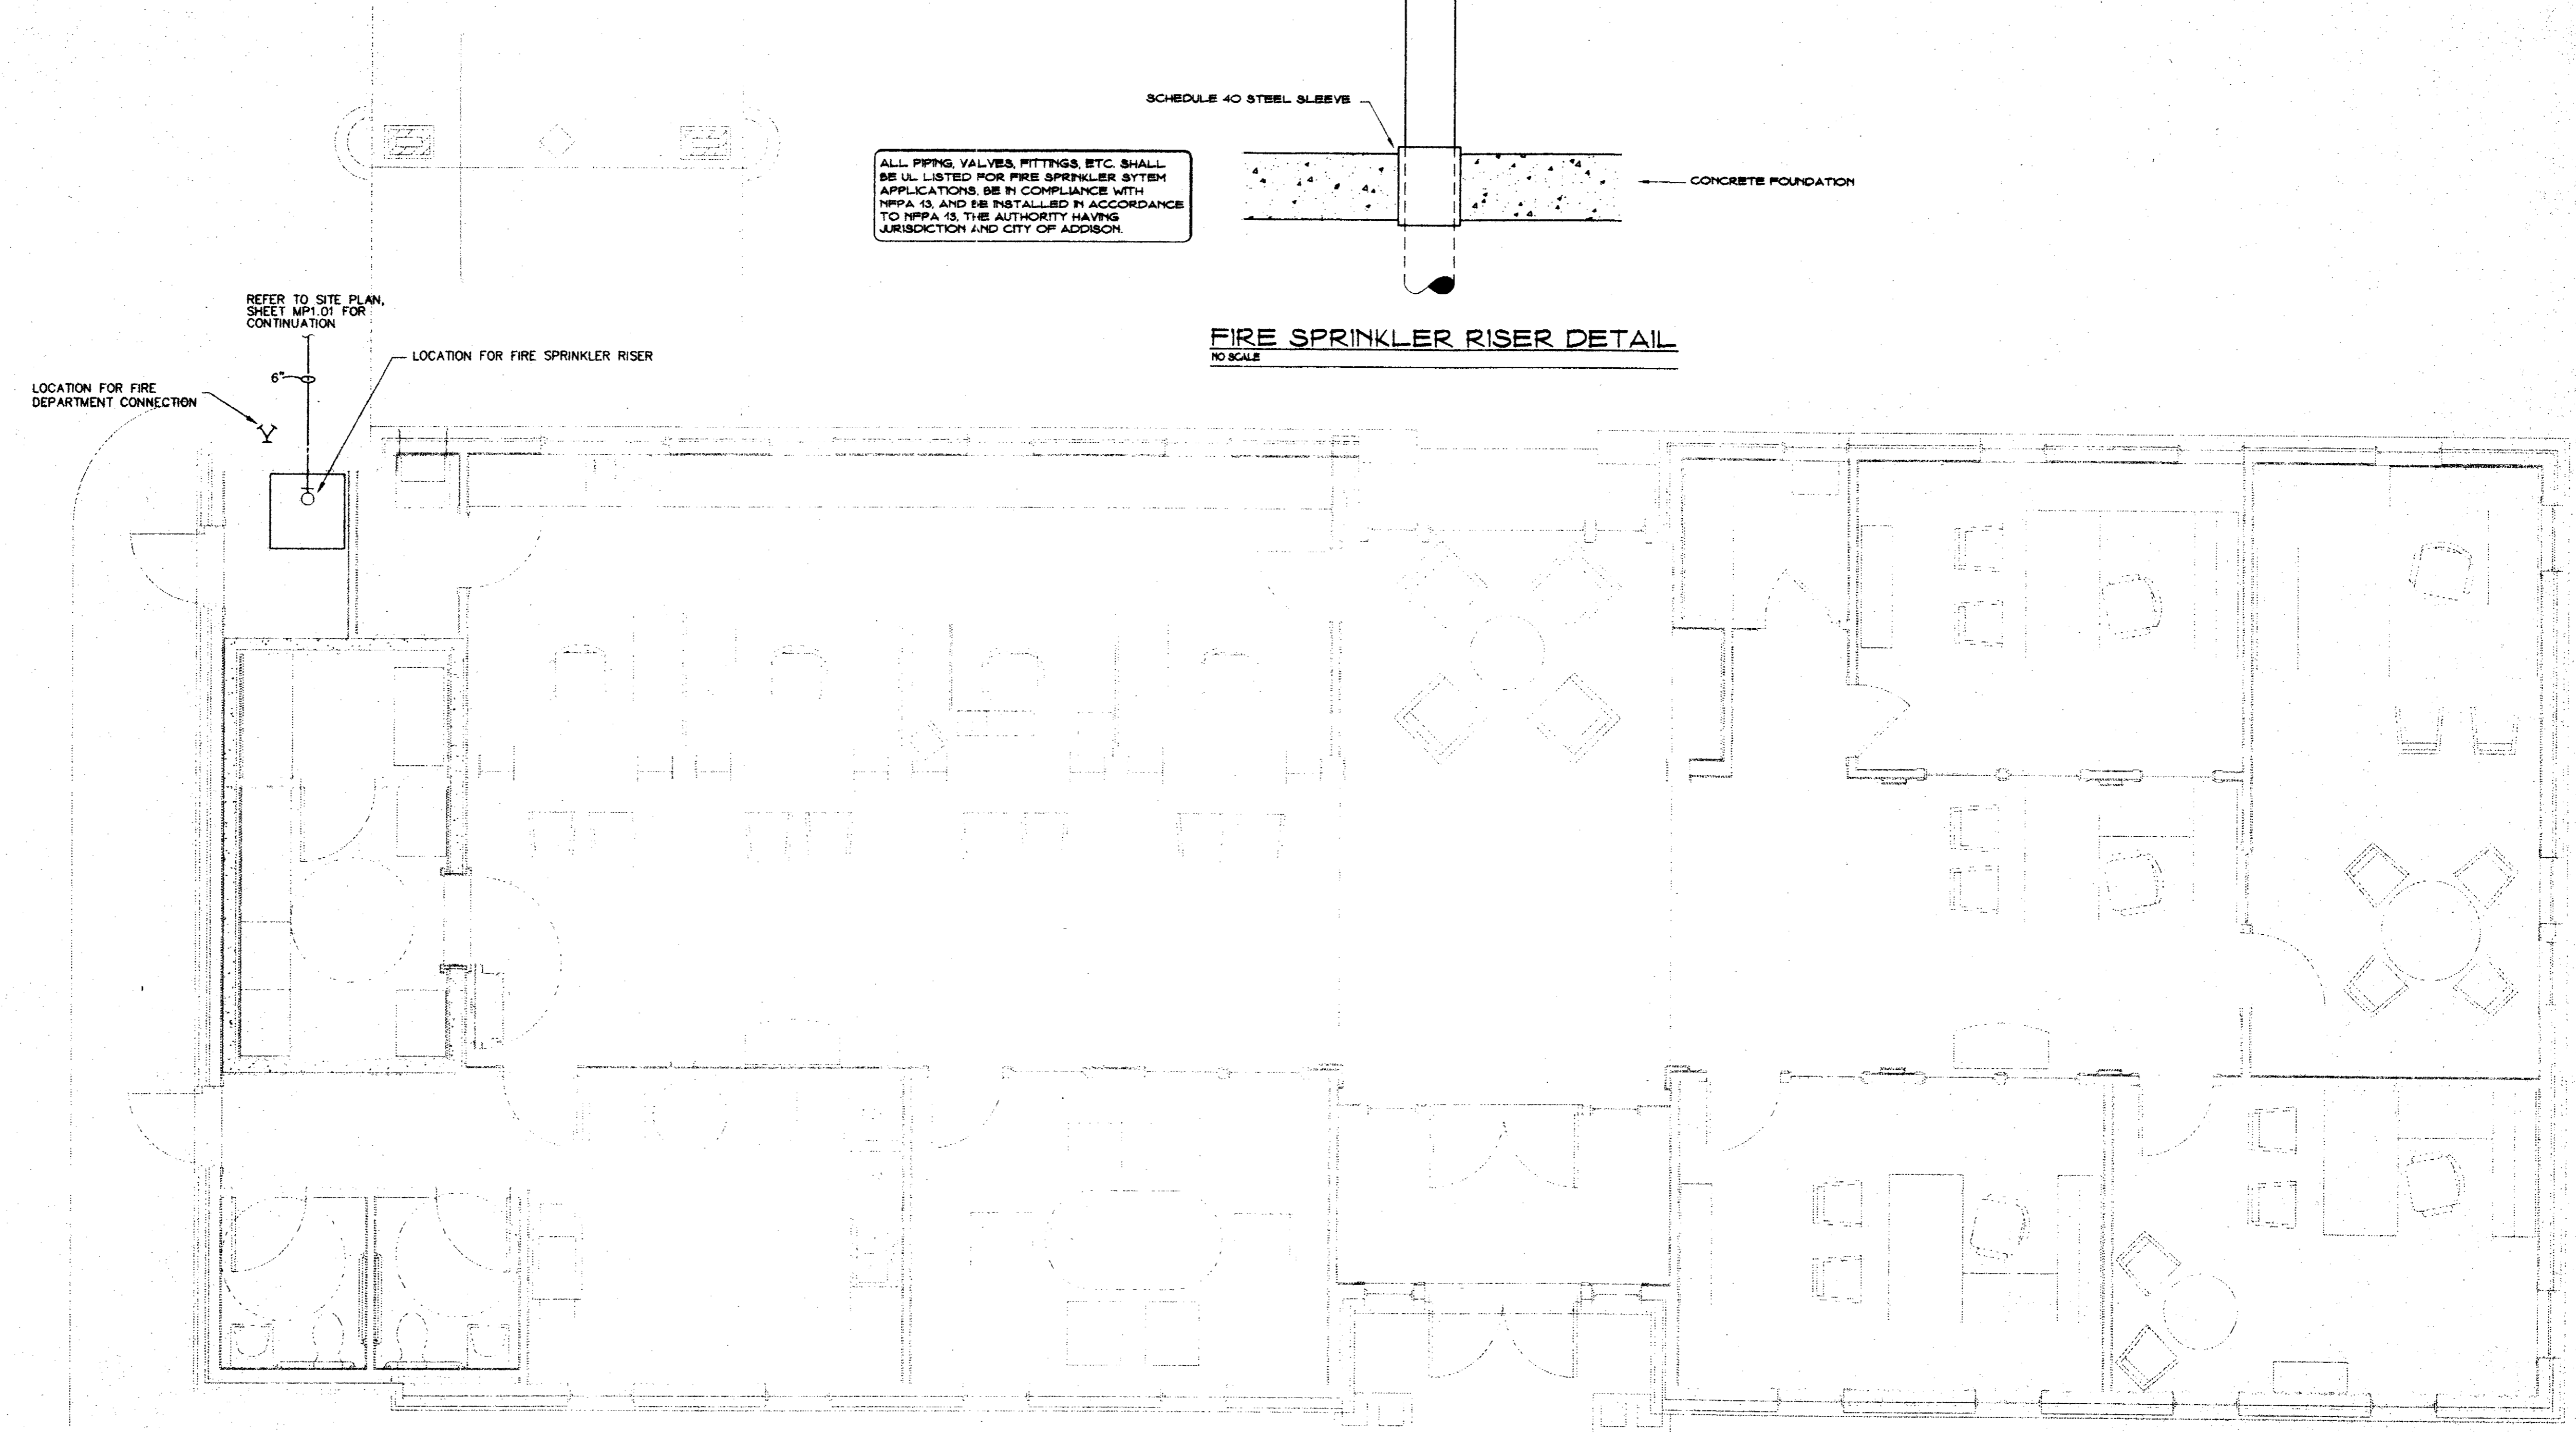

FLOORPLAN - FIRE SPRINKLER SYSTEM
SCALE: 1/4" = 1'-0"

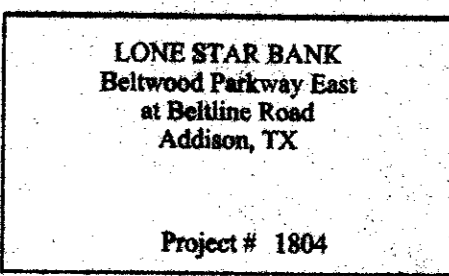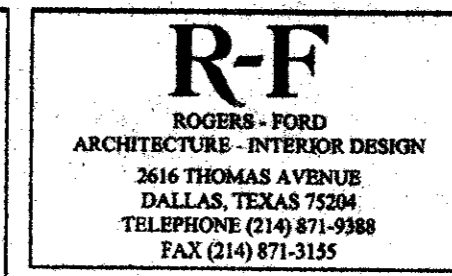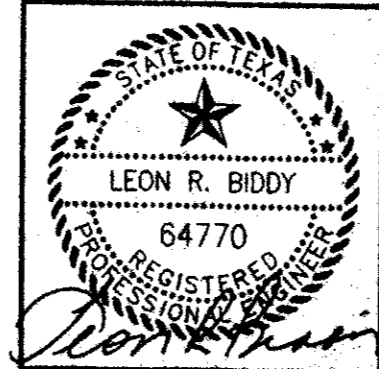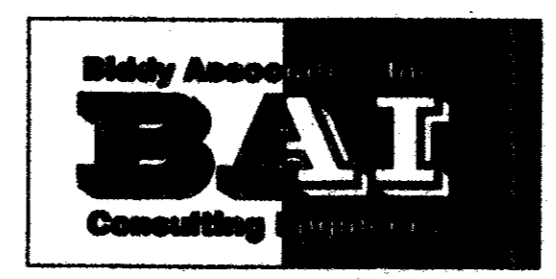

7-28-2000 Issue for Permit
8-17-2000 Issue for Fire Dept
12-5-2000 Concept Issue

FPI.01