


ATTACHMENT NO. 1 - 24" I.D. WATER MAIN EXTENSION
IN BELT LINE ROAD FROM INWOOD ROAD TO ADDISON ROAD

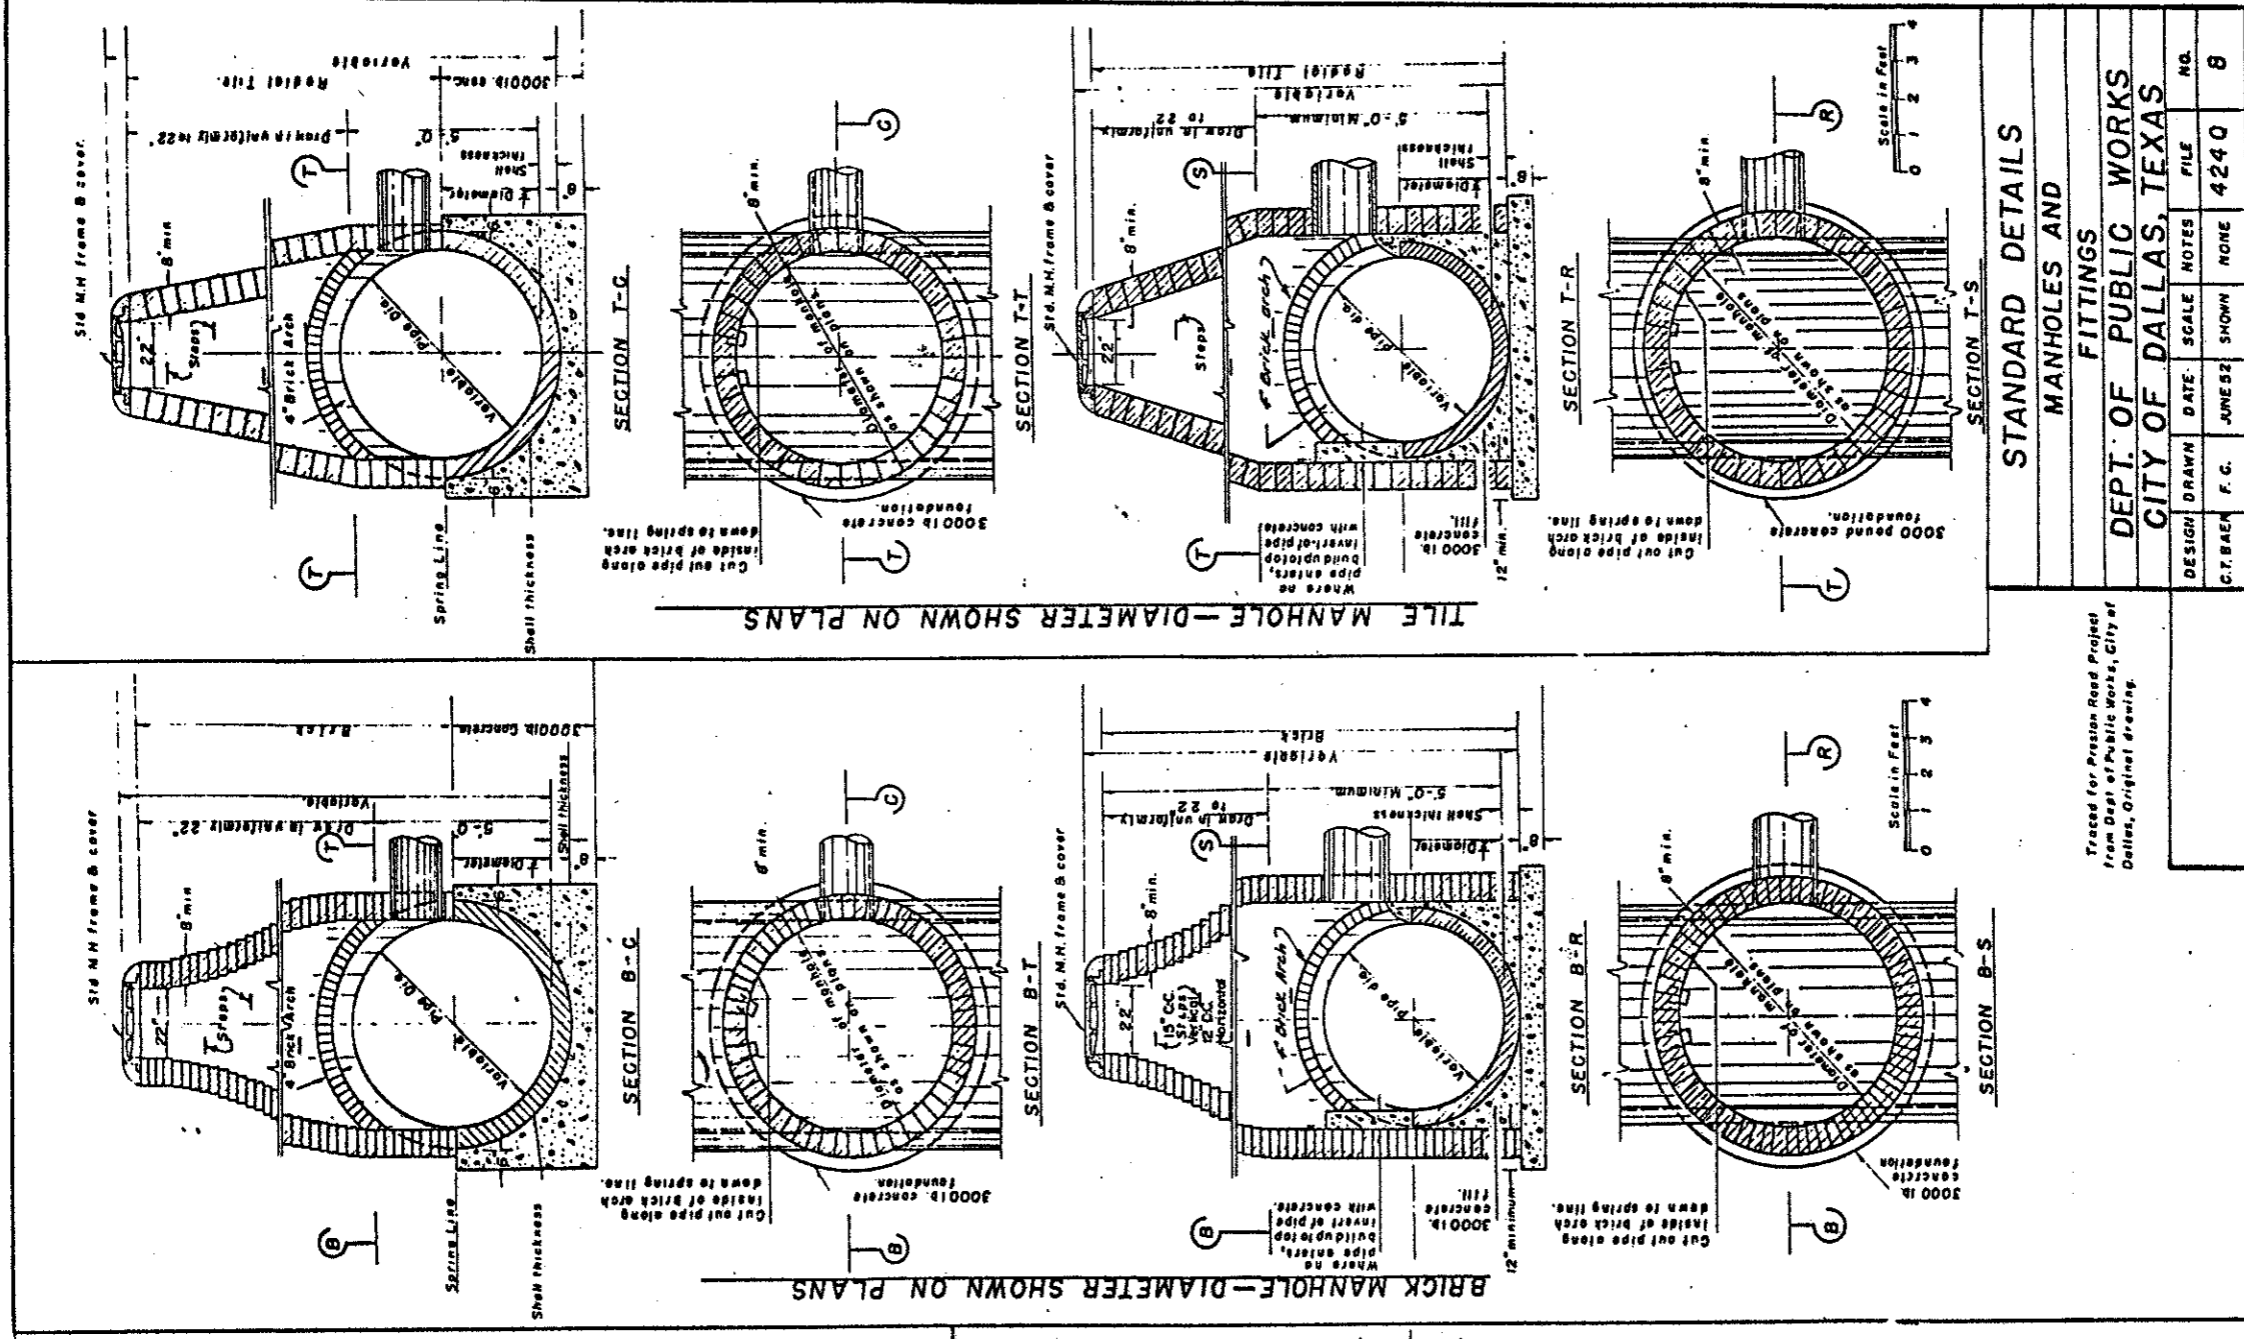

Traced for Preston Road Project
from Dept. of Public Works, City of
Dallas, Original drawing.

STANDARD DETAILS	
MANHOLES AND FITTINGS	
DEPT. OF PUBLIC WORKS	
CITY OF DALLAS, TEXAS	
DESIGN	FILE NO.
DRAWN	SCALE
DATE	NOTES
F. C.	SHOWN
JUNE 52	NONE
4240	8

NOTES APPLICABLE TO ALL MANHOLES:

- Concrete shall have a minimum compressive strength of 3000 lbs. per sq.in. at 28 days.
- Manholes shall be built on the main sewer line, lateral pipes may enter manholes at any location.
- Reinforcing, casting, brick and radial tile shall conform to the specifications.
- Diameter of concrete base shall not be less than inside dia. of manhole - 2 feet.
- Manholes will be measured & paid for at the contract unit price per each, regardless of depth of manhole.
- Manholes, except for horsehoe sewers, where designated as dia., means the inside dia. of the manhole, exclusive of draw in.