


- 1. STONE SIZE USE 3"-5" COURSE AGGREGRATE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.
- 2. LENGTH AS REQUIRED, BUT NOT LESS THAN 50 FEET.
- 3. THICKNESS NOT LESS THAN SIX (6) INCHES. 4. WIDTH - FIFTEEN (15) FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS.
- 5. FILTER CLOTH WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE. FILTER WILL NOT BE REQUIRED ON A SINGLE FAMILY RESIDENCE LOT.
- 6. SURFACE WATER ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE. IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
- 7. MAINTENANCE THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED, OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
- WASHING WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING.
- 9. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAINFALL OF 1/2 INCH OR GREATER.




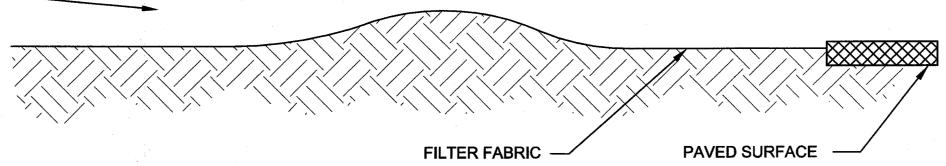

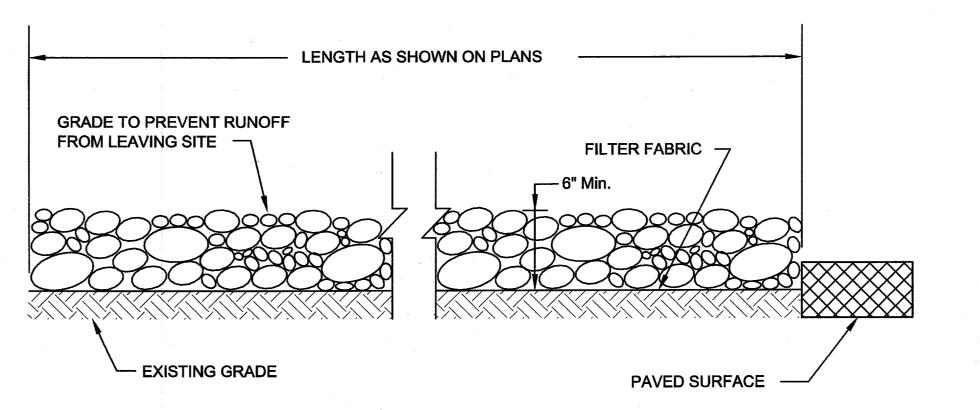


**PROFILE VIEW** 

## SECTION A-A

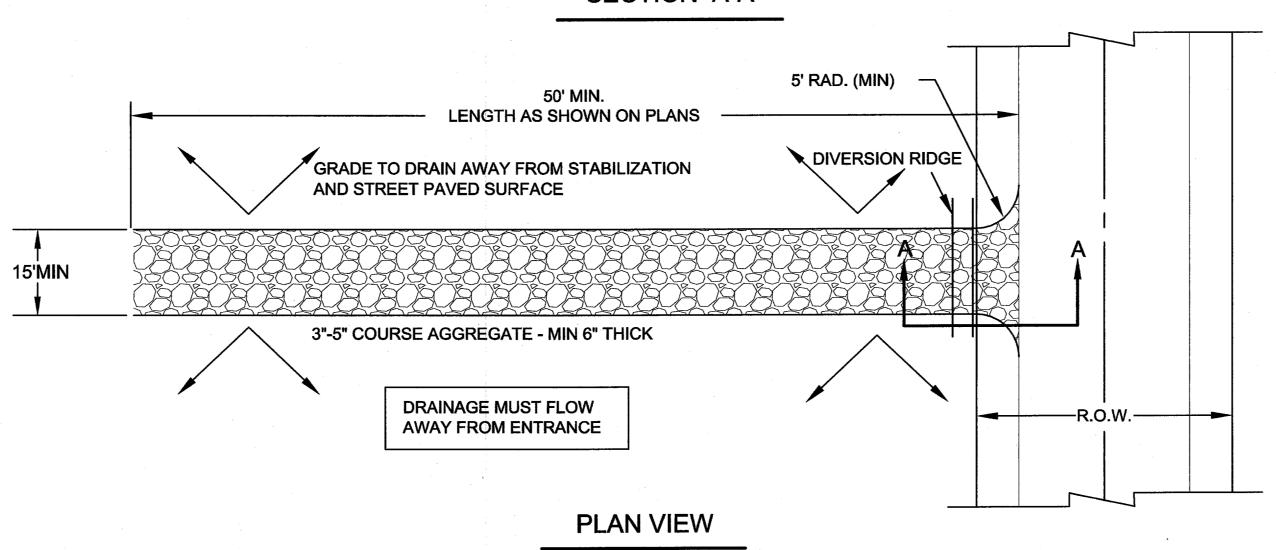

STABILIZED CONSTRUCTION ENTRANCE SCALE: N.T.S.

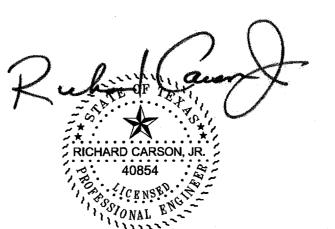

X	PIBURN& CARSON	Piburn & Carson, LLC 9535 Forest Ln Suite 229 Dallas, Texas 75243 Ph: (214) 328-3500 Fax: (214) 328-3512 www.piburncarson.com email@piburncarson.com Surveying Firm #100871-00 Engineering Firm #F-12324	
	ERO	SION CONTROL DETA	\I
		PARKING LOT	
		SITE DEVELOPMENT	
DA	TE PU	IBLIC WORKS DEPARTMEN	T
<u> </u>		OWN OF ADDICON TEVAC	

SCALE: 1" = 20'

REVISION TOWN OF ADDISON, TEXAS DESIGN DRAWN DATE SCALE NOTES FILE NO. 1/10/14 | 1"=20' PC RC