



BELT LINE/QUORUM SHOPPING CENTER  
4933 - 4945 BELT LINE ROAD  
ADDISON, TX 75254

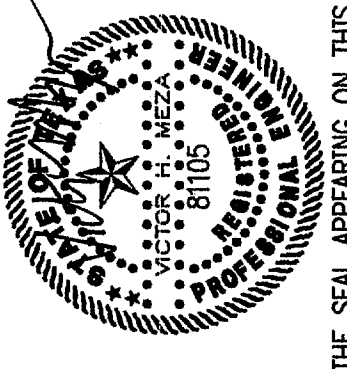

MEZA ENGINEERING, INC.  
Dallas, Texas 75246  
Phone: 214.452.7770  
Fax: 214.452.7744  
www.mezaengineering.com  
Project: 0080100  
THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY ME FOR THE STATE OF TEXAS ON JANUARY 23, 2004.

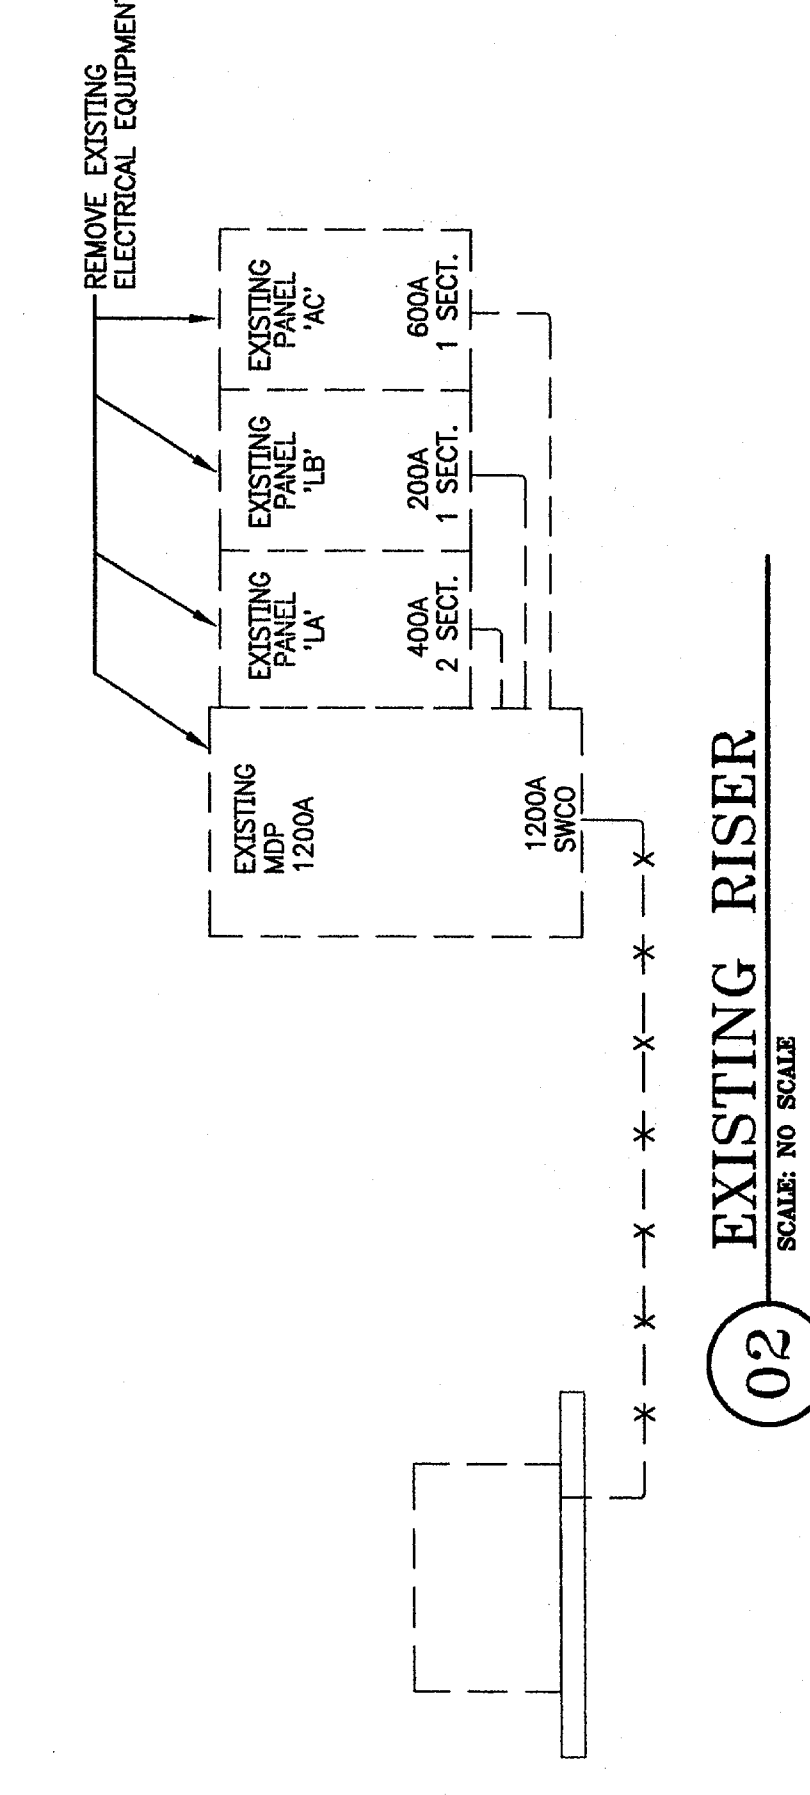

**NOTES BY SYMBOL**

- 1 RTU AND ASSOCIATED DUCTWORK TO BE REMOVED. MECHANICAL CONTRACTOR SHALL COORDINATE WITH ELECTRICAL CONTRACTOR REMOVAL OF ALL ASSOCIATED WIRING BACK TO PANEL. COORDINATE WITH BUILDING OWNER FOR DISPOSITION OF RTU AND ASSOCIATED EQUIPMENT.
- 2 EXHAUST FAN AND ASSOCIATED DUCTWORK TO BE REMOVED. MECHANICAL CONTRACTOR SHALL COORDINATE WITH ELECTRICAL CONTRACTOR REMOVAL OF ALL ASSOCIATED WIRING BACK TO PANEL. COORDINATE WITH BUILDING OWNER FOR DISPOSITION OF EXHAUST FAN AND ASSOCIATED EQUIPMENT.
- 3 REMOVE EXISTING DOMESTIC AND FIRE WATER SERVICE AS REQUIRED TO ACCOMMODATE THE NEW BUILDING. REFER TO MEP-2 FOR EXACT LOCATION OF SERVICES TO NEW BUILDING.
- 4 REMOVE EXISTING ELECTRIC SERVICE (1200A). EXTEND SITE LIGHTING CONDUITS TO NEW HOUSE PANEL.
- 5 EXISTING SITE LIGHT TO REMAIN. CONNECT TO NEW HOUSE PANEL.
- 6 REMOVE EXISTING SPRINKLER SYSTEM IN AREA SCHEDULED FOR DEMOLITION. SALVAGE EXISTING SYSTEM WHERE REQUIRED FOR FINAL BUILDING CONFIGURATION.
- 7 CAP EXISTING SANITARY SEWER AT TIE-IN TO BE ABANDONED AS REQUIRED TO ACCOMMODATE NEW CONSTRUCTION. REFER TO MEP-2.
- 8 ACCOMMODATE NEW CONSTRUCTION. REFER TO MEP-2.
- 9 ADDITION OF NEW ROOF DRAINAGE. REFER TO MEP-2 FOR CONTINUATION.

