CONSTRUCTION PLANS

FOR

THE CONTAINER STORE

AN ADDITION TO

THE TOWN OF ADDISON, TEXAS

Developer

BELTWAY DEVELOPMENT 15280 ADDISON RD, SUITE 300 ADDISON, TX 75001 (972) 661-1011 (tel) (972) 385-8039 (fax) ATTN: Mark Sommer

Engineer

Index Of Drawings

C4

Cover Sheet

Final Plat

Final Plat

Site Plan

Paving Plan


Grading Plan

Water/Samitary Sewer Plan

Brockette · Davis · Drake 4144 N. Central Expressway, Suite 1100 Dallas, Texas 75204


> (214) 824–3647 (214) 824-7064 (fax)

> > **ATTN: Jim Riley**

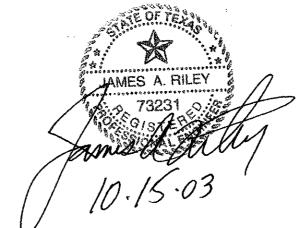

CONSTRUCTION SET

ISSUED BY TOWN OF ADDISON PUBLIC WORKS DEPARTMENT

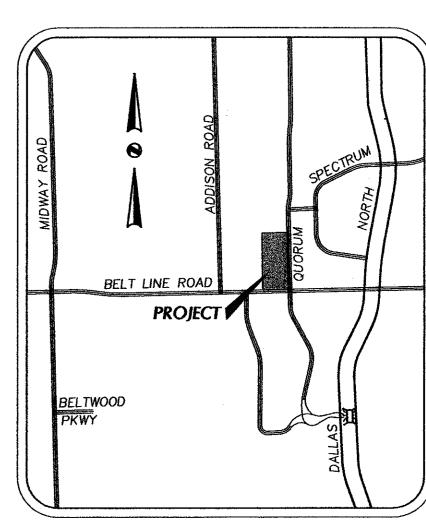

VICINITY MAP

GENERAL NOTES

- A Texas Registered Professional Engineer shall certify that the project was construct accordance with the plans and specifications approved by the Iown of Addison. The Owner shall provide one reproducible set of as—built (sealed and certified by a Registered Engineer) and two blue lines sets.

 A five foot (5) sidewalk shall be installed along the public streets. See attached A one year 10% maintenance bond is required for the public infrastructure. Contractor shall demonstrate that the water and sanitary sentence meet the provide a language of managery tests.
- Prior to starting construction, the Contractor shall contact the utility companies to locate existing facilities. These include but may not be limited to the following:

- Any existing pavement, curbs, and/or sidewalks damaged or removed will be repaired by the Contractor at their expense, and in accordance with Town of Addison std. specifications.
- shall be installed after construction and prior to find acceptance. Concrete monuments shall be placed as shown on the final plat and iron pins shall be placed at block corners, curve points and angle points in public right—of—way. Concrete monuments shall be six inches (6") in diameter and twenty—four inches (24") long. an iron rod one—half inch (1/2") in diameter embedded at least three inches (3") in the monument at the exact intersection point of the monument. The monuments shall be set at such an elevation that after construction, the top of the monument will be not less than twelve inches (12") below the ground surface.

- During construction, the Owner shall provide a qualified geotechnical lab at owner's perform materials testing during the construction at the request of the Town of

- All existing and proposed improvements (valves, manholes, fire hydrants, water meters, etc. shall be adjusted to finished grade by the Contractor.