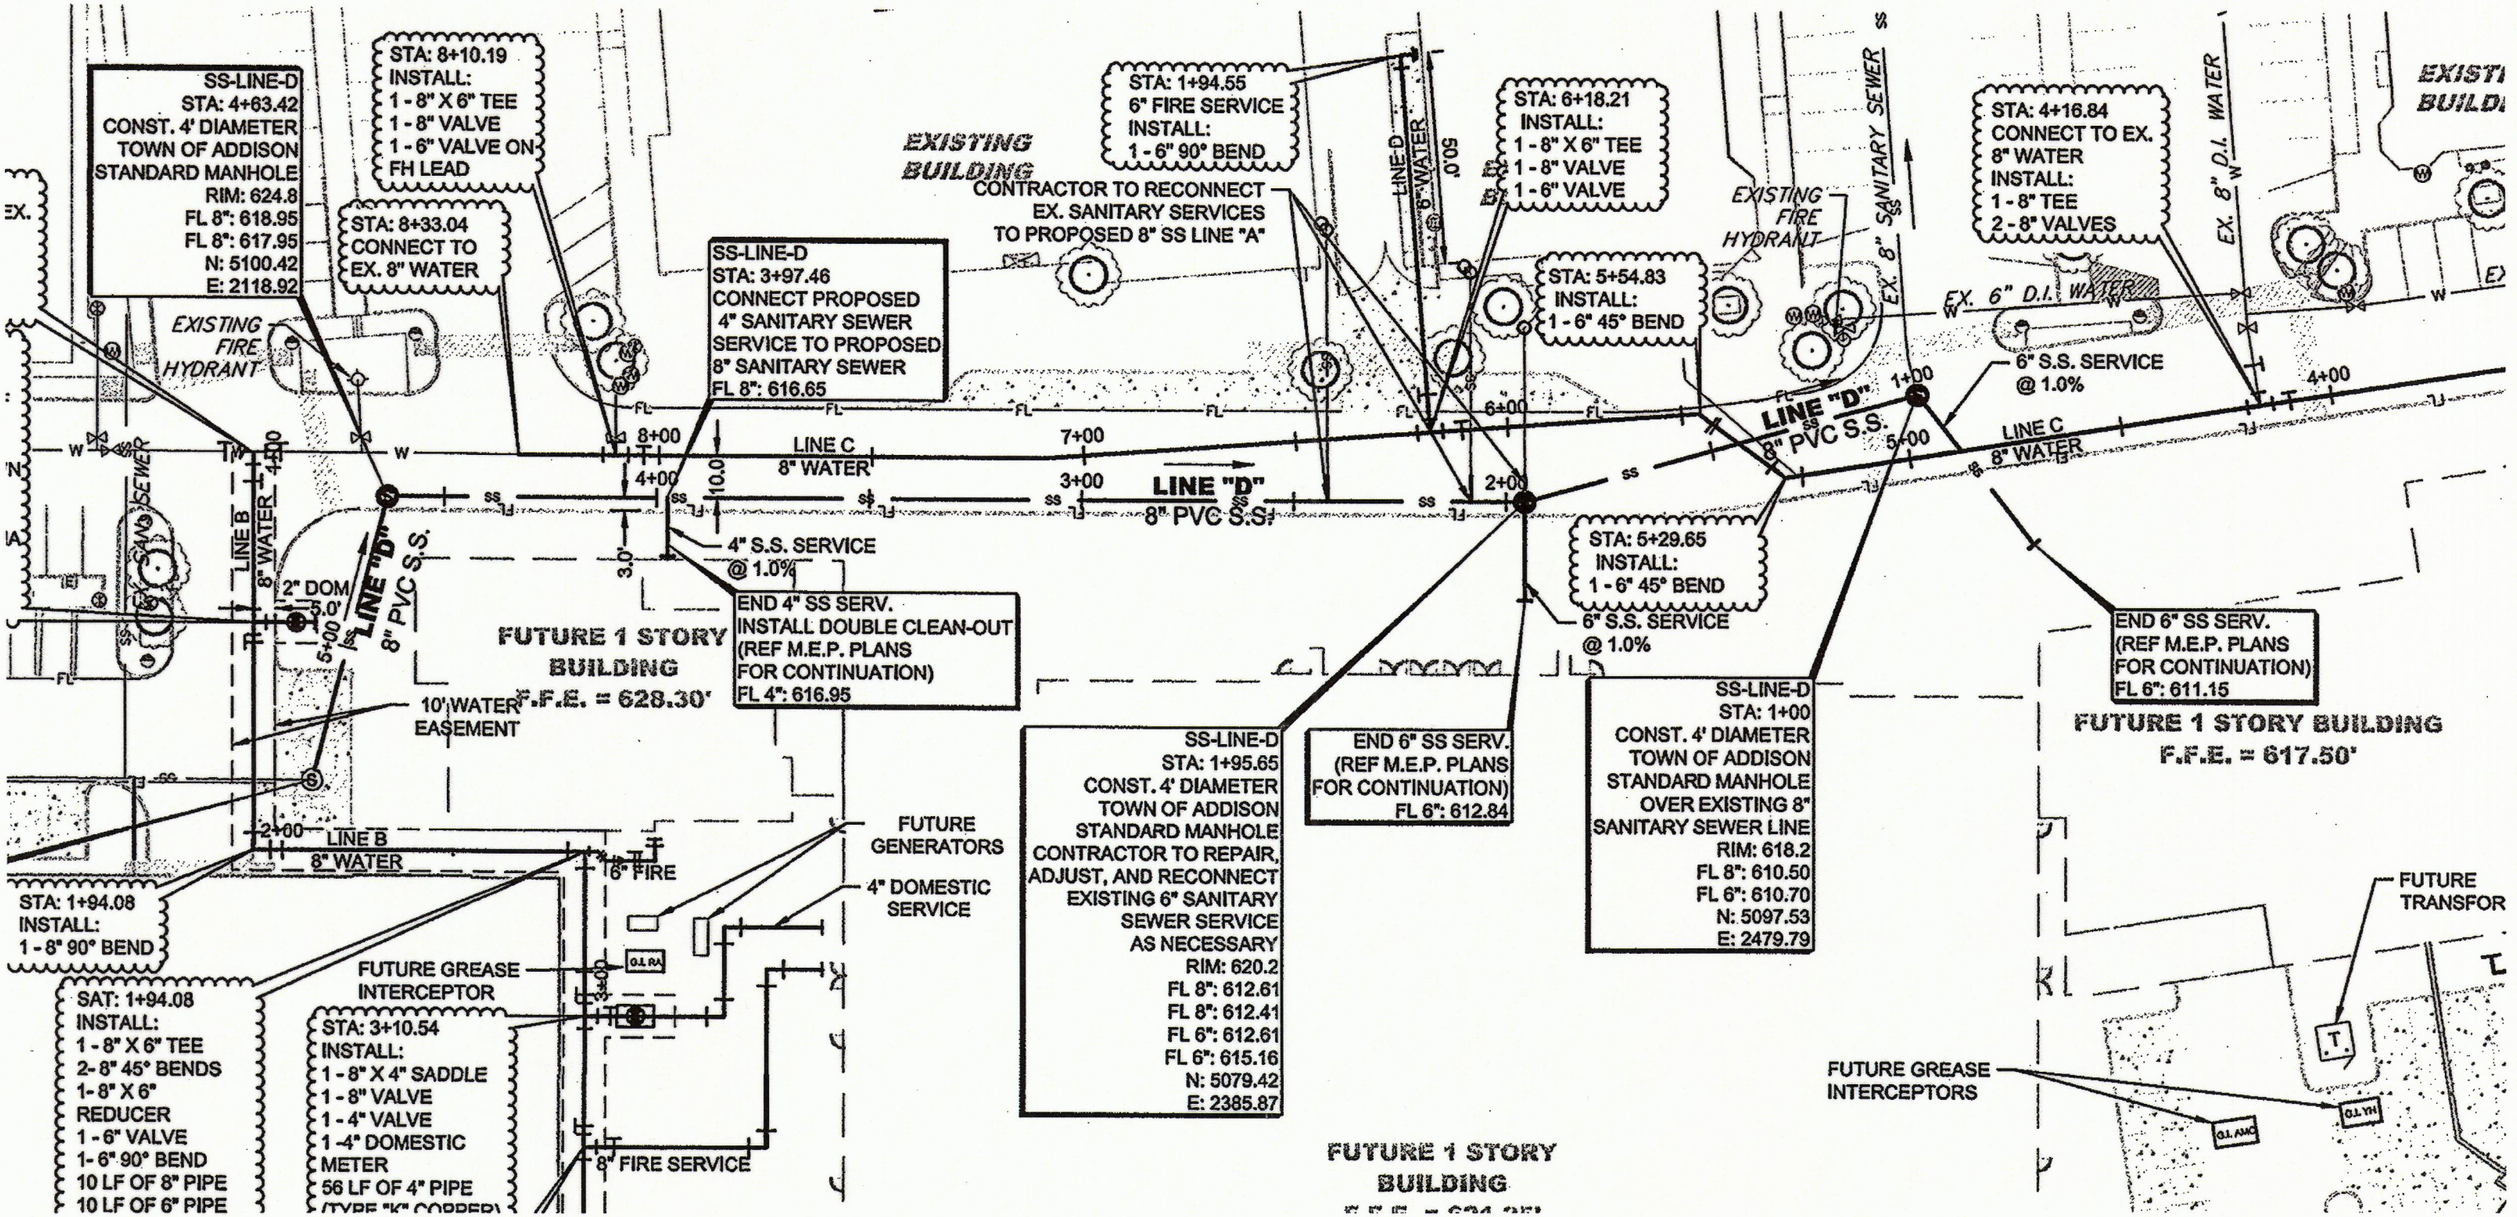
SS-LINE-D
STA: 4+63.42
CONST. 4' DIAMETER
TOWN OF ADDISON
STANDARD MANHOLE
RIM: 624.8
FL 8": 618.95
FL 8": 617.95
N: 5100.42
E: 2118.92
STA: 8+10.19
INSTALL:
1 - 8" X 6" TEE
1 - 8" VALVE
1 - 6" VALVE ON
FH LEAD
STA: 8+33.04
CONNECT TO
EX. 8" WATER
EXISTING
FIRE
HYDRANT
SS-LINE-D
STA: 3+97.46
CONNECT PROPOSED
4" SANITARY SEWER
SERVICE TO PROPOSED
8" SANITARY SEWER
FL 8": 616.65
EXISTING
BUILDING
CONTRACTOR TO RECONNECT
EX. SANITARY SERVICES
TO PROPOSED 8" SS LINE "A"
STA: 1+94.55
6" FIRE SERVICE
INSTALL:
1 - 6" 90° BEND
LINE D
8" WATER
50.0'
STA: 6+18.21
INSTALL:
1 - 8" X 6" TEE
1 - 8" VALVE
1 - 6" VALVE
STA: 5+54.83
INSTALL:
1 - 6" 45° BEND
EXISTING
FIRE
HYDRANT
EX. 8" SANITARY SEWER
EX. 6" D.I. WATER
STA: 4+16.84
CONNECT TO EX.
8" WATER
INSTALL:
1 - 8" TEE
2 - 8" VALVES
EX. 8" D.I. WATER
6" S.S. SERVICE
@ 1.0%
LINE "D"
8" PVC S.S.
LINE C
8" WATER
8+00
7+00
6+00
5+00
4+00
3+00
2+00
1+00
10.0'
4" S.S. SERVICE
@ 1.0%
3.0'
END 4" SS SERV.
INSTALL DOUBLE CLEAN-OUT
(REF M.E.P. PLANS
FOR CONTINUATION)
FL 4": 616.95
FUTURE 1 STORY
BUILDING
F.F.E. = 628.30'
STA: 5+29.65
INSTALL:
1 - 6" 45° BEND
6" S.S. SERVICE
@ 1.0%
END 6" SS SERV.
(REF M.E.P. PLANS
FOR CONTINUATION)
FL 6": 611.15
FUTURE 1 STORY BUILDING
F.F.E. = 617.50'
SS-LINE-D
STA: 1+00
CONST. 4' DIAMETER
TOWN OF ADDISON
STANDARD MANHOLE
OVER EXISTING 8"
SANITARY SEWER LINE
RIM: 618.2
FL 8": 610.50
FL 6": 610.70
N: 5097.53
E: 2479.79
SS-LINE-D
STA: 1+95.65
CONST. 4' DIAMETER
TOWN OF ADDISON
STANDARD MANHOLE
CONTRACTOR TO REPAIR,
ADJUST, AND RECONNECT
EXISTING 6" SANITARY
SEWER SERVICE
AS NECESSARY
RIM: 620.2
FL 8": 612.61
FL 8": 612.41
FL 6": 612.61
FL 6": 615.16
N: 5079.42
E: 2385.87
END 6" SS SERV.
(REF M.E.P. PLANS
FOR CONTINUATION)
FL 6": 612.84
FUTURE 1 STORY
BUILDING
LINE B
8" WATER
2" DOM
5.0'
10' WATER
EASEMENT
FUTURE
GENERATORS
4" DOMESTIC
SERVICE
6" FIRE
8" FIRE SERVICE
FUTURE GREASE
INTERCEPTOR
STA: 1+94.08
INSTALL:
1 - 8" 90° BEND
SAT: 1+94.08
INSTALL:
1 - 8" X 6" TEE
2 - 8" 45° BENDS
1 - 8" X 6"
REDUCER
1 - 6" VALVE
1 - 6" 90° BEND
10 LF OF 8" PIPE
10 LF OF 6" PIPE
STA: 3+10.54
INSTALL:
1 - 8" X 4" SADDLE
1 - 8" VALVE
1 - 4" VALVE
1 -4" DOMESTIC
METER
56 LF OF 4" PIPE
FUTURE
TRANSFOR
FUTURE GREASE
INTERCEPTORS
G.I. AMC
G.I. YH