
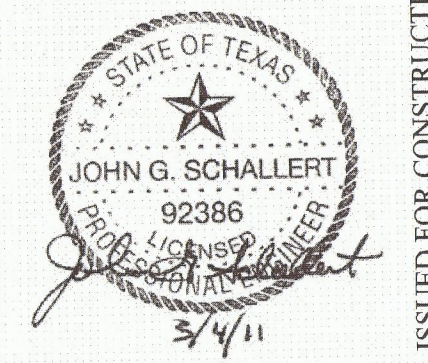


- LIGHTING LEGEND**
- ○ FUTURE LIGHT POLE
  - ● PROPOSED SINGLE LUMINAIRE ON CURVED 55' RADIUS POLE
  - ● ● PROPOSED TWIN LUMINAIRE ON CURVED 40' RADIUS POLE
  - ⊗ EXISTING LIGHT POLE TO BE REMOVED
  - TRENCHED CONDUIT
  - ▭ BORED CONDUIT
  - PROPOSED GROUND BOX
  - ⬡ PROPOSED LIGHTING CONTROLLER


**NOTES**

- CONDUIT SHALL BE INSTALLED 18 INCHES FROM EDGE OF CURB TO AVOID INTERFERING WITH LANDSCAPE FEATURES. ADDITIONALLY, THE CONTRACTOR SHALL FIELD ADJUST CONDUIT TO MINIMIZE DAMAGE TO ROOTS OF TREES THAT ARE TO REMAIN.
- ALL DIMENSIONS ARE TAKEN FROM THE CENTER OF THE POLE BASE.

- A 1 - 1**
- POLE NUMBER
  - CIRCUIT NUMBER
  - CONTROLLER
- (A) 2" C, 2#4, 1#4 BARE GND
  - (B) 2" C, 4#4, 1#4 BARE GND
  - (C) 2-2" C, 8#4, 1#4 BARE GND

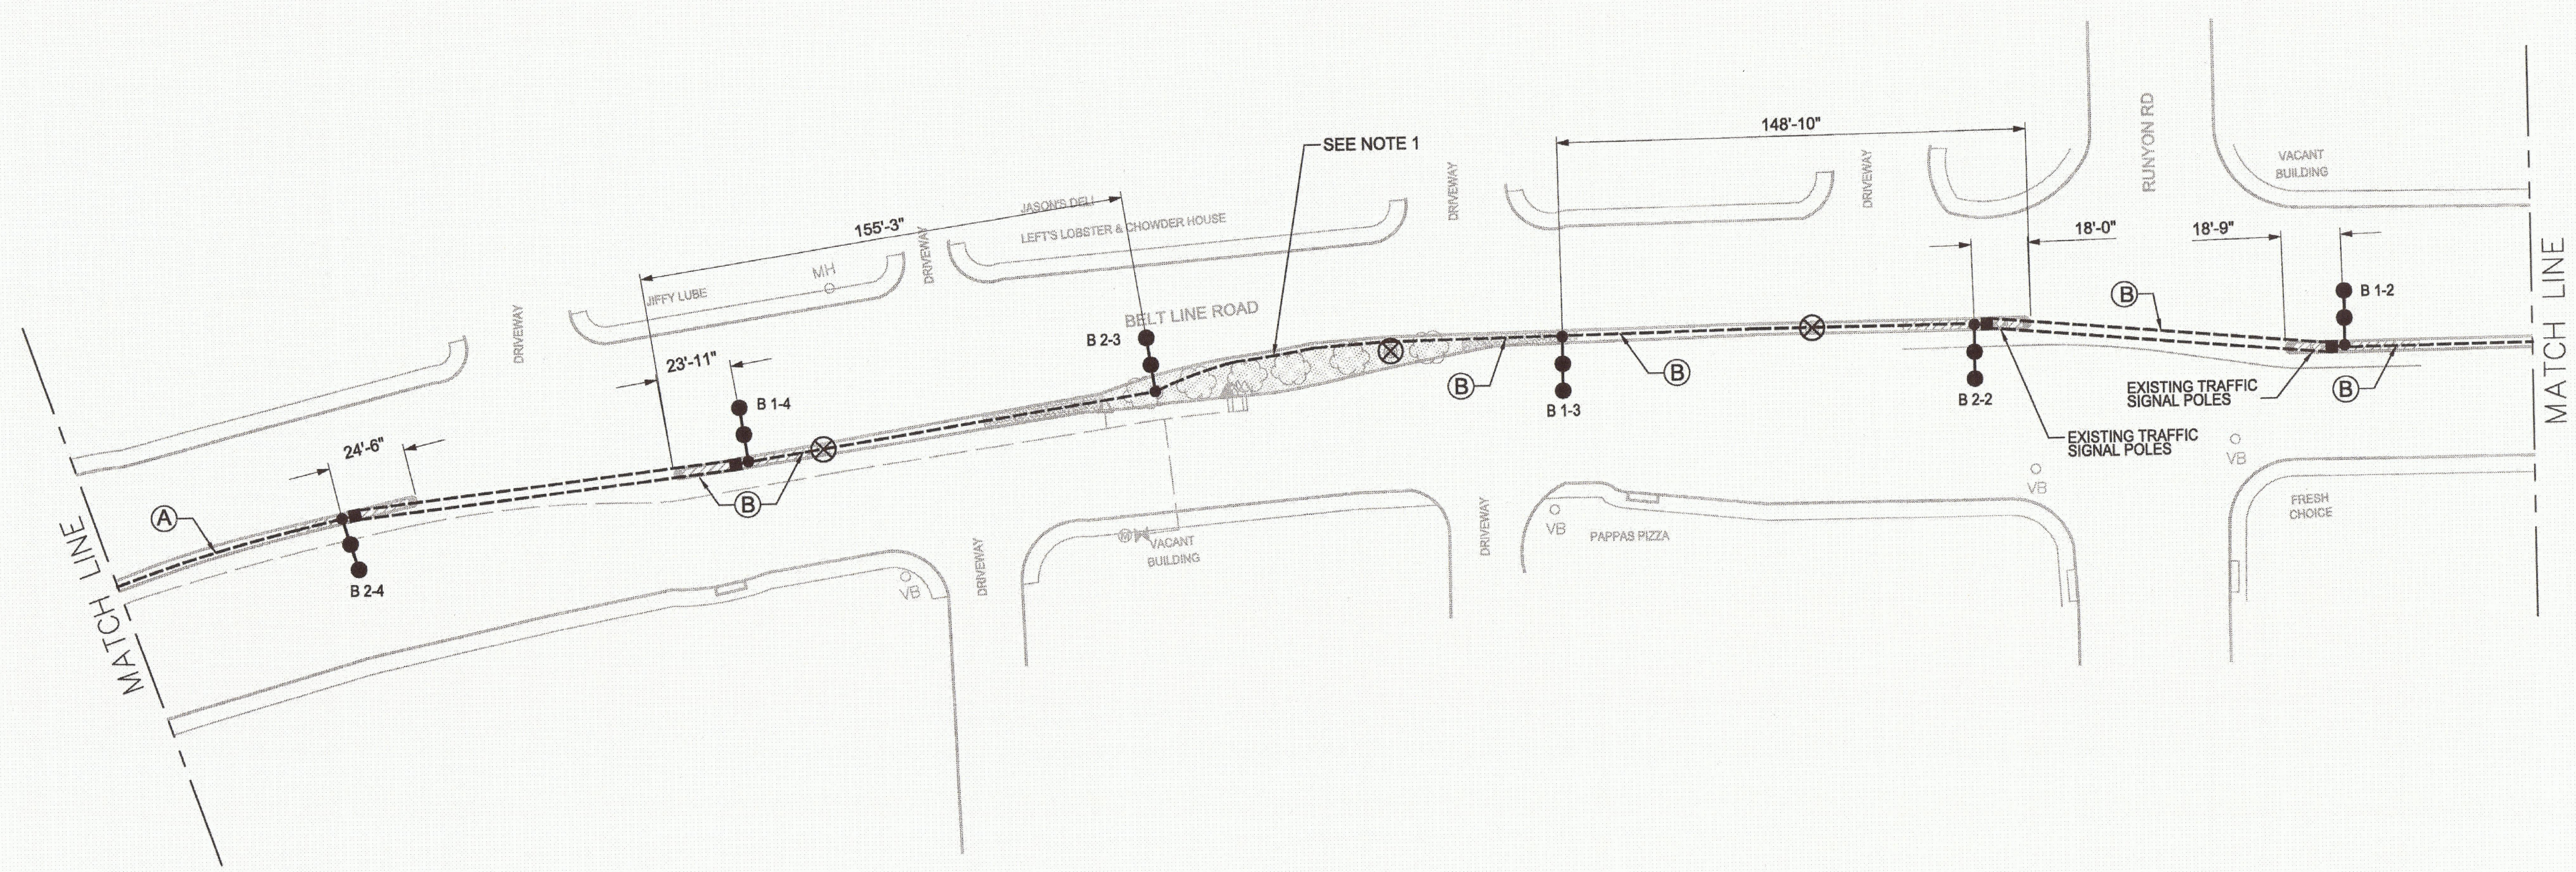

ISSUED FOR CONSTRUCTION - 6/11

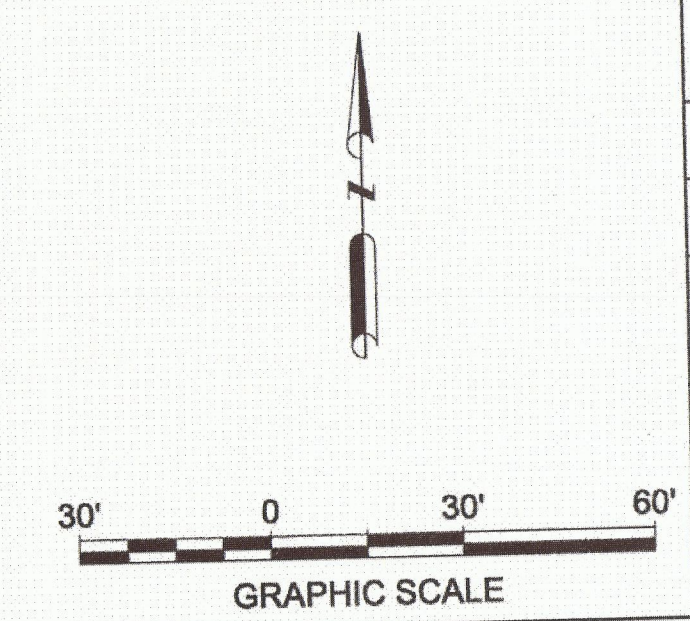

NO.	DATE	REVISION	APPROV.

**HNTB** ARCHITECTS ENGINEERS PLANNERS  
 The HNTB Companies - TBE Firm No. 420  
 2001 BRYAN STREET, SUITE 100  
 DALLAS, TEXAS 75201 (214) 748-8400

**BELT LINE ROAD MEDIAN**  
 MARSH LANE TO DALLAS N. TOLLWAY

ROADWAY LIGHTING PLAN

TOWN OF ADDISON, TEXAS

DESIGN	DRAWN	FH	DATE	SCALE	HNTB NO.	SHEET NO.	
CHECK	JS	CHECK	TK	30-Dec-10	1"=30'	48564	6

SHEET 5 OF 19