



City of Carrollton
City of Addison

ESTIMATED QUANTITIES		UNIT	QUANTITY
3	8" P.V.C. WATER LINE	L.F.	1960
6	FIRE HYDRANTS	EA.	4
5	8" VALVES	EA.	3
11	2" SERVICE LINE	L.F.	100
7	TIE IN EXIST. WATER LINE	EA.	2

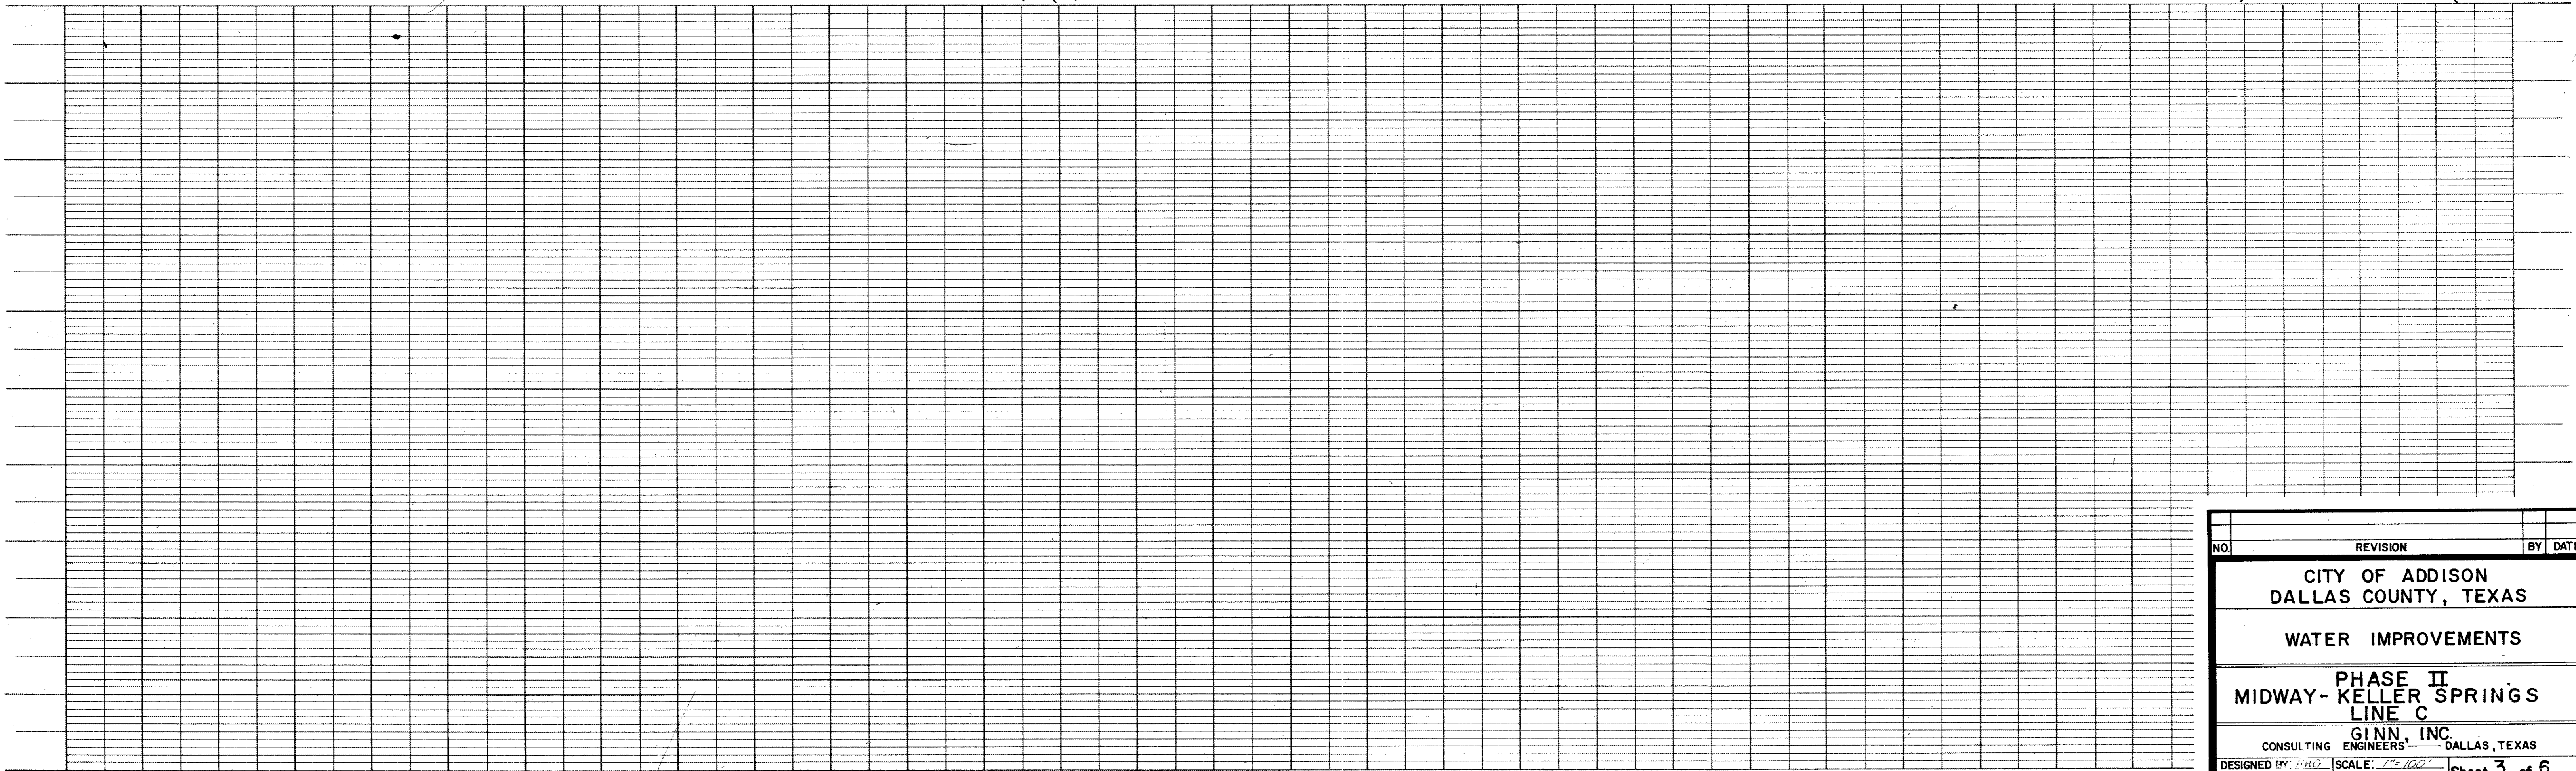

NO.	REVISION	BY	DATE
CITY OF ADDISON DALLAS COUNTY, TEXAS			
WATER IMPROVEMENTS			
PHASE II MIDWAY-KELLER SPRINGS LINE C			
GINN, INC. CONSULTING ENGINEERS' DALLAS, TEXAS			
DESIGNED BY: [Signature]	SCALE: 1"=100'	Sheet 3 of 6	
DRAWN BY: [Signature]	DATE: 1979		

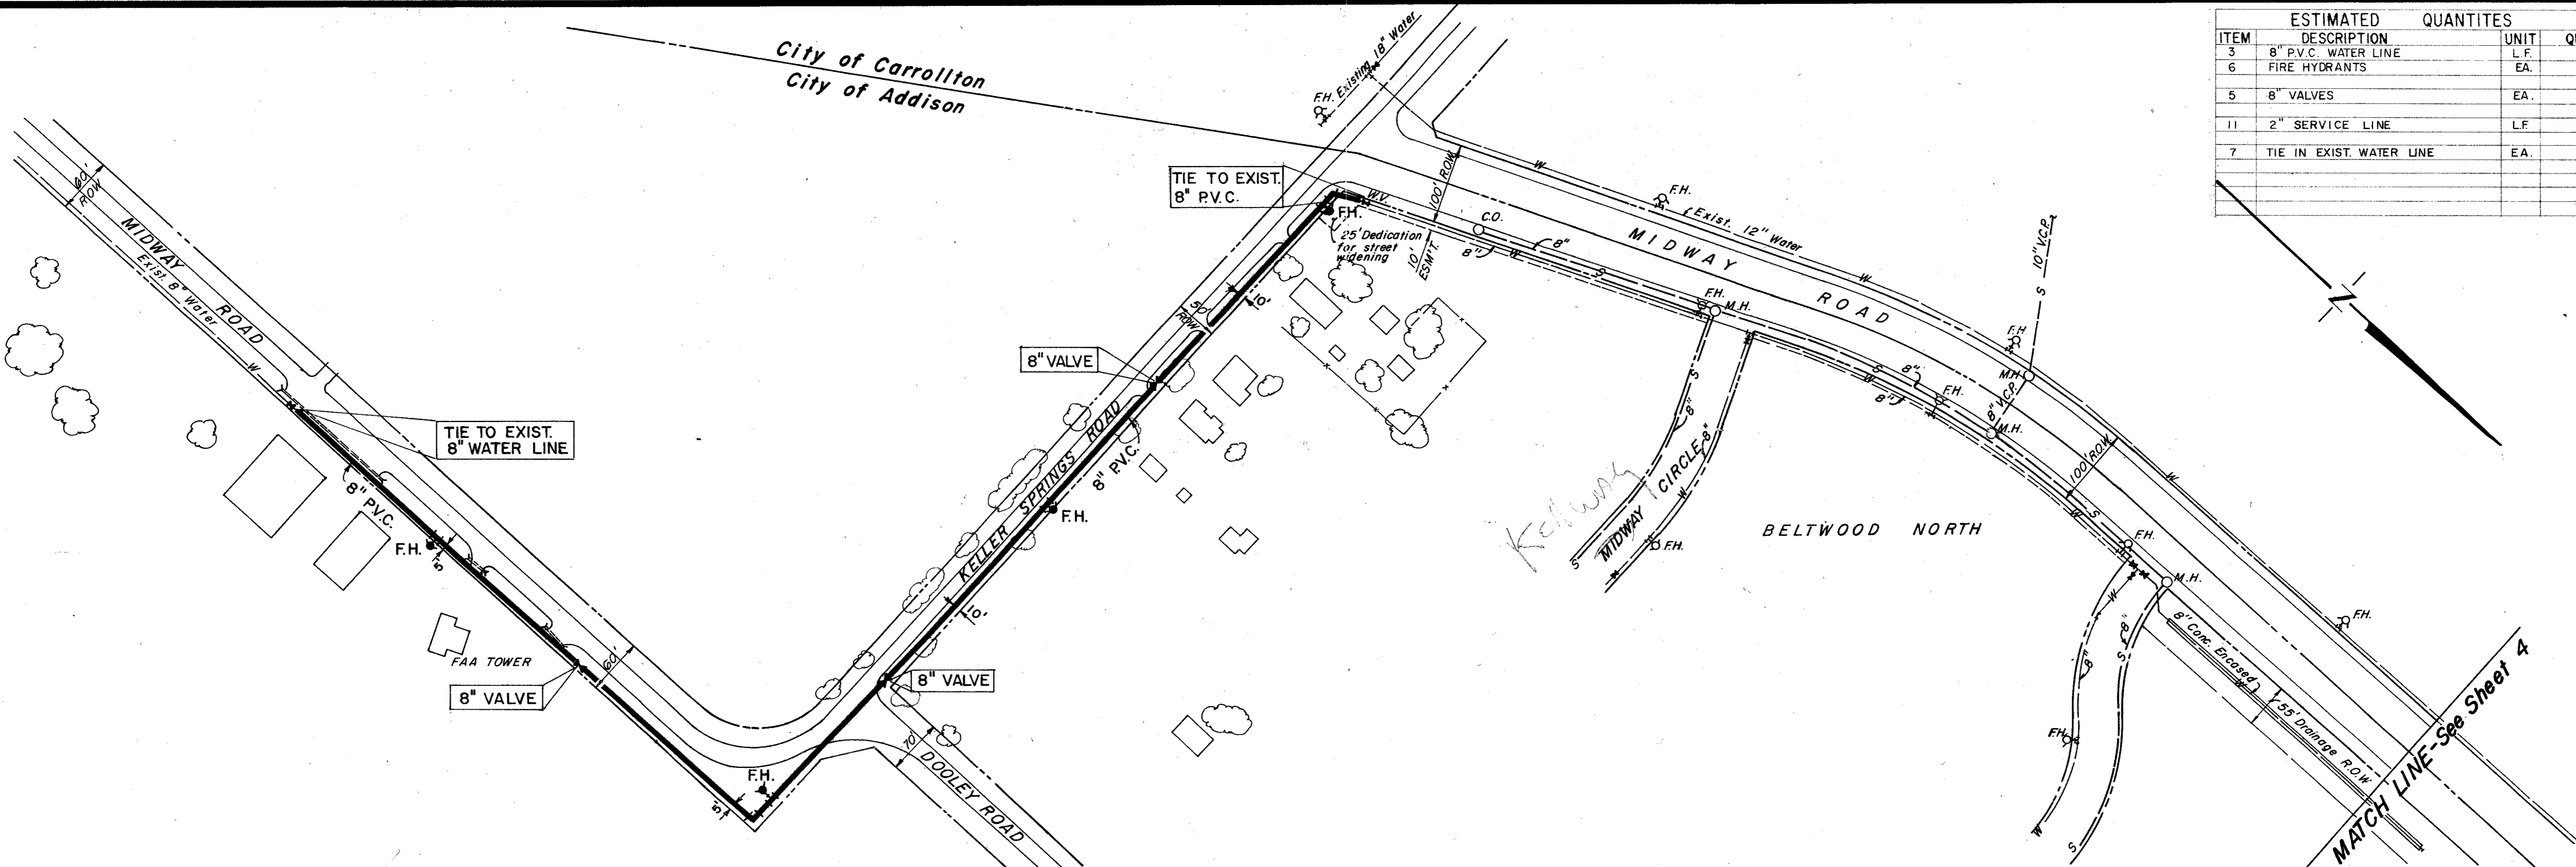