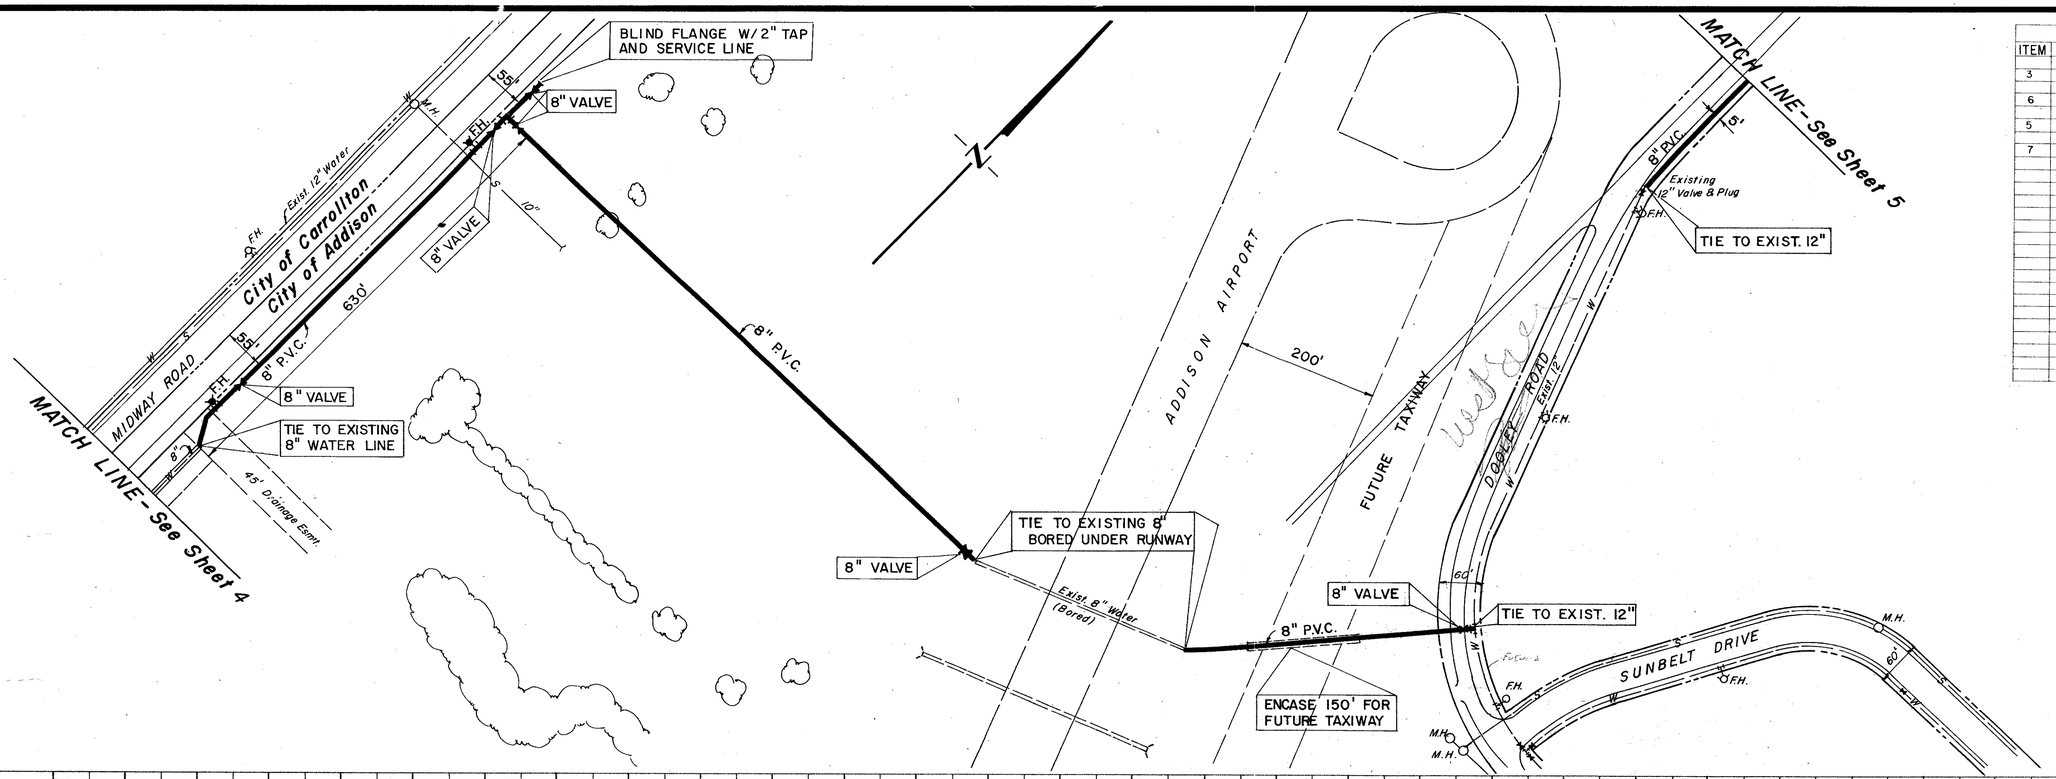

ESTIMATED QUANTITES			
ITEM	DESCRIPTION	UNIT	QUANTITY
3	8" PVC WATER MAIN	L.F.	2440
6	FIRE HYDRANTS	EA.	2
5	8" VALVES	EA.	6
7	TIE-IN TO EXIST. WATER LINE	EA.	5

NO.	REVISION	BY	DATE

CITY OF ADDISON
DALLAS COUNTY, TEXAS

WATER IMPROVEMENTS

PHASE II
MIDWAY WATER LINE
LINE D

GINN, INC.
CONSULTING ENGINEERS — DALLAS, TEXAS

DESIGNED BY: SCALE:
DRAWN BY: DATE:

Sheet 4 of 6