General Notes:

1. All RCP Shall Class III Unless Otherwise Noted.
2. Concrete Cushion Shall be Provided Where Rock is Encountered.
3. The Location of all Utilities Indicated on The Plans are Taken from existing Public records. The exact location & elevation of all public utilities must be determined by the Contractor. It Shall be the duty of the Contractor to ascertain whether any additional facilities other than those shown on plans may be present.

PLAN	REVISED	BY	DATE
NOTE BOOK	REVISED		
No.	ALIGNMENT CHECKED		
	P.I. OF WAY CHECKED		

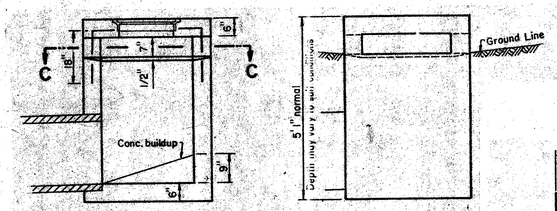

Sect."A-A"

Sect."B-B"



Plan



Sect."C-C"

TYPE "Y" INLET

Scale: 1/2" = 1'0"

All reinforcement steel shall be No. 5 bars.
Concrete shall have a minimum compressive strength of 3000psi at 28days.

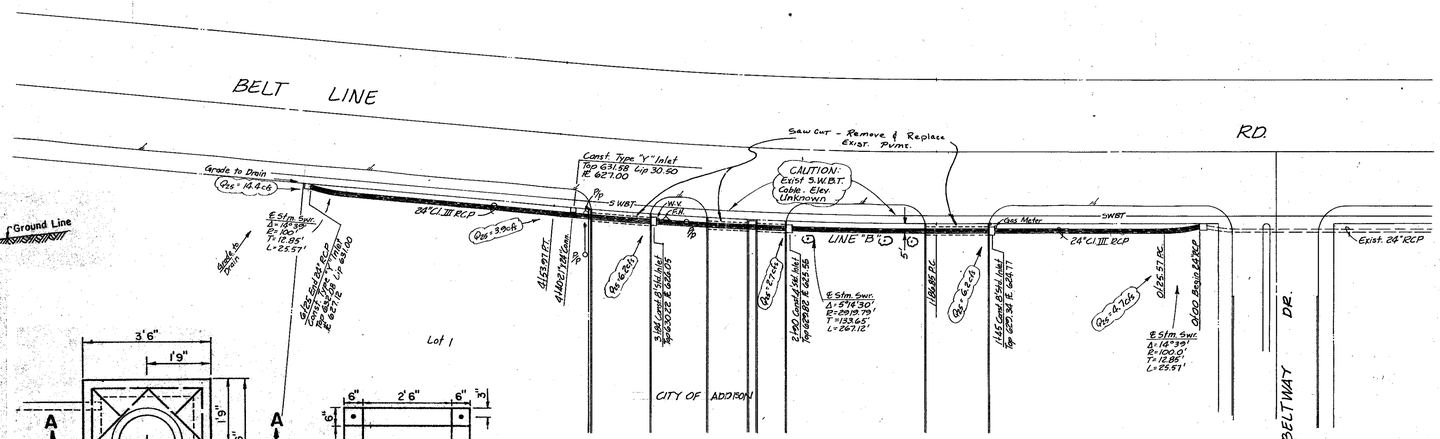

Note:
Pull Sta. Swr. Around P/p And F.H., Exist. Trees

Bench Mark
Top Oper. Nut of F.H. North Side, Belt Line Road 1000'± West Inwood Rd.
Elev. 631.53

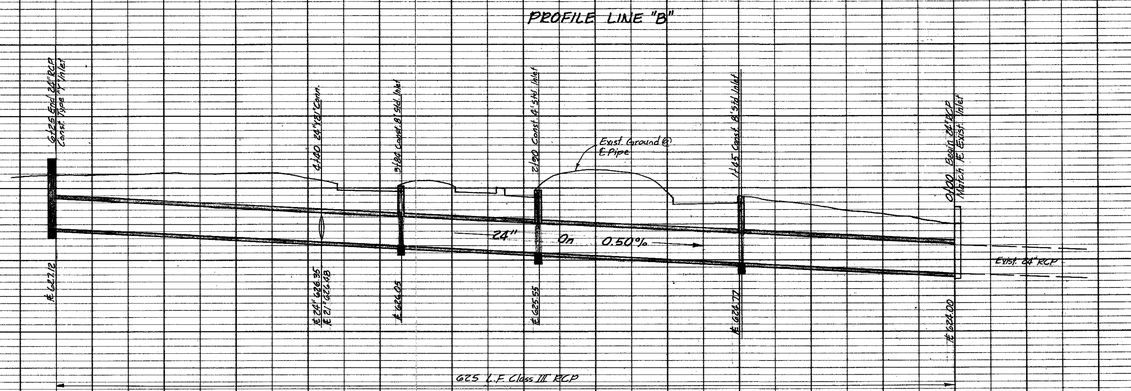

STORM SEWER PLAN & PROFILE					
BELTWAY DRIVE					
CITY OF ADDISON, TEXAS					
RAYMOND L. GOODSON JR. INC., ENGINEERS					
DESIGN	DRAWN	DATE	SCALE	NOTES	FILE NO.
R.L.G.	INC.	MARCH 1977	1" = 50'	R.L.G. INC.	

K&E PLATE 1, PLAN-PROFILE
KEUFFEL & ESSER CO.

15,752-5 5W/10