

REMOVE & REPLACE VALVE 4M4A

PEBBLE BEACH

CITY OF FARMERS BRANCH

APT. BLDG. 14500
SIDNEY

APT. BLDG. 14500
SHADOWWOOD APT.

APT. BLDG. 14500
4M4

BRILLIANCE PRESCHOOL
14450

BROOKHAVEN PET CLINIC
14412
BROOKHAVEN DRY CLEANERS
14404


7ELEVEN
14400
SPRING VALLEY

NOTES

1. The Town of Addison shall shut down existing waterlines during off-peak hours.
2. Excavate and remove existing gate valves, including pavement removal.
3. Install new gate valve, including valve stack furnished to the site by the Town of Addison.
4. Restore area with solid sod.
5. Place 10-Inch reinforced concrete pavement and curb. NCTCOG Item 745, Class "C" concrete; 3600 psi compressive strength @ 28-days, minimum 6-sack mix per cubic yard. Maximum water cement ratio 6.0.
6. Backfill shall be select material (NCTCOG Item 2.1.8(c) compacted in place.
7. Embedment shall be NCTCOG Grade 4 aggregate to spring line of pipe.

FURNISH & INSTALL
 4" OR 6" x 1" TAP
 5 L.F. - 1" TYPE K COPPER WATERLINE
 1-1" CURB STOP - 6" BELOW SURFACE
 1-1" CORP STOP W/COMP NUT
 1-CONC. METER BOX & COVER (10" x 20")

SCALE 1"=100'

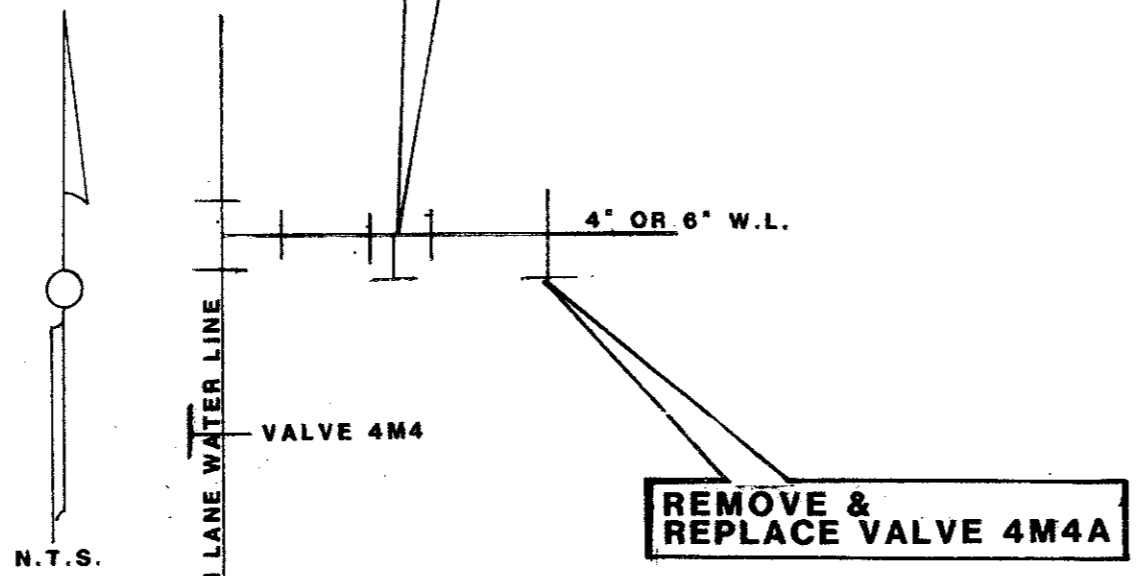

REMOVE & REPLACE VALVE 4M4A

LEGEND

- 16" Water Line (Size indicated)
- Fire Hydrant W/Valve
- Fire Hydrant No Valve
- Meter Station
- Valve
- Reducer

WATER

TOWN OF
ADDISON

Rev

SHEET 5

3	8
4	9
5	10

SHEET INDEX