


BENCH MARK # 1
 " " on T.C. 60' east of Addison Road
 north side of Westgrove.
 ELEVATION: 641.96

BENCH MARK # 2
 " " on T.C. 100'± north of Sir Lancelot
 Drive, west side of Addison Road
 ELEVATION: 642.49

A minimum depth of 6 inches of
 Lime Stabilized Subgrade Required When
 P.I. is Greater Than 10. Otherwise Compact
 Subgrade to 95% Standard Proctor. Lime
 Stabilized Subgrade will be required
 On Any Fill Sections.

Typical Section

The contractor is responsible to preserve the final alignment and
 grade stakes as set by the engineer until the completed pavement
 is accepted by the City. In the event stakes are lost, the en-
 gineer accepts no responsibility for pavement alignment or grade.

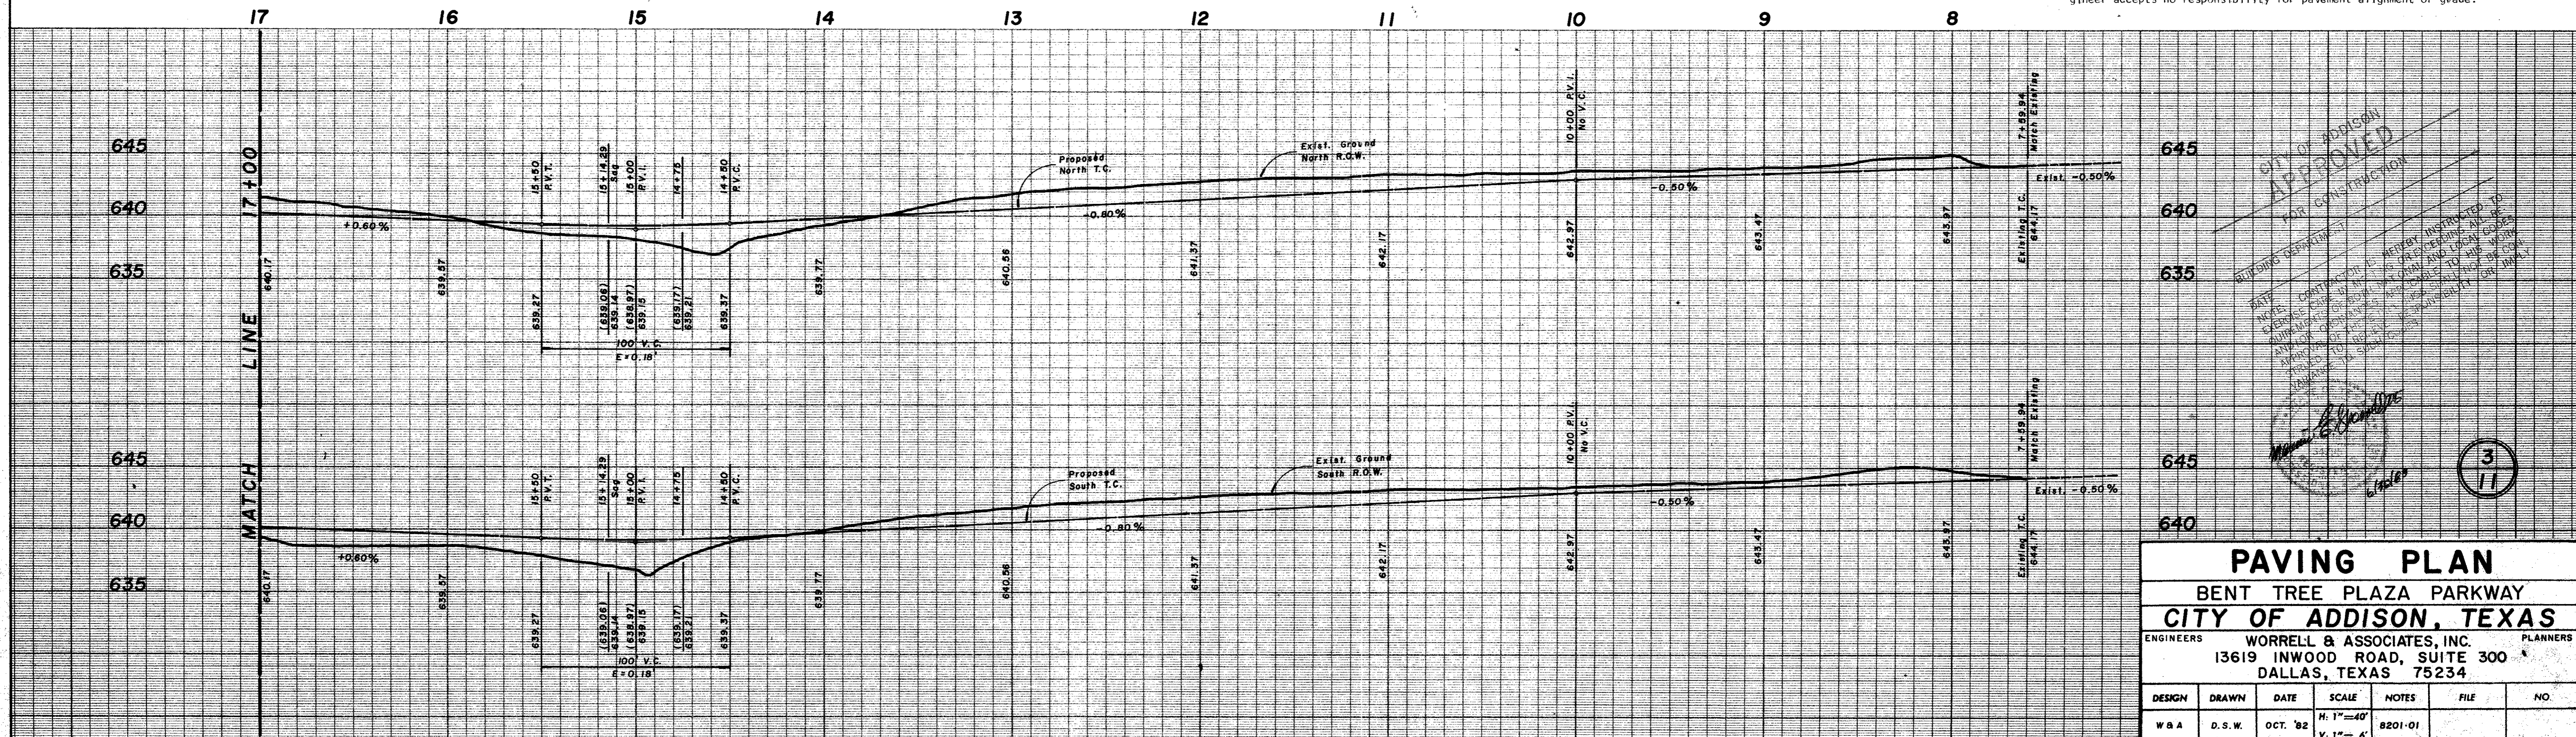

CITY OF ADDISON
 APPROVED
 FOR CONSTRUCTION

BUREAU OF PUBLIC WORKS

DATE: _____ CONTRACTOR: _____

EXEMPT FROM THE PROVISIONS OF THE
 ADDISON CONSTRUCTION CODE IN THE
 APPROVAL OF THE CITY ENGINEER AND LOCAL GOVERN-
 MENT OFFICIALS. THE CITY ENGINEER AND LOCAL GOVERN-
 MENT OFFICIALS ARE NOT RESPONSIBLE FOR THE WORK
 UNDERTAKEN BY THE CONTRACTOR.

6/12/82

PAVING PLAN						
BENT TREE PLAZA PARKWAY						
CITY OF ADDISON, TEXAS						
ENGINEERS	WORRELL & ASSOCIATES, INC.				PLANNERS	
13619 INWOOD ROAD, SUITE 300						
DALLAS, TEXAS 75234						
DESIGN	DRAWN	DATE	SCALE	NOTES	FILE	NO.
W & A	D.S.W.	OCT. '82	H: 1"=40' V: 1"= 6'	B201-01		

3
11