



SECTION A-A
3/4" = 1'-0"

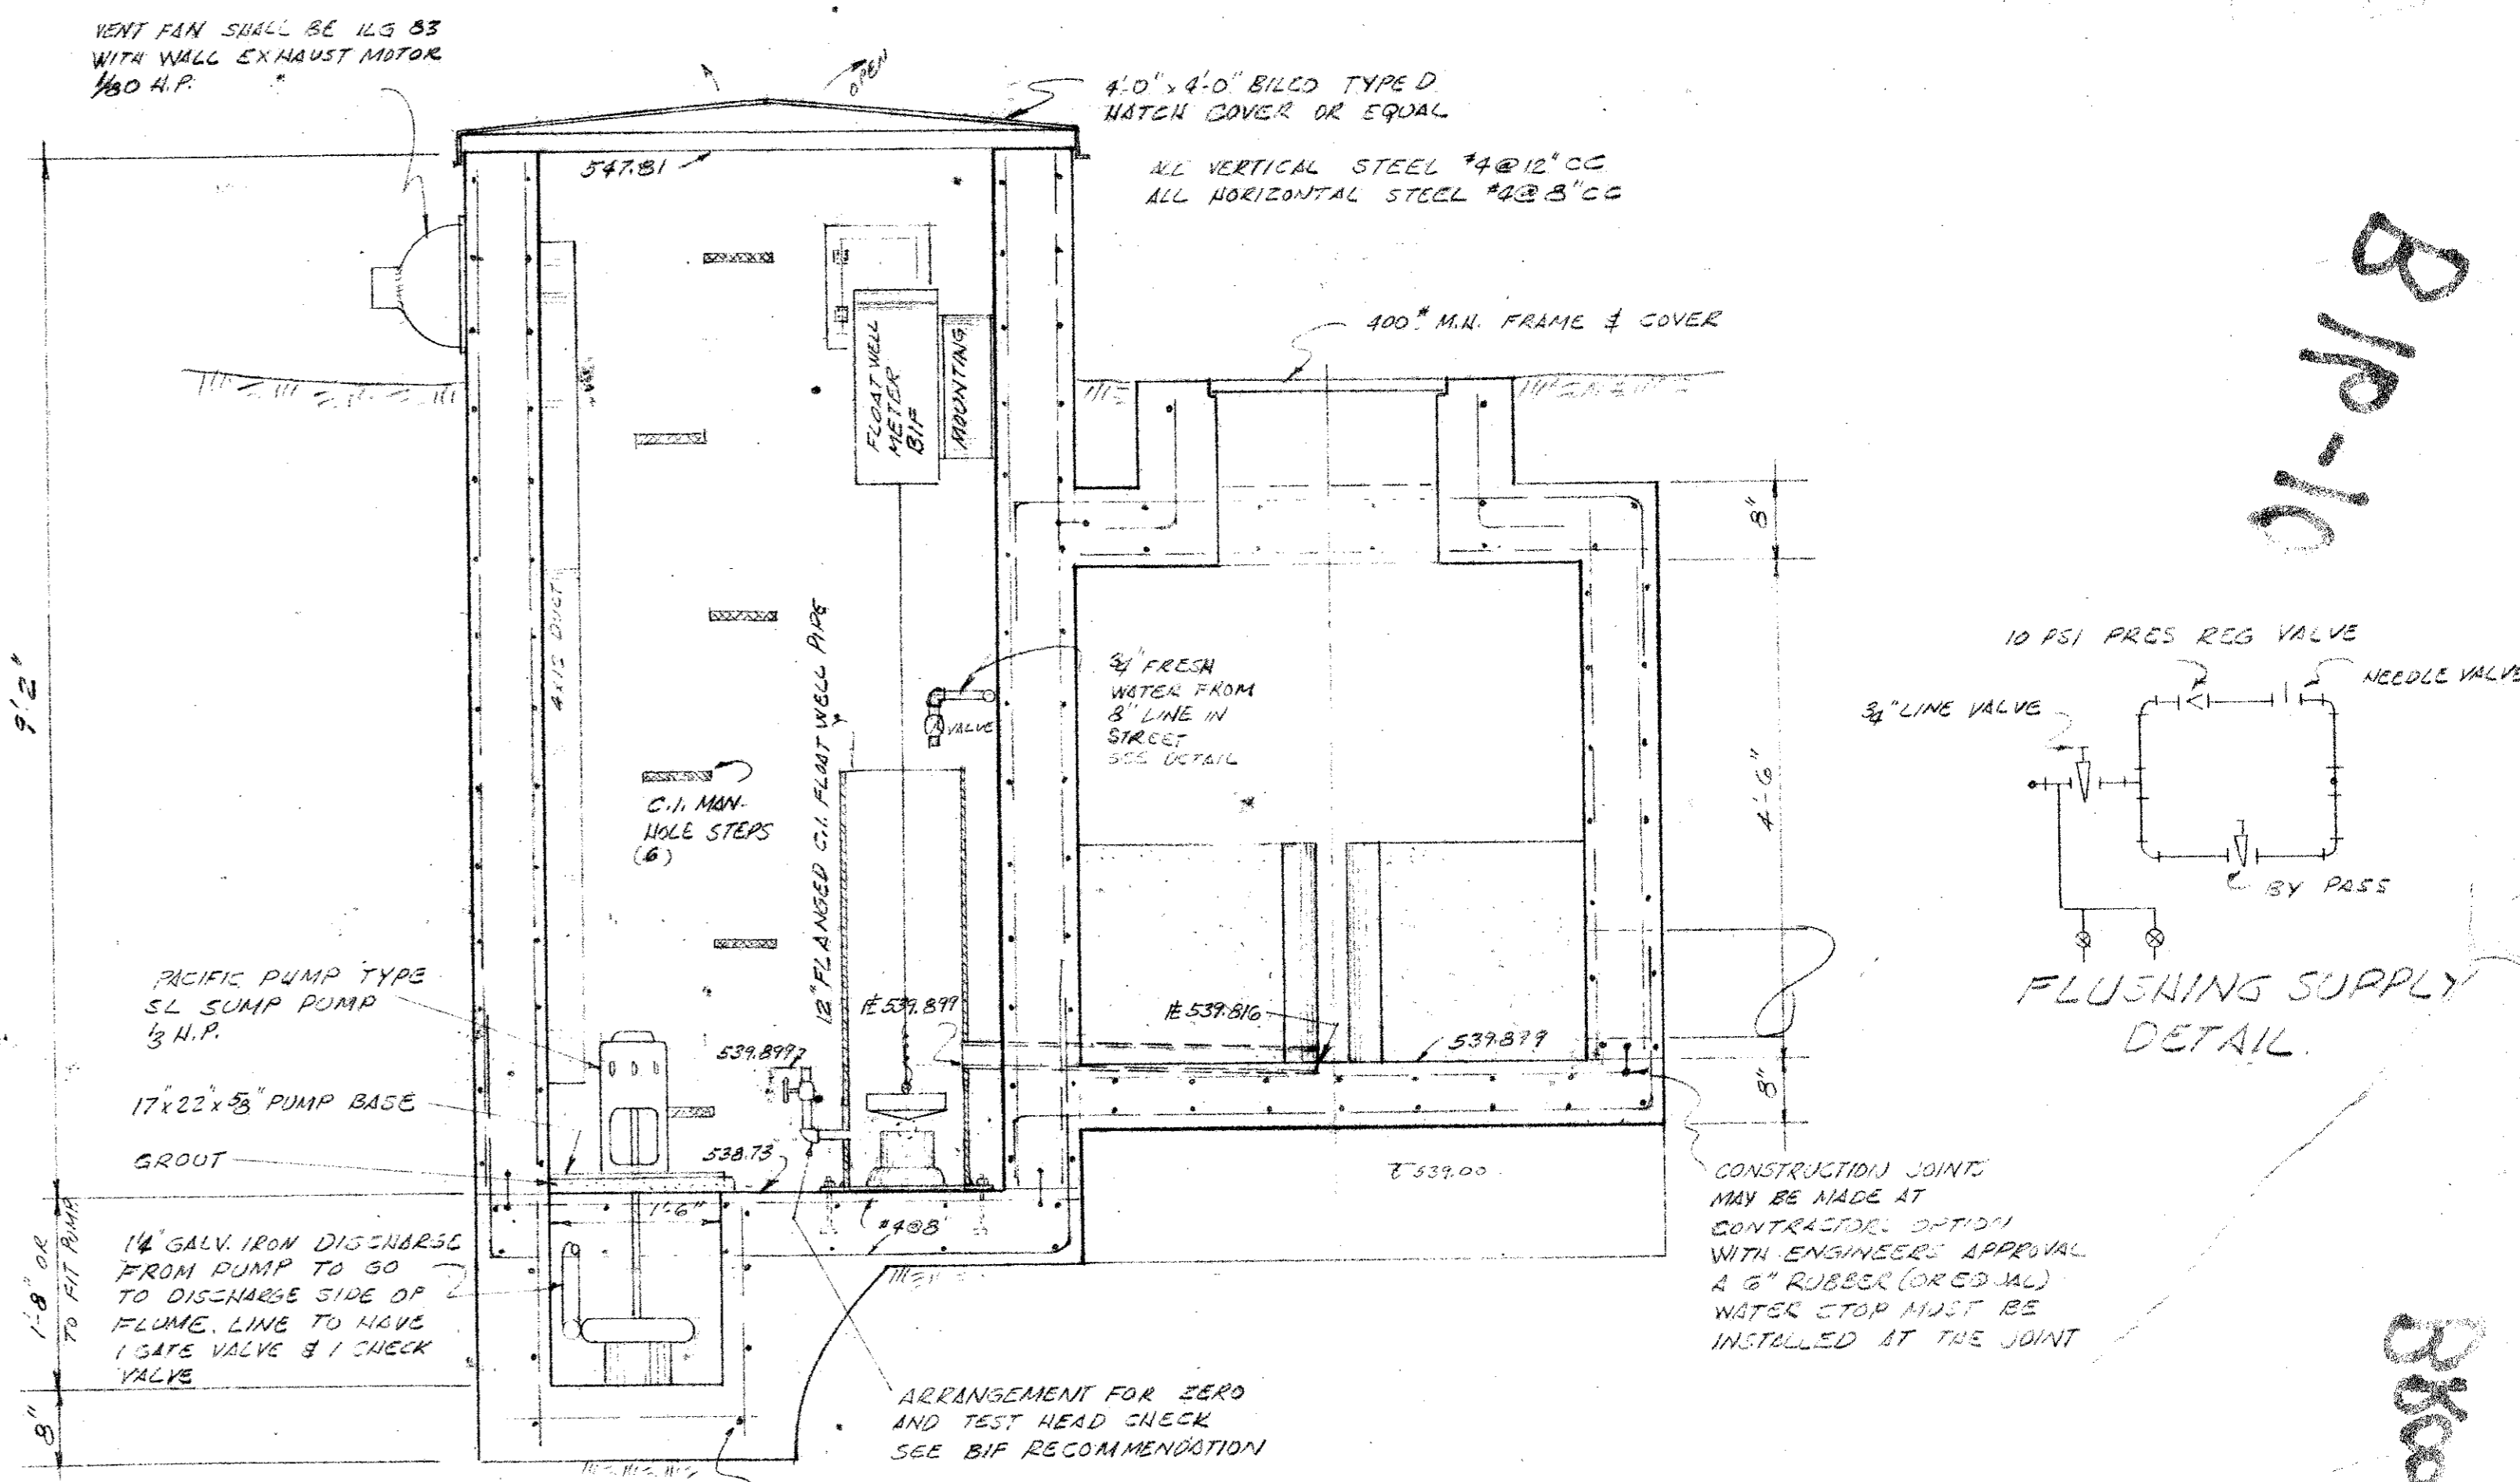

SECTION B-B
3/4" = 1'-0"


NOTE:
PRIOR TO CONSTRUCTING
METERING STATION CONTRACTOR
MUST EXPOSE 10" LINE IN MESH
LANE AND LET ENGINEER VERIFY
GRADES OF DISCHARGE LINES

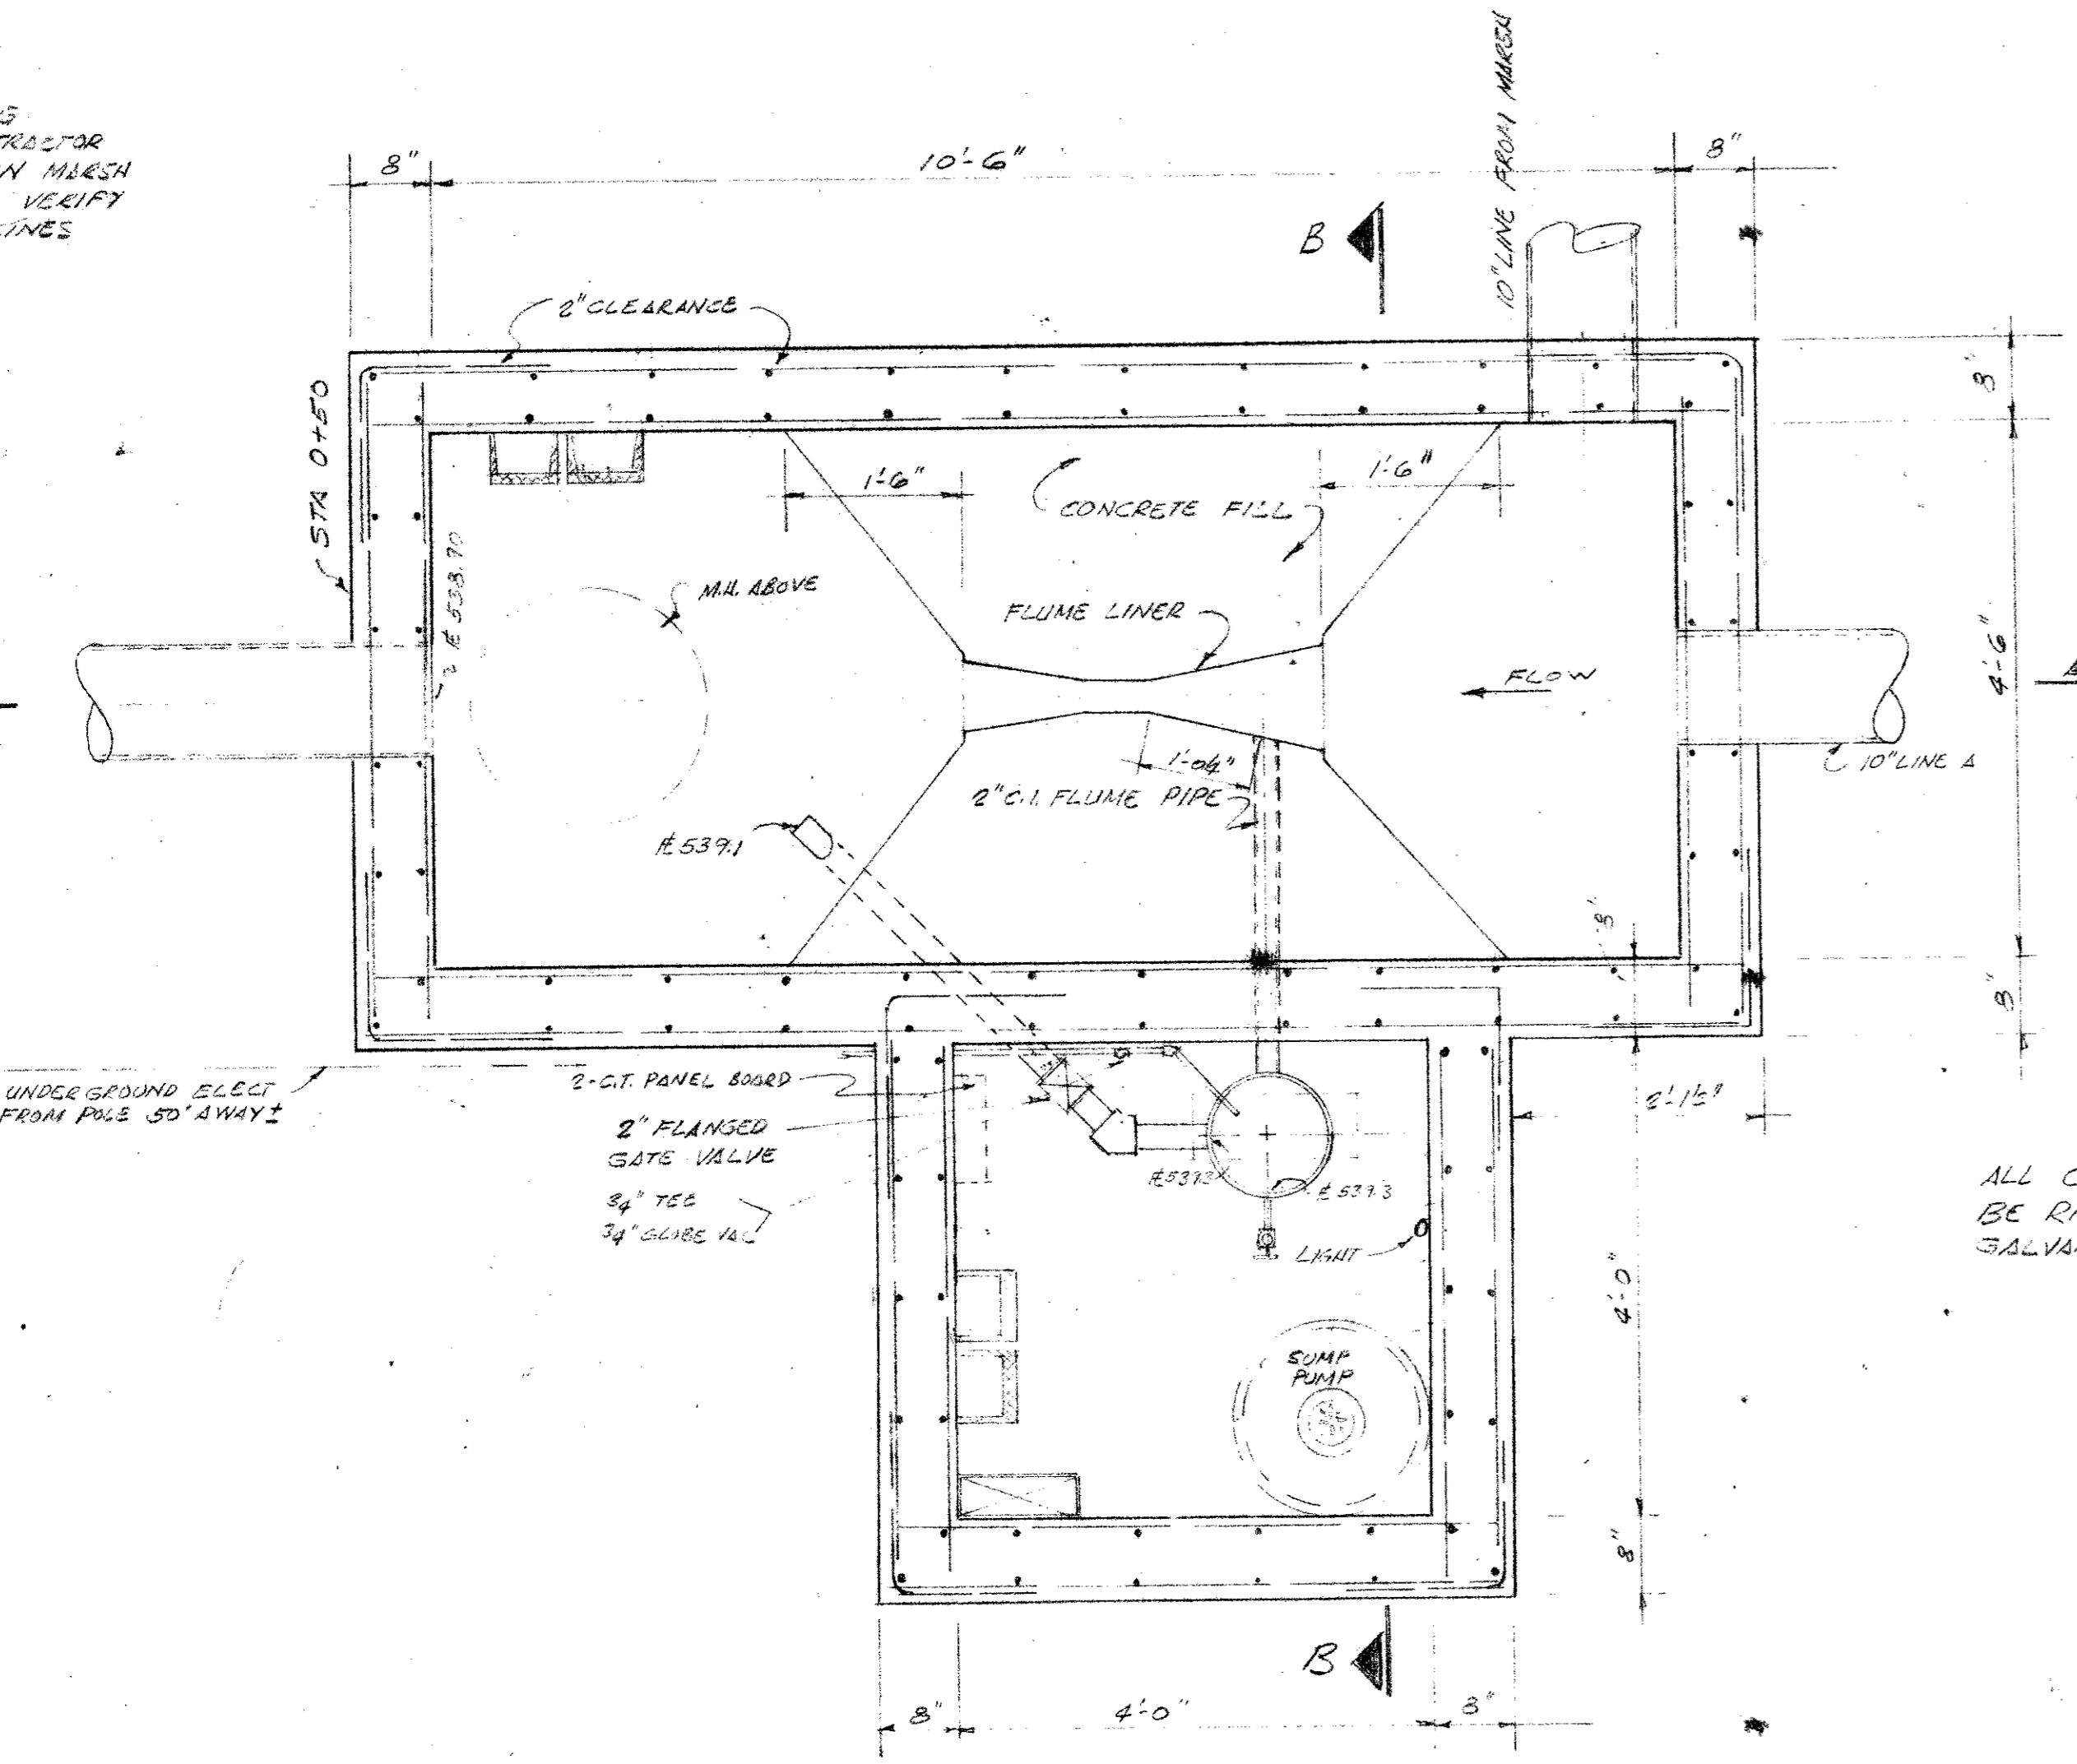


FLOOR PLAN
3/4" = 1'-0"

CUTLER HAMMER TYPE CHES NEMA1 SURFACE MTD PANEL
WITH 2-20A 1P BREAKERS
CIRCUIT #1 - 1/2 HP SUMP MTR.
CIRCUIT #2 100W LAMP RECP FLOATWELL CONTROL & VENT FAN

ALL CONDUIT SHALL
BE RIGID STEEL
GALVANIZED

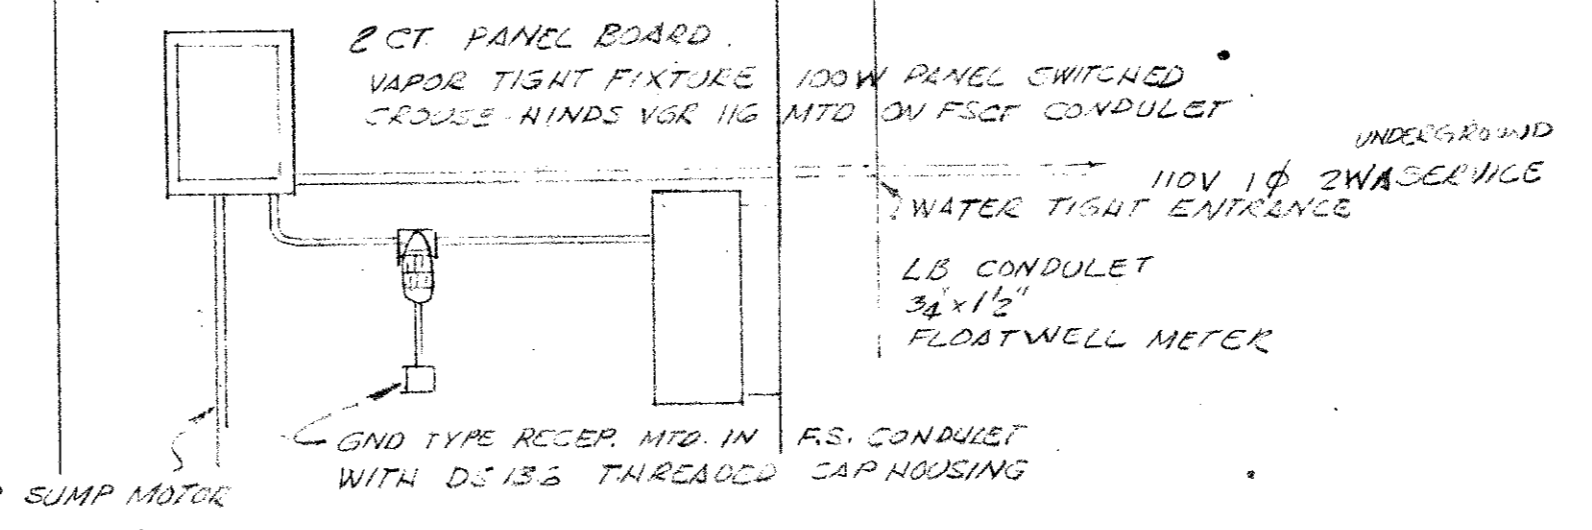

ELECTRICAL DETAIL
SCHEMATIC NO SCALE

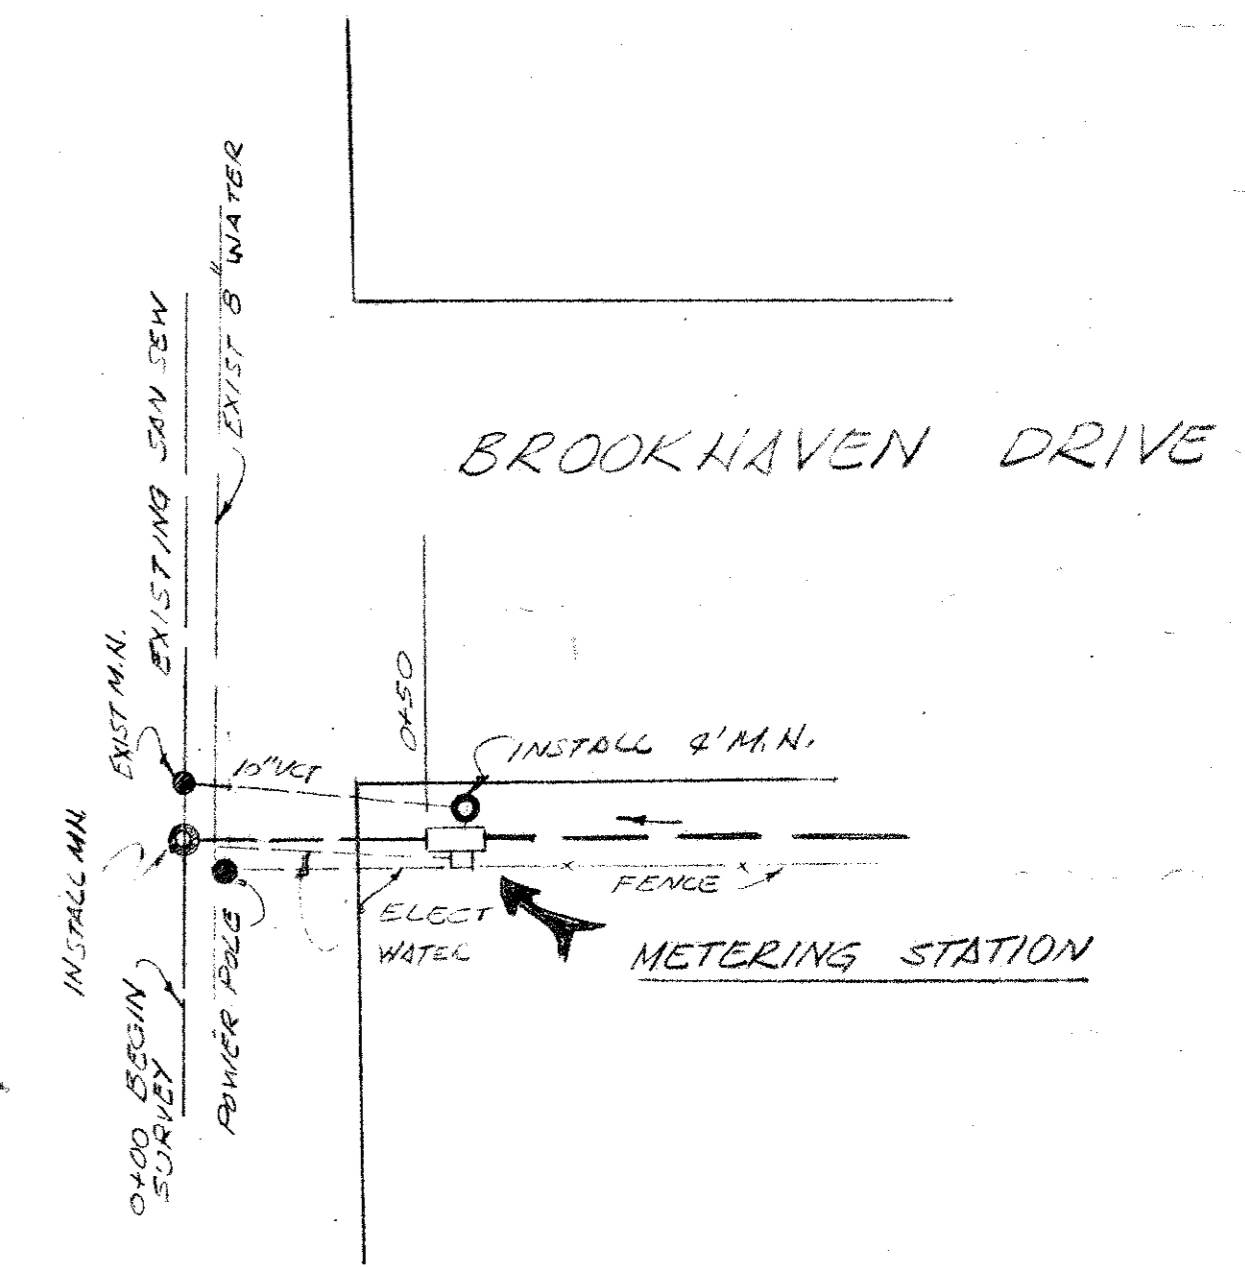

BILLY L. STEPHENSON
AND ASSOCIATES
CONSULTING ENGINEERS
7311 FERGUSON ROAD
327-4553
DALLAS, TEXAS

DATE	REVISION		
	A SEWAGE METERING S		
	ADDISON CITY WATERWORKS CITY OF ADDISON, TEX		
DESIGN	BLS		
DRAWN	BLS		
TRACED	BLS		
CHECKED	BLS		
DATE	SCALE	NOTES	F

B/P-10

BROOKHAVEN DRIVE LINE