




PLAN AT HATCH

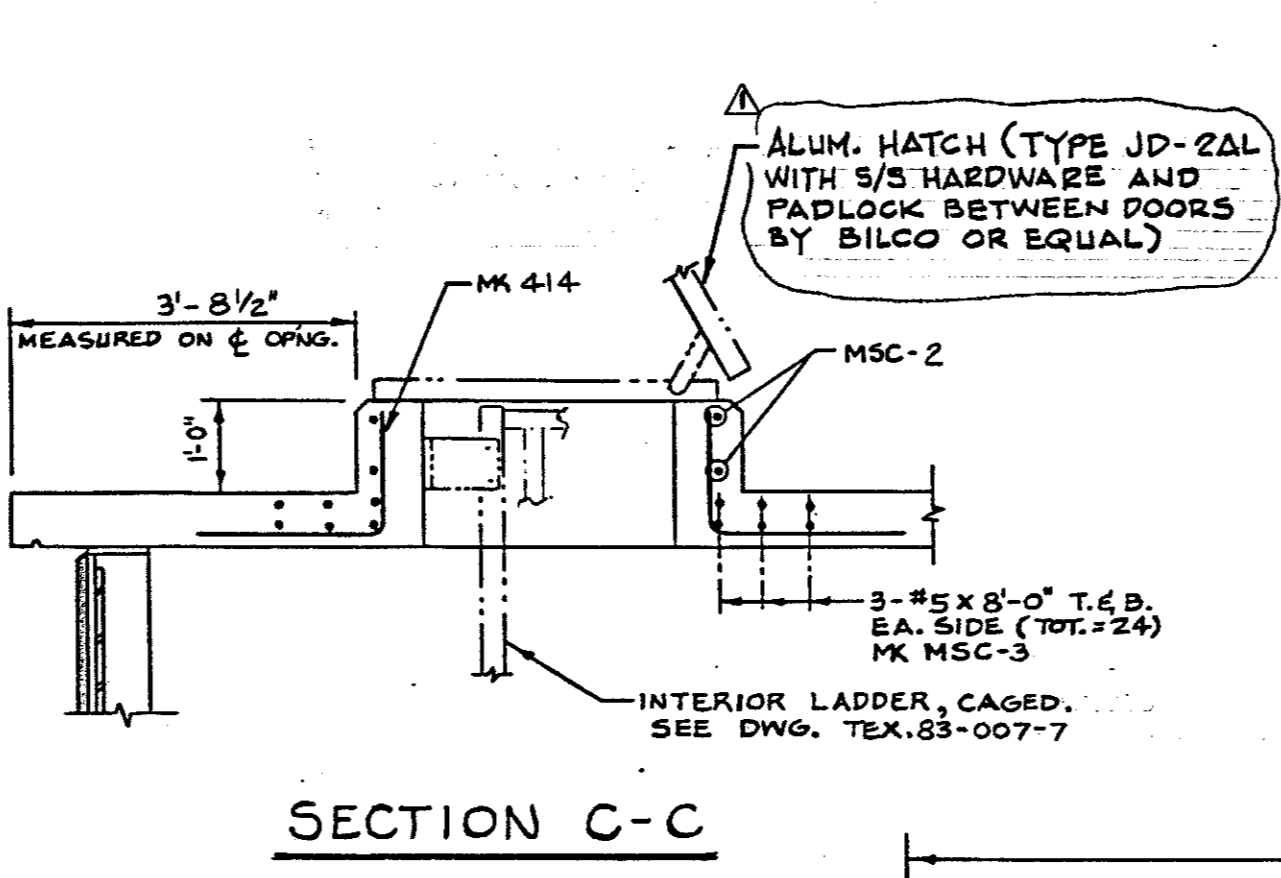


SECTION C-C

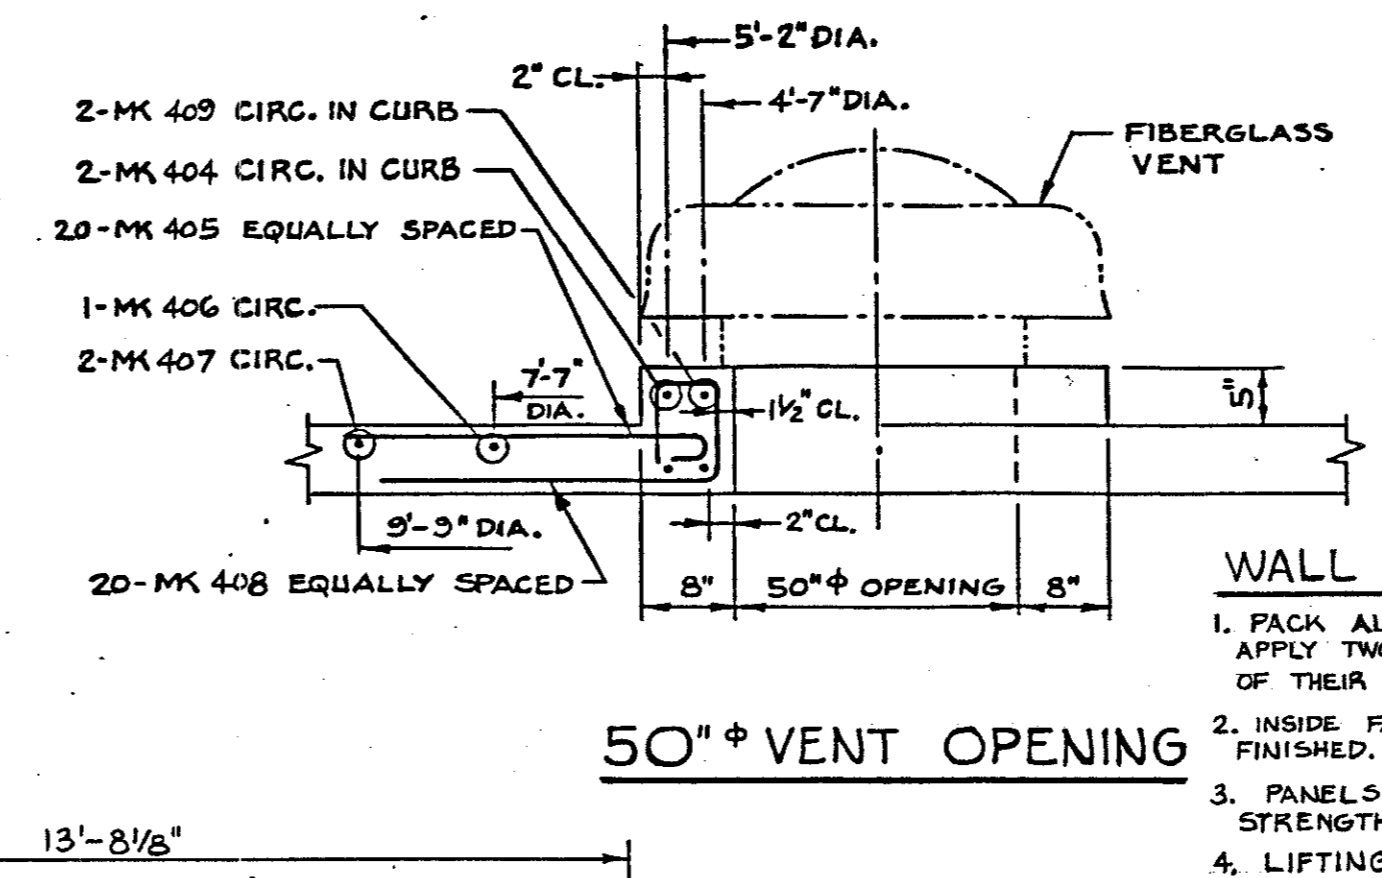


50" VENT OPENING

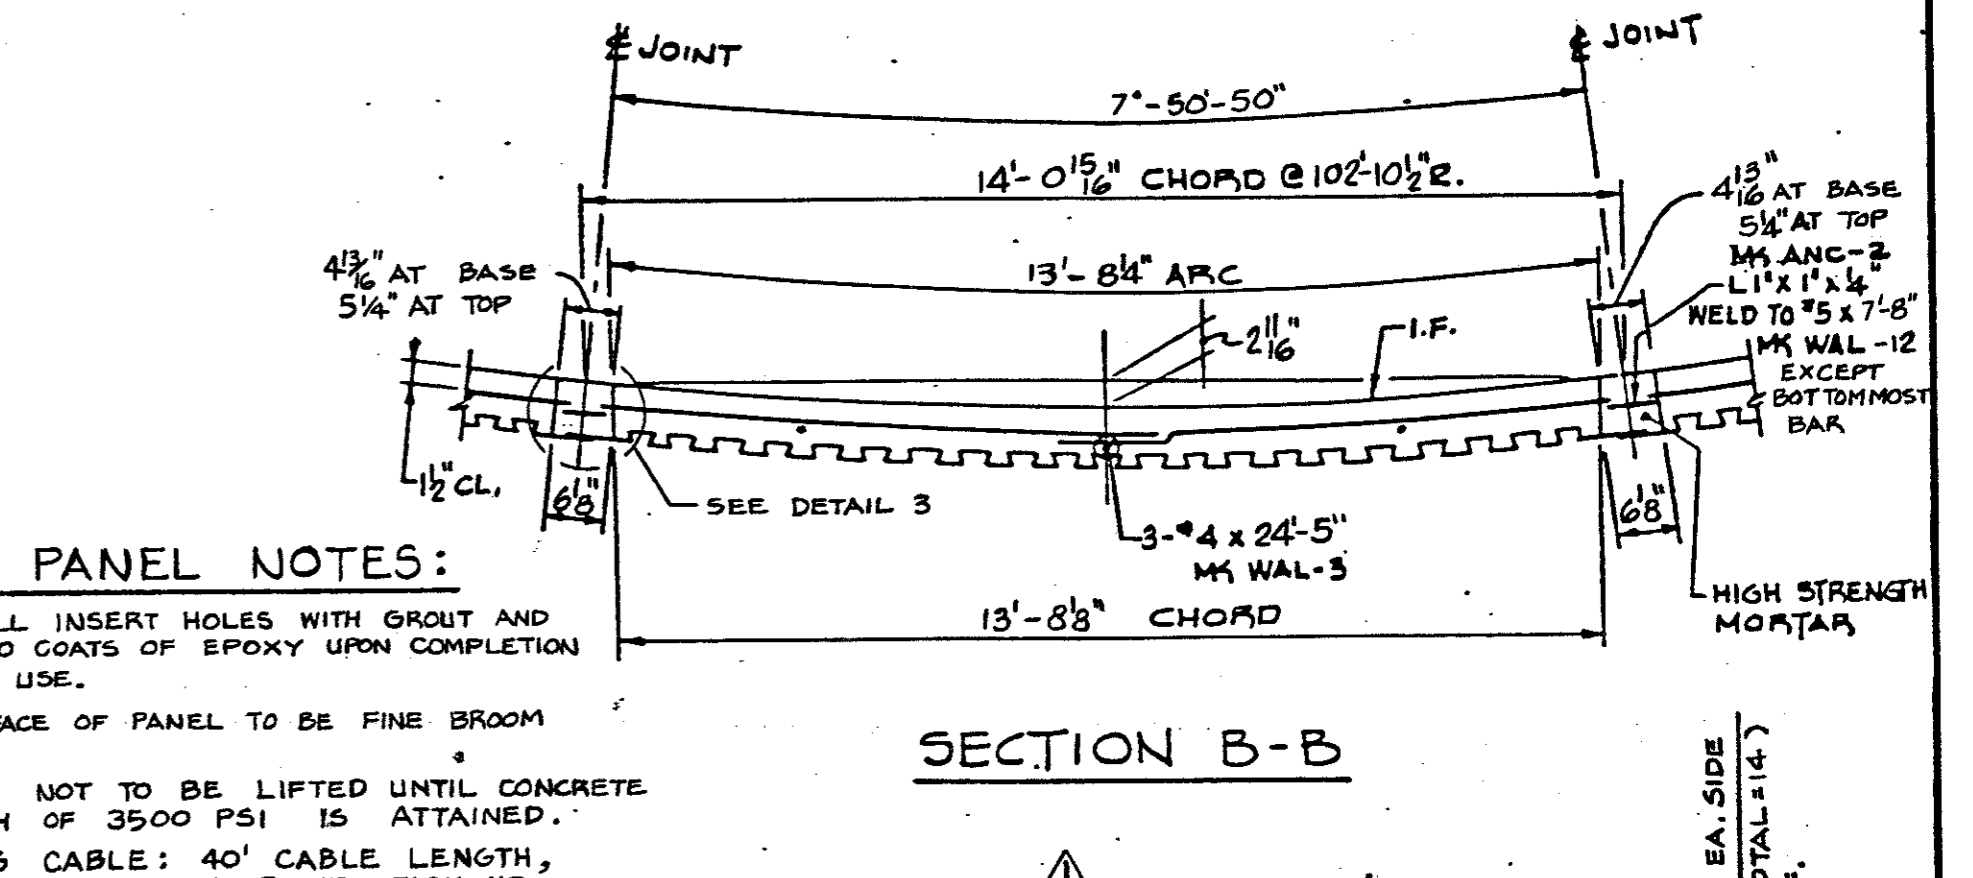

SECTION B-B

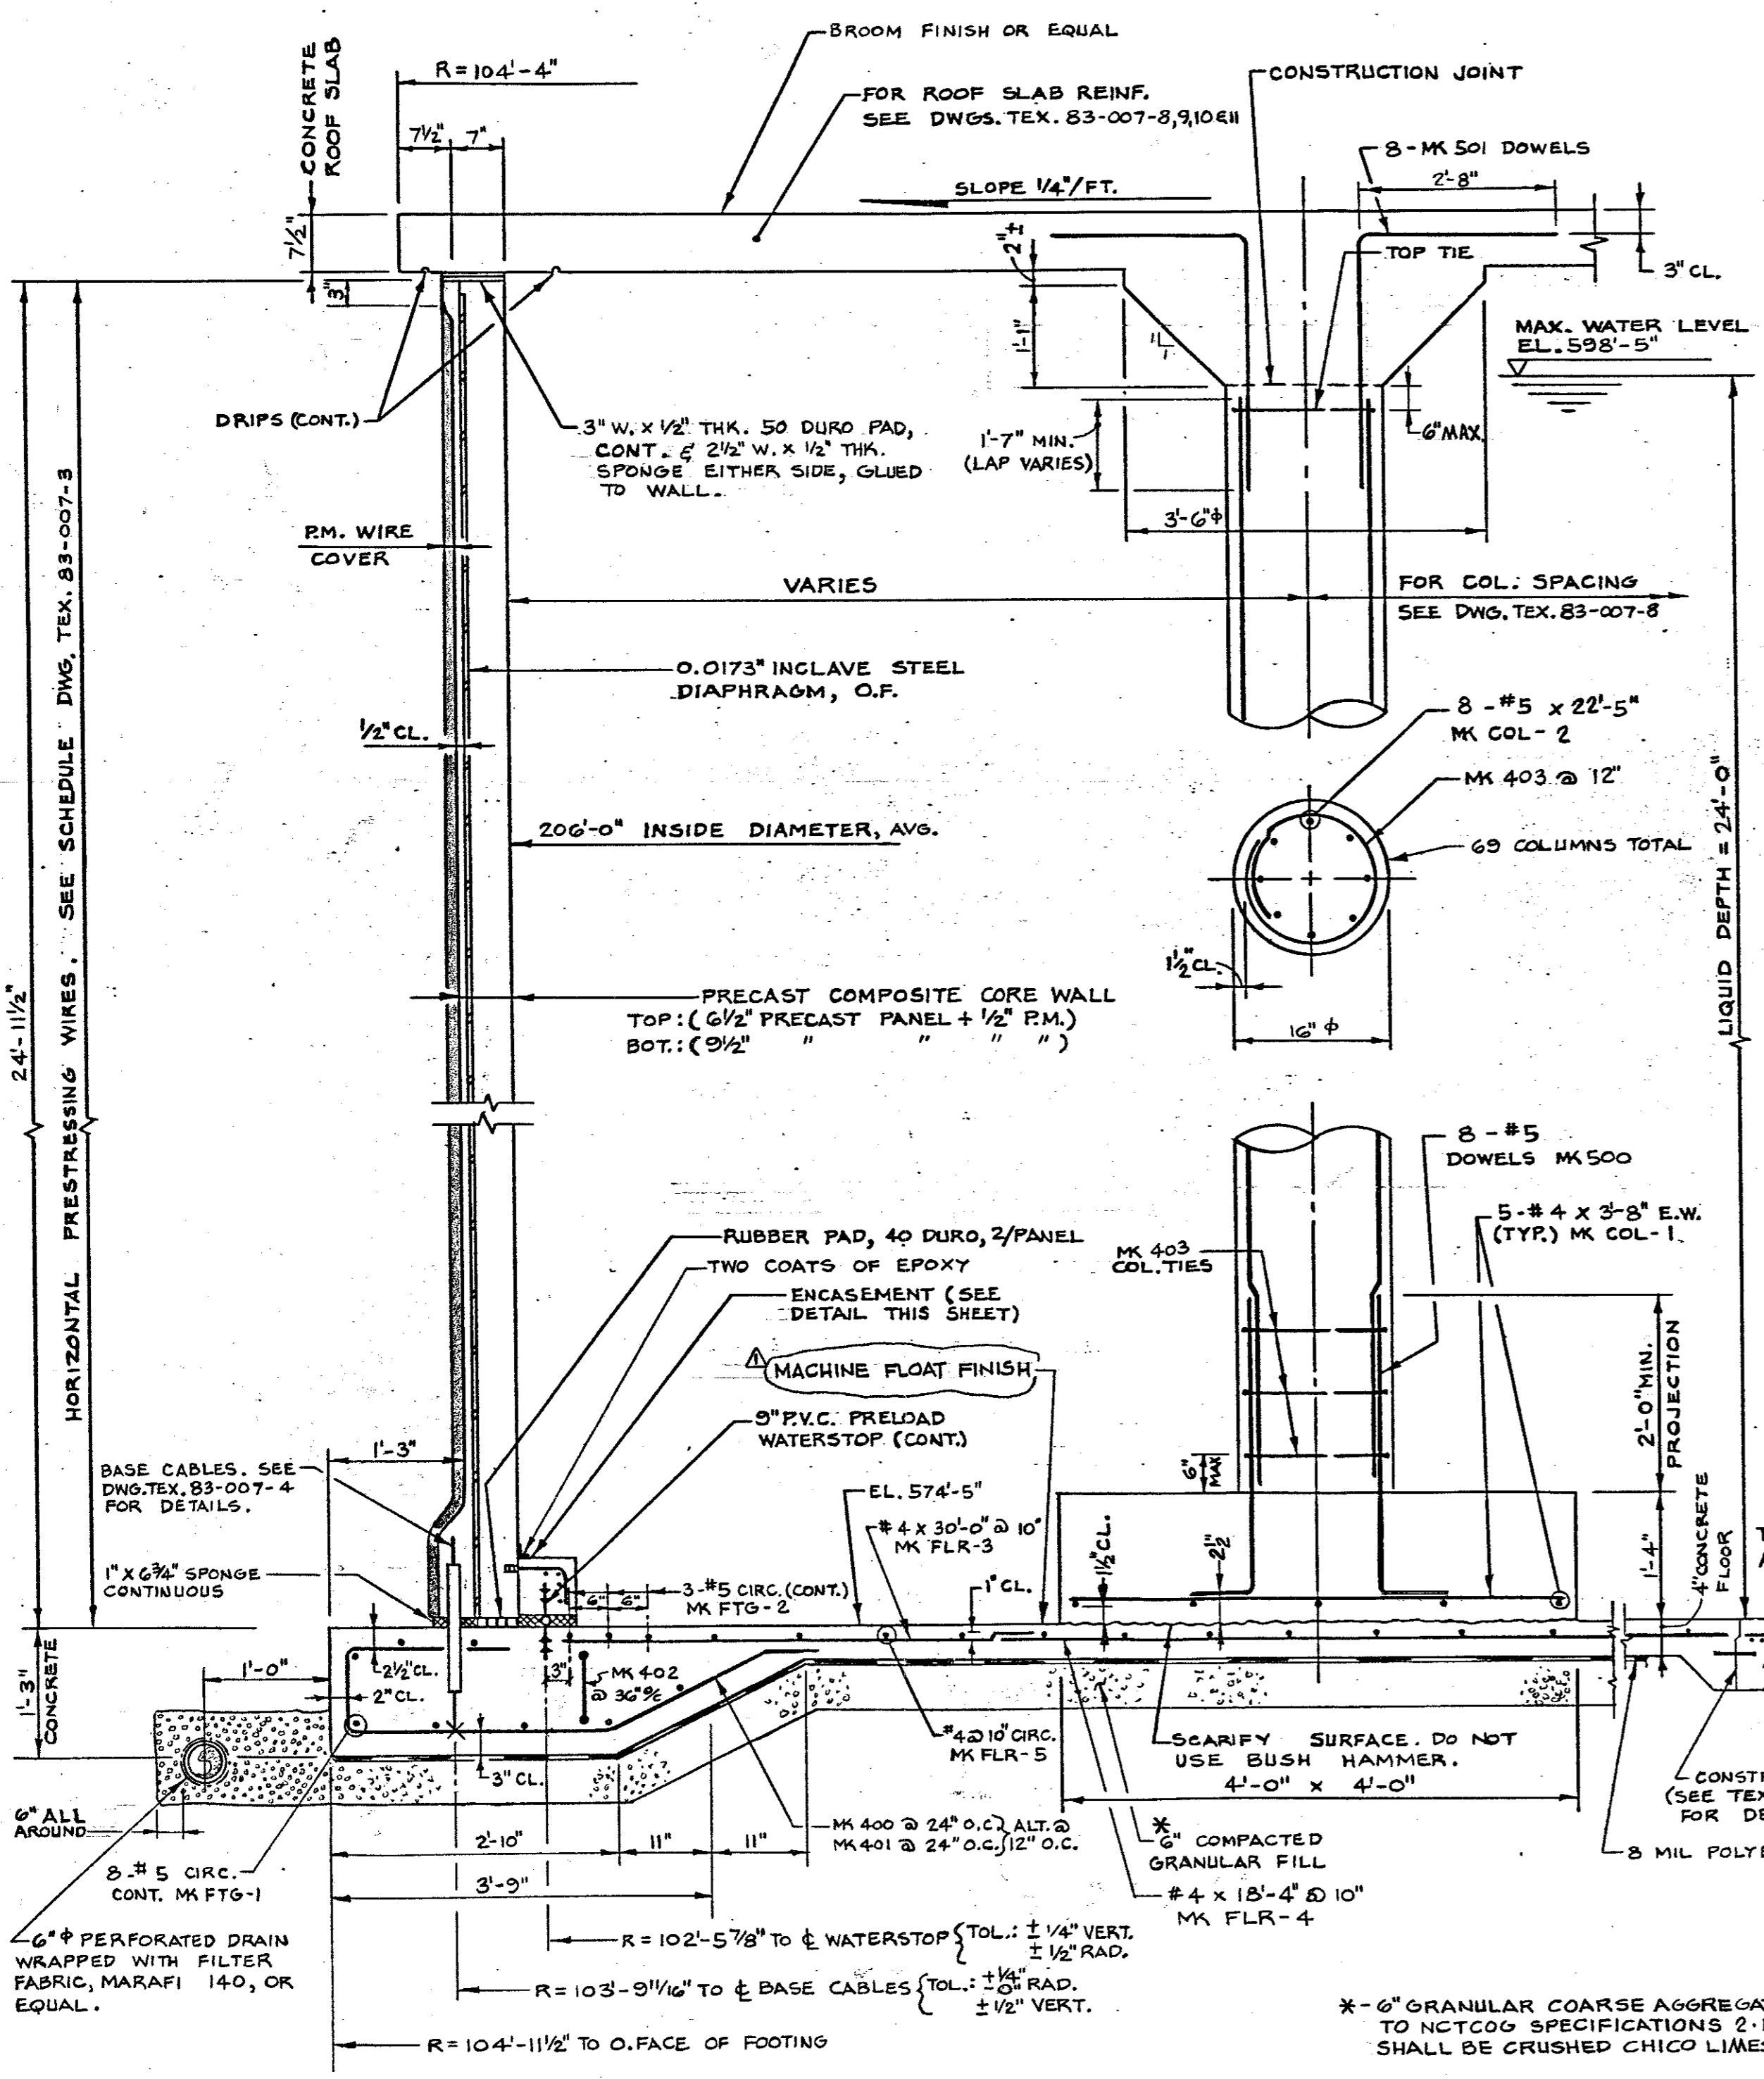


TYPICAL SECTION AT WALL

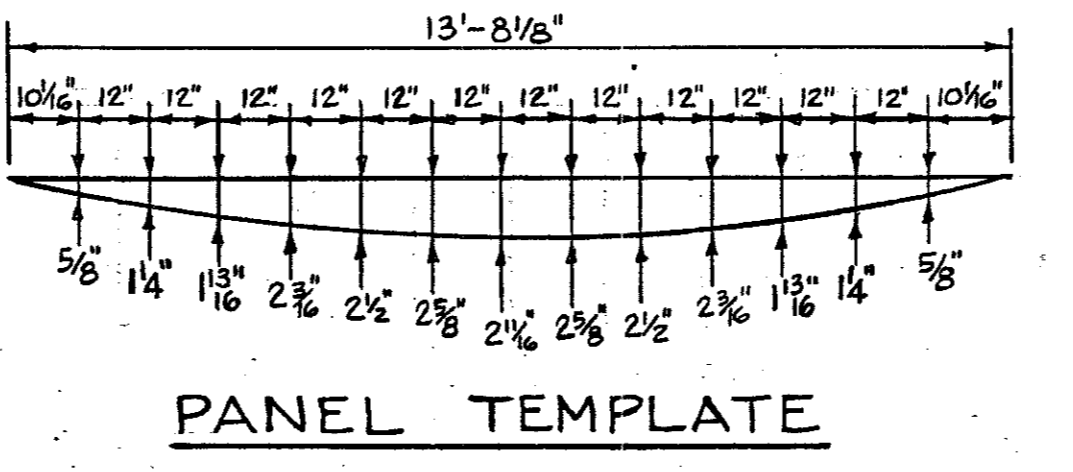


PANEL TEMPLATE


- GENERAL NOTES:
1. P.M. = PNEUMATIC MORTAR (28-DAY COMPRESSIVE STRENGTH = 4500 PSI)
 2. MIN. 28-DAY CONCRETE CYLINDER STRENGTHS:
 - FOOTINGS & FLOOR ----- 3000 PSI
 - ROOF SLAB & COLUMNS ----- 4500 PSI
 - WALL ----- 4500 PSI
 - PIPE ENCASEMENT ----- 3000 PSI
 3. ROOF LIVE LOAD = 100 P.S.F.
 4. REBARS TO BE NEW BILLET STEEL, ASTM A615, GR. 60. MIN. LAP = 30 BAR DIA.
 5. WELDED WIRE FABRIC TO CONFORM TO ASTM A185
 6. ALL SPONGE RUBBER ON THIS DWG. SHALL CONFORM TO ASTM D1056-RE 41.

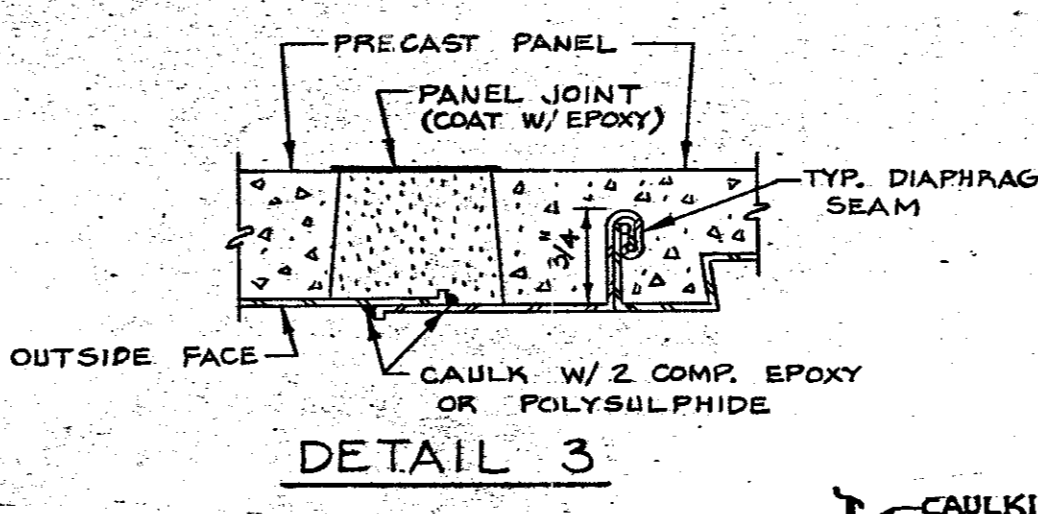

DETAIL 3

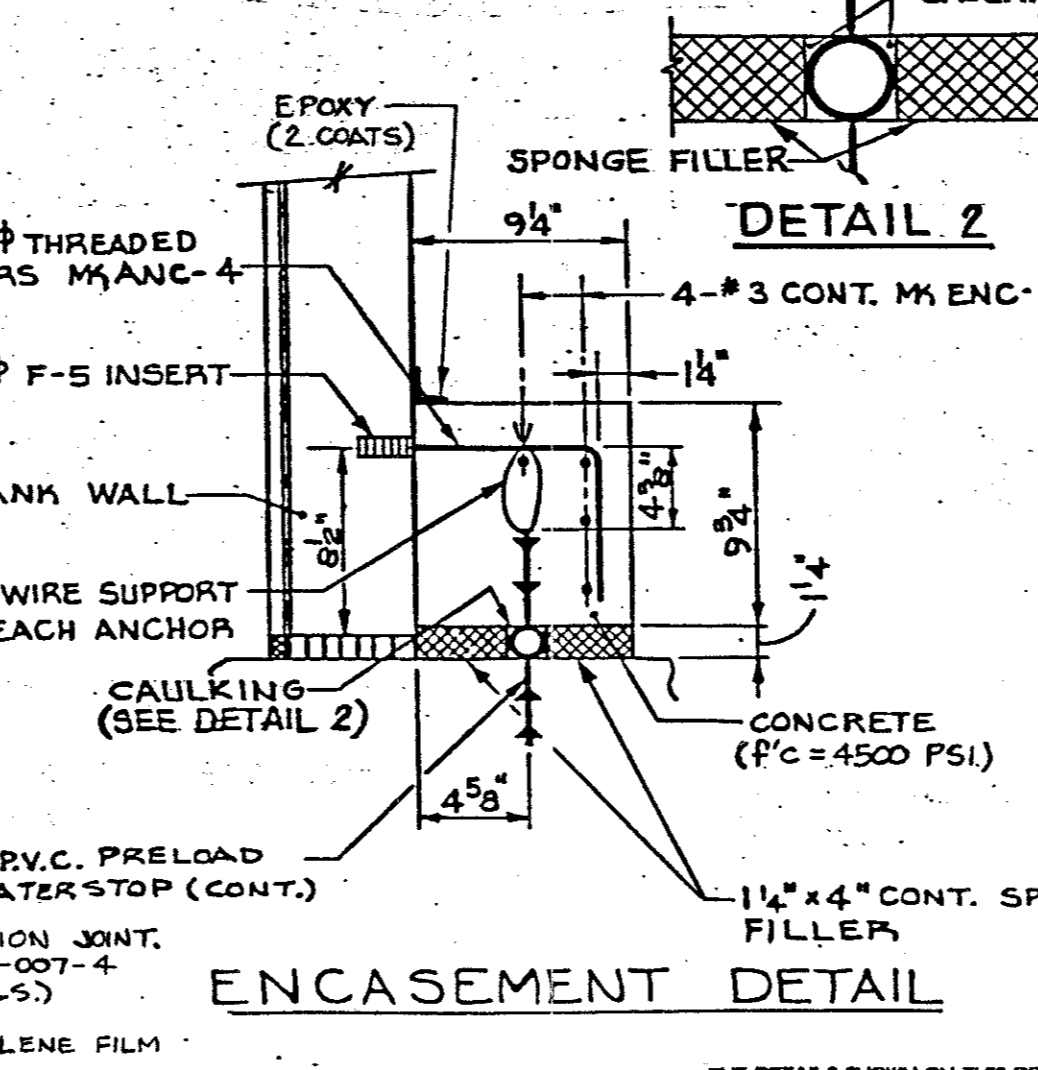

ENCASEMENT DETAIL

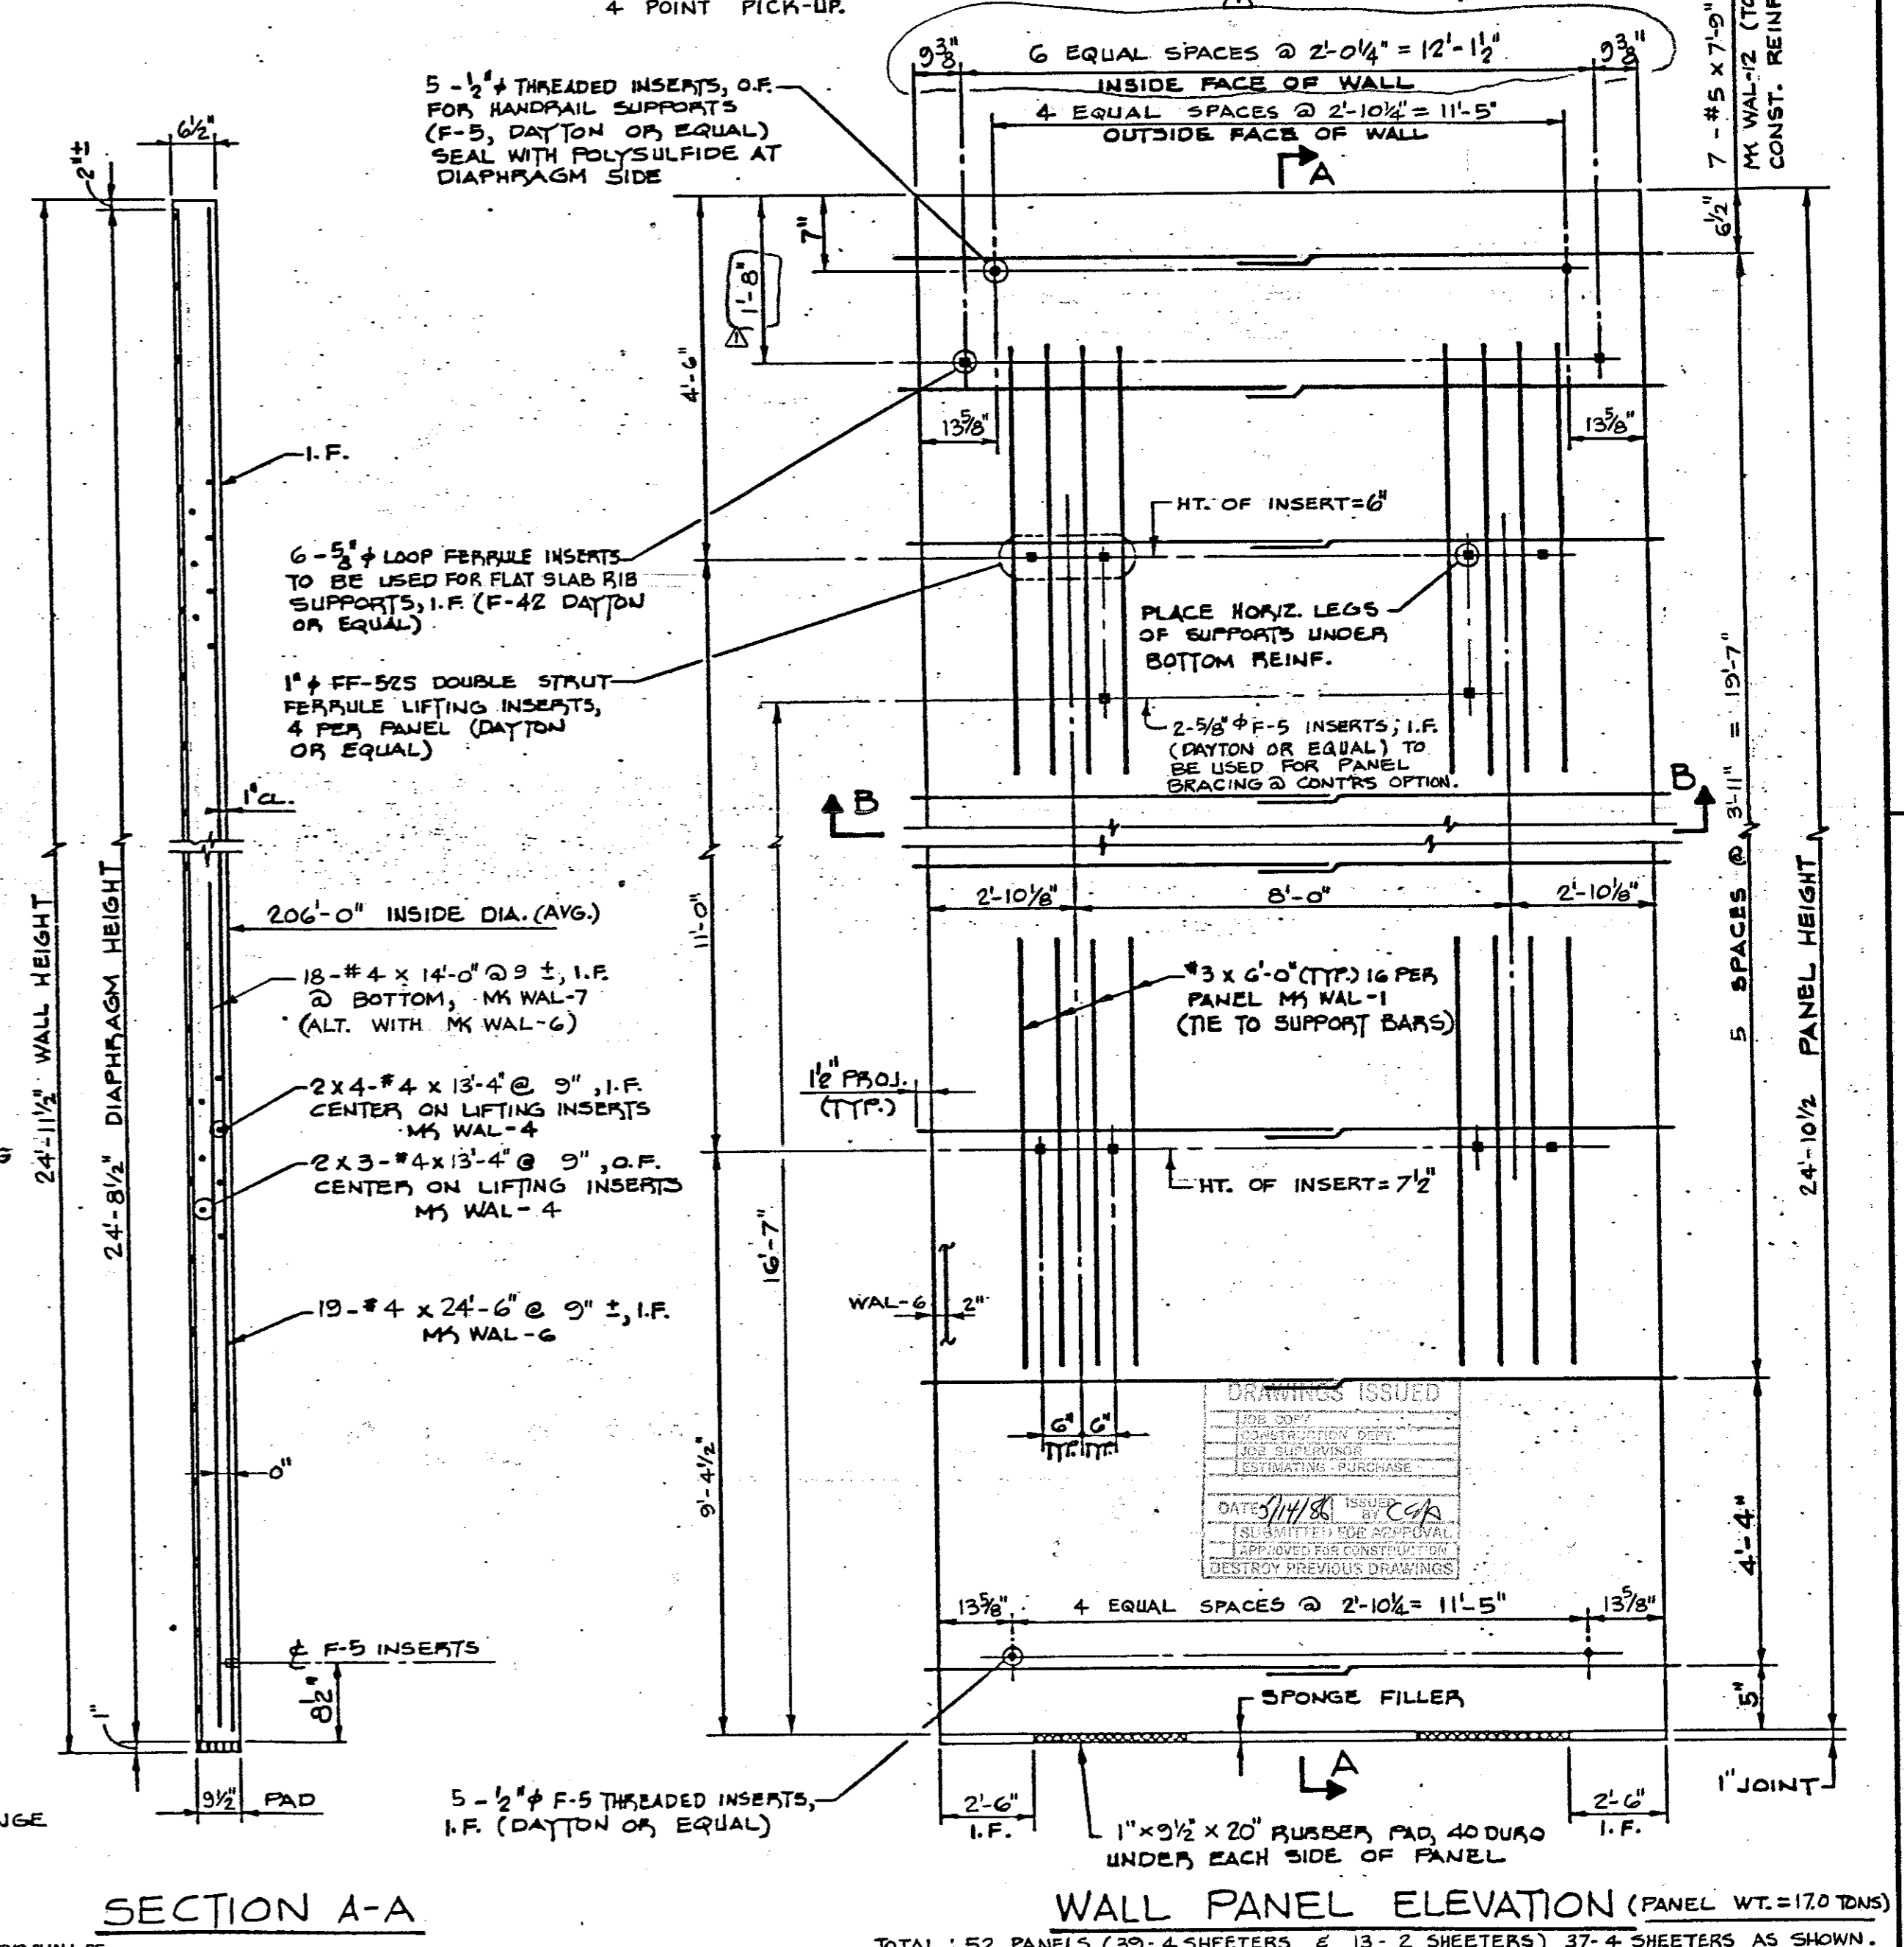

SECTION A-A

WORKING DRAWING

REVISIONS				
NO.	DATE	DESCRIPTION	BY	CKD
1	5/9/86	REV. ROOF HATCH (SECT. C-C), GRANULAR SPEC. & ROOF RIB SUPPORT INSERTS	E	RAO

839 STEWART AVENUE, GARDEN CITY, NEW YORK, 11530

THIS DRAWING IS THE PROPERTY OF THE PRELOAD COMPANY, INC. AND/OR PRELOAD TECHNOLOGY, INC. AND IS SUBJECT TO RETURN ON DEMAND. IT CONTAINS FEATURES OF DESIGN WHICH ARE FULLY COVERED BY PATENTS AND PATENTS PENDING AND COPYRIGHTS. IT IS SUBMITTED FOR USE ONLY IN CONNECTION WITH PROPOSALS OR CONTRACTS OF PRELOAD OR ITS LICENSEES UPON THE EXPRESS CONDITION THAT IT MAY NOT BE USED ON ANY OTHER DIFFERENT PROJECTS WITHOUT PRIOR APPROVAL OF PRELOAD.

ONE 6.0 M.G. WATER STORAGE TANK
ADDISON, TEXAS

TYPICAL TANK SECTION

DRAWN: JD	SCALE: NONE	CONTRACT: 86 PE 00 4
DESIGNED: FD	MTO:	DRAWING NUMBER: 83-007-2
CHECKED: RAO	DATE: 4-24-86	