


KEY PLAN

NOTE:
 COLUMNS A-3, A-5, A-7, C-1, C-9, E-1, E-9;
 G-1, G-9 & J-3, J-5 & J-7 ARE OFFSET FROM
 COLUMN 4'S SHOWN ABOVE.

ROOF SLAB GRID SCHEDULE (LAYER NO. 4)										
BUNDLE MK	REINR PER BUNDLE	NO. OF TOTAL BUNDLES	NO. OF BARS	ORDER	BAR WEIGHT			LOCATION	SKETCH	
					#5	#4	#3			
CT1	11 #5	26'-6"	3	33	35	967		LINE E & 5 END BAYS	4" 26'-2"	
CT2A	3 #5	14'-0"	18	54	57	832		LINE 4, 5, E, D & F END BAYS PLUS LINE 6		
CT3	10 #5	10'-4"	4	40	42	453		LINE E & 5 END BAYS		
CT4	6 #5	26'-6"	2	12	13	359		EACH SIDE OF HATCH	4" 26'-2"	
CT5	10 #5	14'-0"	45	450	460	6717		INTERIOR BAYS		
CT6	9 #5	10'-4"	53	477	490	5281		INTERIOR BAYS PLUS LINE 4, 6, D & F END BAYS		
CT7	9 #5	27'-0"	8	72	75	2112		LINE 4, 6, D & F END BAYS	4" 26'-8"	
CT8	12 #5	23'-2"	8	96	100	2417		LINE END BAYS	4" 22'-10"	
CT9	20 #5	23'-4"	4	80	84	2044		ALONG WALL	4" 23'-0"	
CT10	3 #5	20'-11"	7	21	22	480		LINE D ONLY		
MT1	11 #4	26'-8"	8	88	92	1639		MID. STRIP D-E, E-F, 5-4 & 5-6 END BAYS	4" 26'-4"	
MT2	11 #4	11'-1"	38	418	430	3183		INTERIOR BAYS		
MT3	11 #4	23'-4"	8	88	92	1433		MID. STRIP C-D, F-G, 3-4 & 6-7 END BAYS	4" 23'-0"	
MT4	20 #4	15'-4"	8	160	165	1690		ALONG WALL	4" 15'-0"	
MT5	3 #4	19'-6"	6	18	19	248		LINE D		
MT6	140 #4	4'-0"	1	140	145	387		CONSTRUCTION JOINT		
TOTAL WEIGHT					21662	8580				

PART ROOF FRAMING PLAN
 SCALE: 3/32" = 1'-0"

- NOTES:**
1. REINFORCING STEEL TO CONFORM TO ASTM A615, GRADE 60.
 2. FOR HATCH, VENT & SONIC LEVEL TRANSMITTER DETAILS & ADD'L REINF. SEE DWG TEX. 83-007-12
 3. FOR INLET PIPE SEE DWG TEX. 83-007-6
 4. FOR TYP MIDDLE STRIP & COLUMN SECTIONS SEE DWG TEX. 83-007-12
 5. REINFORCING BARS DETAILED ON THIS DWG ARE FOR LAYER #4 (SEE REBAR LAYOUT, THIS DWG)
 6. FOR OTHER LAYERS SEE DWGS TEX. 83-007-8, -9 & -10
 7. REINF. MARKED WITH SUFFIX "A" TO BE PLACED NEAR THE # COLUMN.

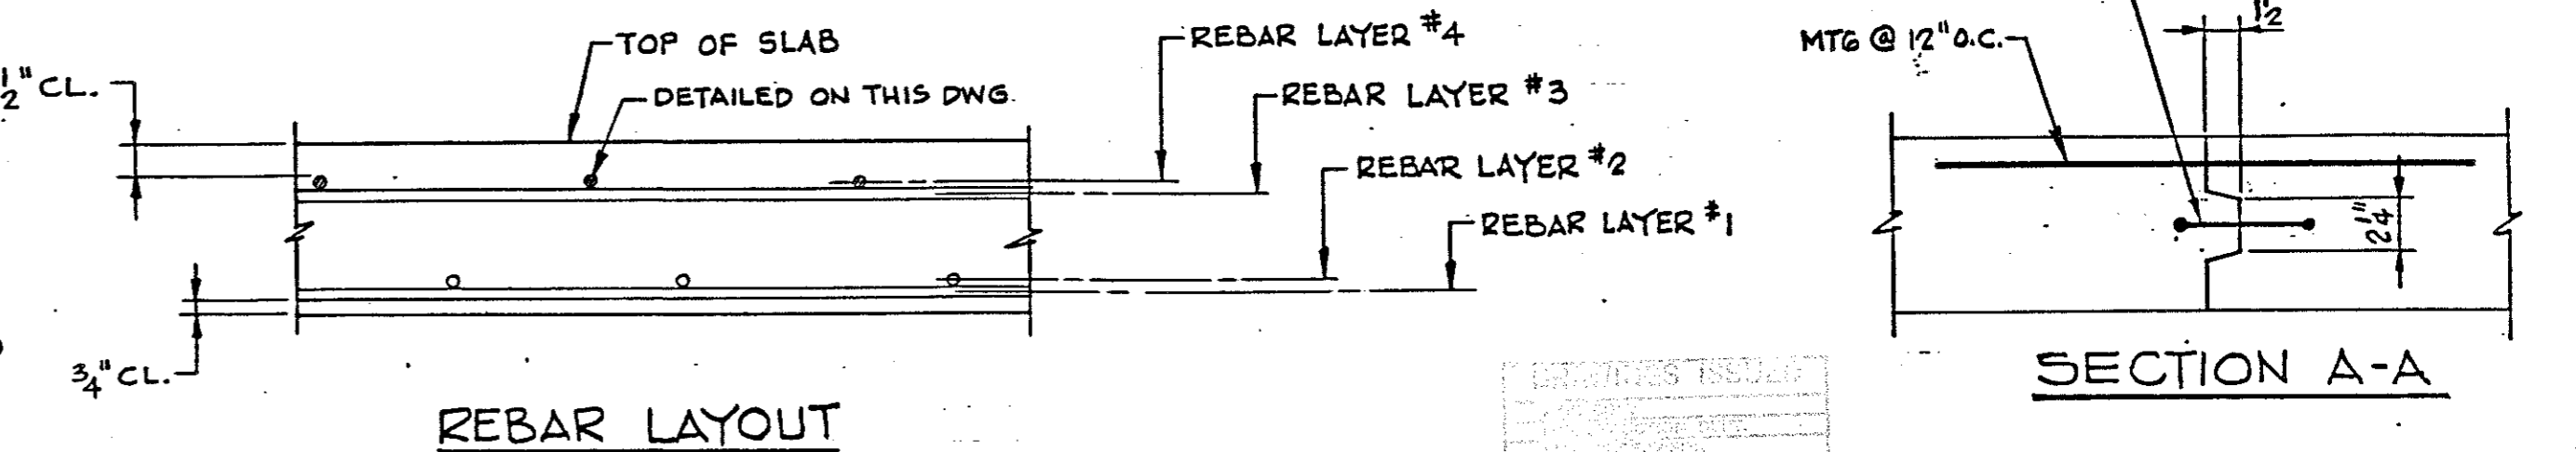

- FORMWORK NOTES:**
1. FORMWORK DESIGN AND RESHORING SHALL BE IN ACCORDANCE WITH ACI 347, LATEST EDITION.
 2. FORMS TO REMAIN UNTIL SLAB REACHES DESIGN STRENGTH BUT NOT LESS THAN 7 DAYS UNLESS RESHORING IS USED.
 3. SLAB BETWEEN CONSTRUCTION JOINT AND COLUMNS IS NOT DESIGNED FOR CANTILEVER ACTION. FORMWORK IN THIS AREA MUST REMAIN UNTIL ADJACENT SLAB IS CAST AND HAS ACHIEVED FULL STRENGTH.

REVISIONS				
NO.	DATE	DESCRIPTION	BY	CKD

PRELOAD

839 STEWART AVENUE, GARDEN CITY, NEW YORK, 11530

THIS DRAWING IS THE PROPERTY OF THE PRELOAD COMPANY, INC. AND/OR PRELOAD TECHNOLOGY, INC. AND IS SUBJECT TO RETURN ON DEMAND. IT CONTAINS FEATURES OF DESIGN WHICH ARE FULLY COVERED BY PATENTS AND PATENTS PENDING AND COPYRIGHTS. IT IS SUBMITTED FOR USE ONLY IN CONNECTION WITH PROPOSALS OR CONTRACTS OF PRELOAD OR ITS LICENSEES. UPON THE EXPRESS CONDITION THAT IT MAY NOT BE USED ON ANY OTHER DIFFERENT PROJECTS WITHOUT PRIOR APPROVAL OF PRELOAD.

WORKING DRAWING

ONE 6.0 M.G. GROUND STORAGE RESERVOIR
 ADDISON, TEXAS
 ROOF SLAB REINFORCING
 LAYER NO. 4

DESIGNED: RAO
 CHECKED: FD
 DATE: 4/24/86

CONTRACT NUMBER: 86 PE 004
 DRAWING NUMBER: 83-007-11