


NOTE: EXPOSED SURFACES, EXCEPT THE SIDEWALK, SHALL RECEIVE A GRADE I FINISH, TINTED A LIGHT GREY SIMILAR TO FEDERAL SPECIFICATION COLOR No 26405, IN ACCORDANCE WITH ITEM 427. SIDEWALK SURFACE SHALL RECEIVE A NON-SKID WOOD FLOAT SURFACE.

GENERAL NOTES:
 ALL CONCRETE TO BE CLASS "A", DESIGN 1c - 3,000 psi.
 ALL REINFORCING STEEL TO BE ASTM A-416, GRADE 60.
 ALL REINFORCING STEEL BAR LAPS TO BE 18-INCH MINIMUM.
 ALL EXPOSED CORNERS SHALL BE CHAMFERED 3/4-INCH.
 EXPANSION JOINTS ARE NOTED. ALL OTHER JOINTS SHALL BE CONTRACTION.
 ○ DENOTES PANEL NUMBER.
 □ DENOTES MATCH POINT.

NOTE:
 The information shown on this drawing concerning type and location of underground utilities is not guaranteed to be accurate or all inclusive. The Contractor is responsible for making his own determinations as to type and location of underground utilities as may be necessary to avoid damage thereto. The Contractor shall verify location of underground pipe lines, conduits, and structures by contacting owners of underground utilities and by prospecting in advance of excavation operations.

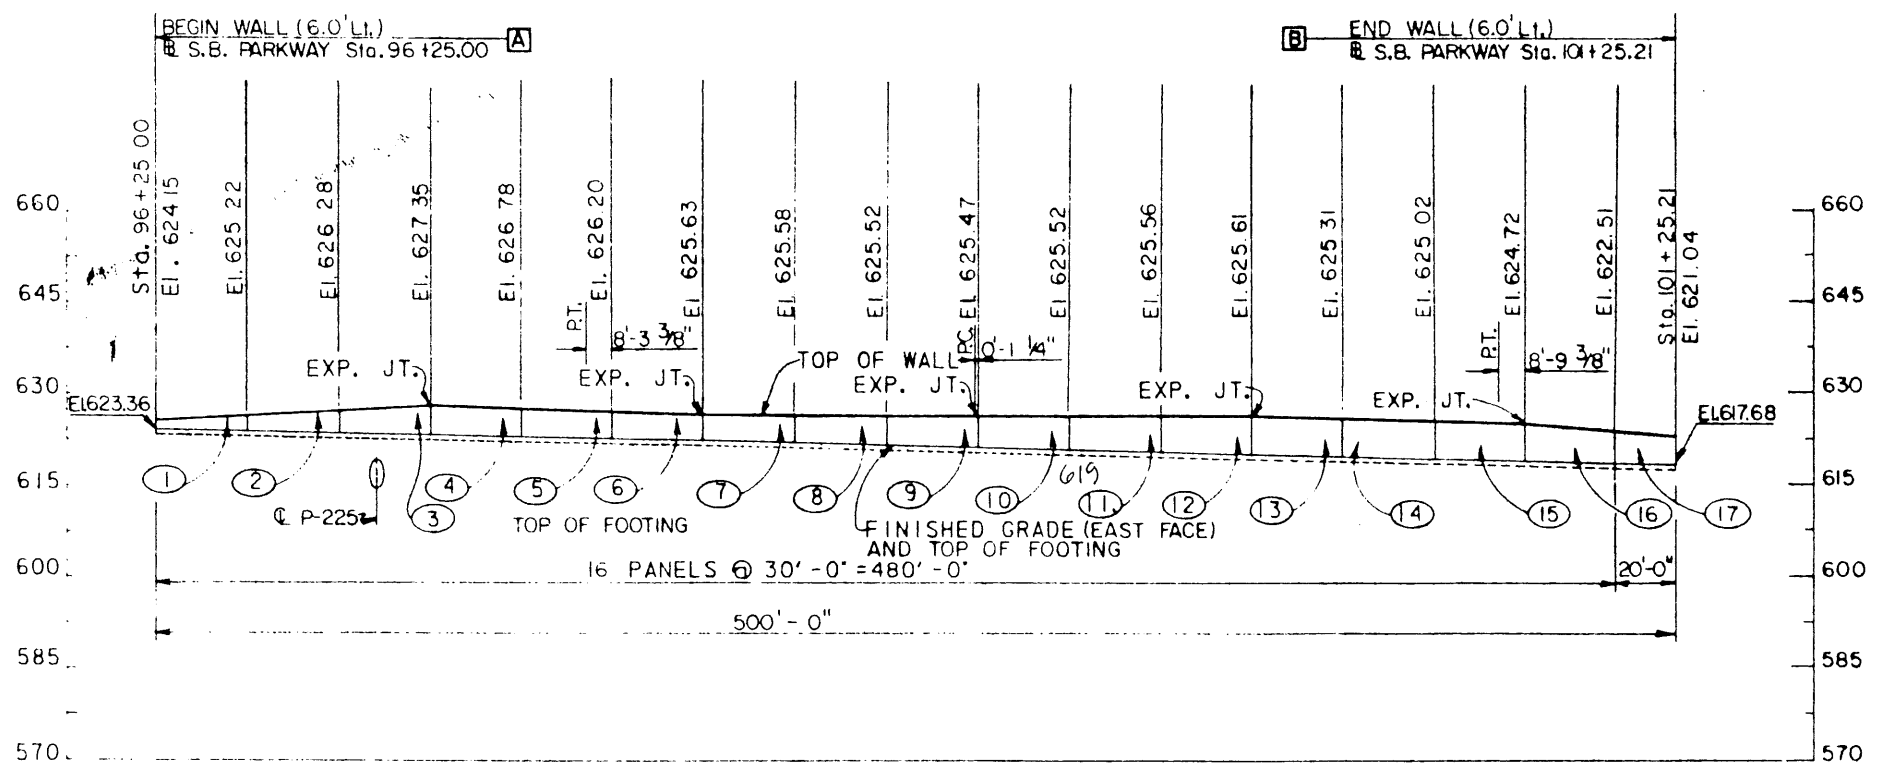

ESTIMATED QUANTITY SUMMARY			
ITEM NO.	DESCRIPTION	UNIT	QUANTITY
423	RETAINING WALL (C.I.P.)	S.F.	2448

WALL NO. W-104

NO.	REVISION	BY	DATE
TEXAS TURNPIKE AUTHORITY DALLAS NORTH TOLLWAY			
S.B. DALLAS PARKWAY RETAINING WALLS PLAN AND ELEVATIONS			
Turner Collier & Braden Inc. <small>Consulting Engineers</small>			SECTION VI
DRAWN R.G.D.	DATE 8-83	CHECKED T.J.R.	DATE 7-83
CONTRACT NO.: DNT-114		SHEET S-78 OF S-82	