

INDEX OF SHEETS
WATER & SANITARY SEWER RELOCATIONS

SHEET NO.	TITLE
1	Cover Sheet
2	Paving Sta 570+00 to Sta 585+00
3	Paving Sta 585+00 to Sta 599+00
4	Paving Sta 599+00 to Sta 613+00
5	Paving Sta 613+00 to Sta 627+00
6	Paving Sta 627+00 to Sta 640+00
APPURTENANCE SHEETS	
414 D-1 A	Sanitary Sewers
414 D-1	Sanitary Sewer Manholes
414 D-15	Thrust Blocks for Pipe Bends & Tees & Plugs
414 D-29	Advance of Paving - Water - & Sanitary Sewer Appurtenances
414 D-30	Water Service Installations and Methods for Setting Fire Hydrants

TEXAS TURNPIKE AUTHORITY

TOWN OF ADDISON

CONTRACT NO. DNT - 49U


UTILITY ADJUSTMENTS
AND RELOCATIONS

SECTION VI

GENERAL NOTES

- All fire hydrant installations shall be with 6" SDR-14-PVC Pipe and conform to 414 D-30, except as noted.
- Contractor shall install sanitary sewer laterals as per 414 D-29 Laterals shall be the same material as the sewer main.
- All sanitary sewer manholes to be abandoned shall conform to 414 D-29. The cover is to be disposed of as directed by the Texas Turnpike Authority.
- Contractor shall install proposed manholes to conform to 414 D-29.
- Contractor shall install proposed valve covers at existing grade or as directed by Town of Addison inspector.
- Contractor shall be responsible for water meter relocations. Cost to be subsidiary to water services.

DALLAS NORTH TOLLWAY

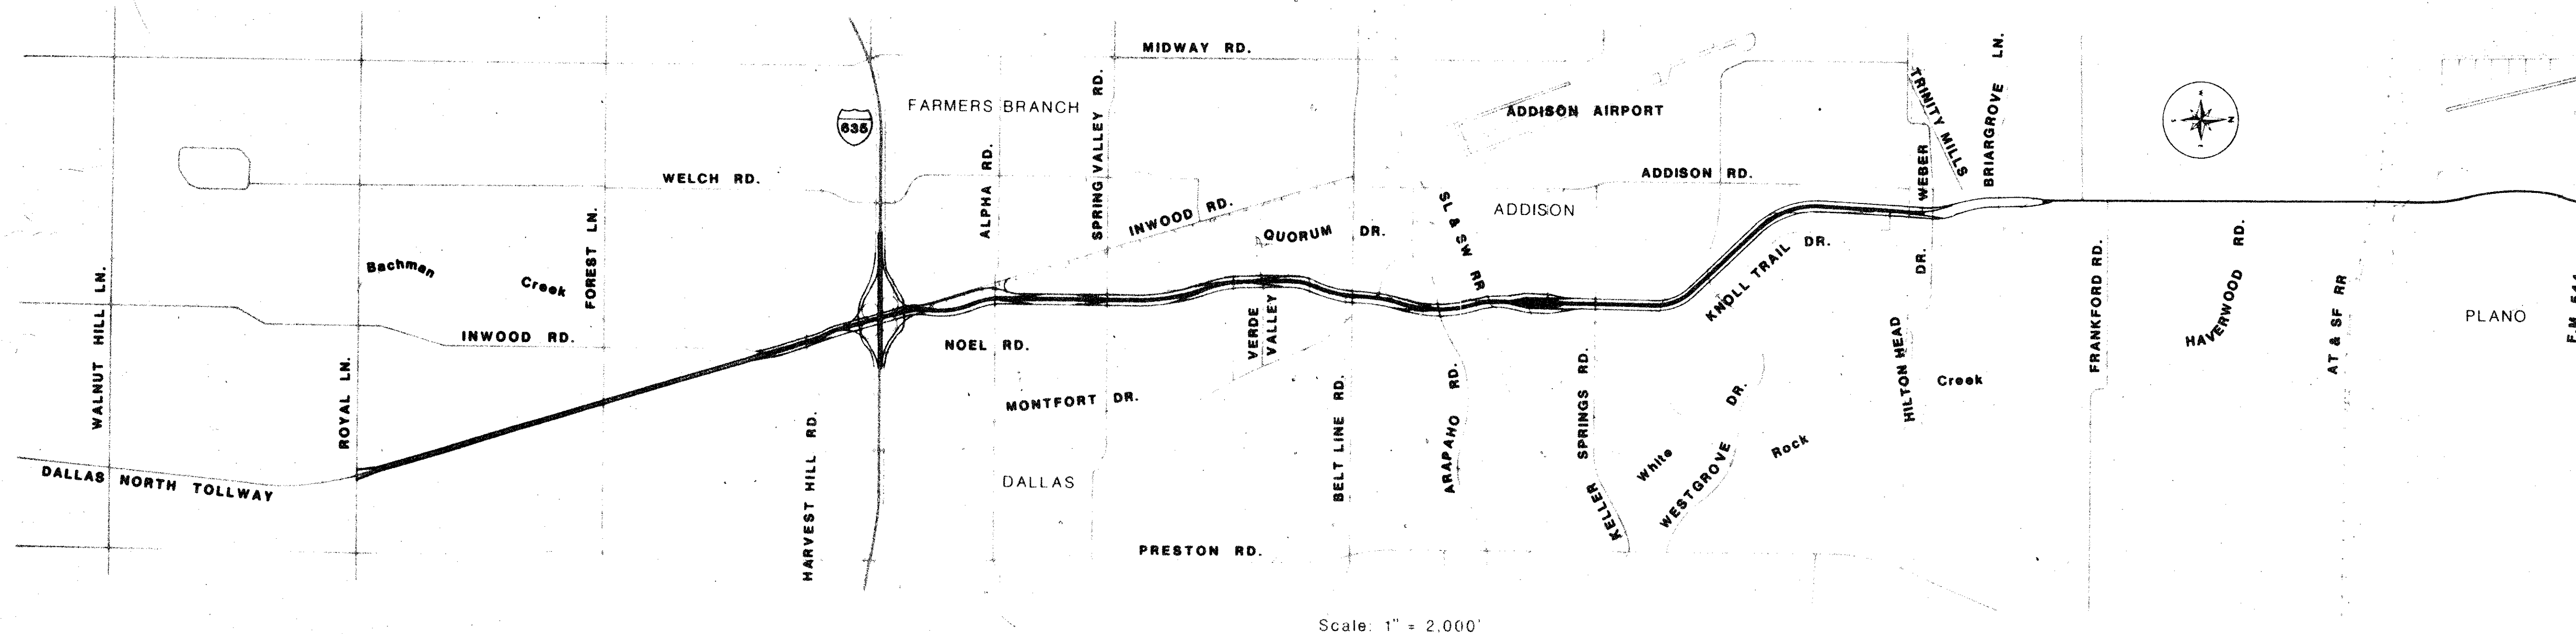

Approved By:
TOWN OF ADDISON

[Signature]
Mayor
Date: 3/23/84

Prepared by:
TURNER, COLLIE & BRADEN, INC.

[Signature]
Date: 3-23-84

Recommended by:
HOWARD, NEEDLES, TAMMEN & BERGENDOFF

[Signature]
Engineer in Charge
Date: March, 29, 1984

Recommended by:
TEXAS TURNPIKE AUTHORITY

[Signature]
Director, Engineering & Maintenance
Date: March 31, 1984

Approved by:
TEXAS TURNPIKE AUTHORITY

[Signature]
Engineer Manager
Date: 4-4-84

