




STANDARD WATER MAIN LOWERING

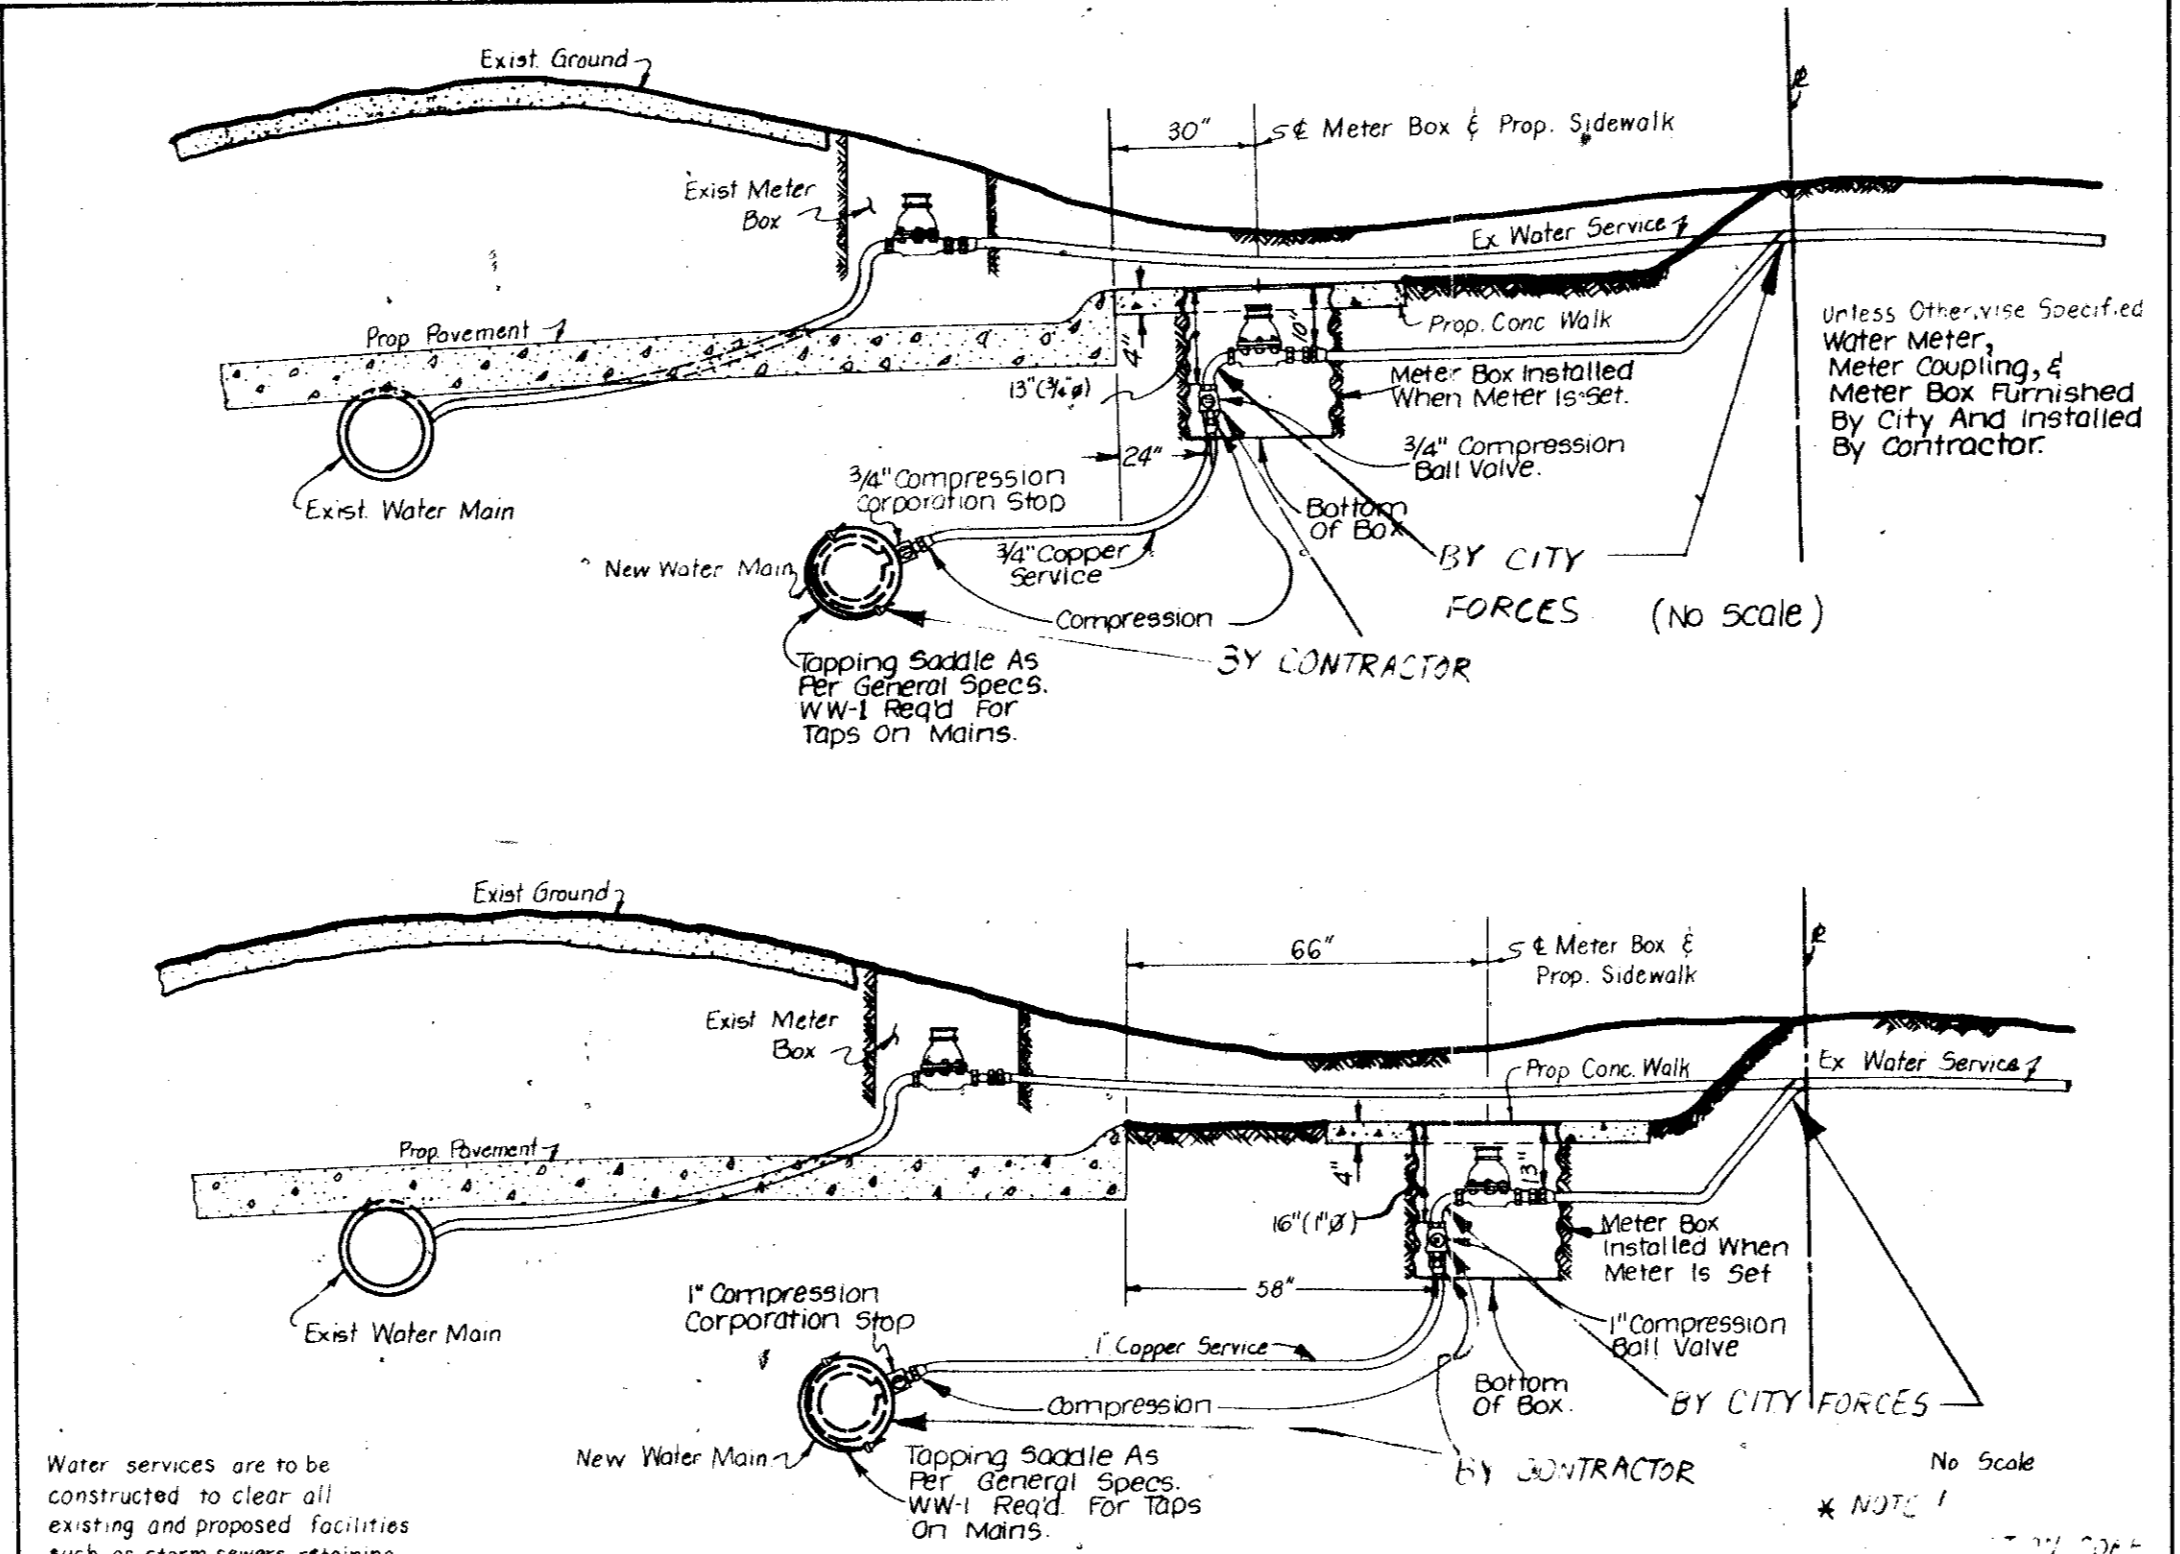


3/4" & 1" WATER SERVICE REPLACEMENT

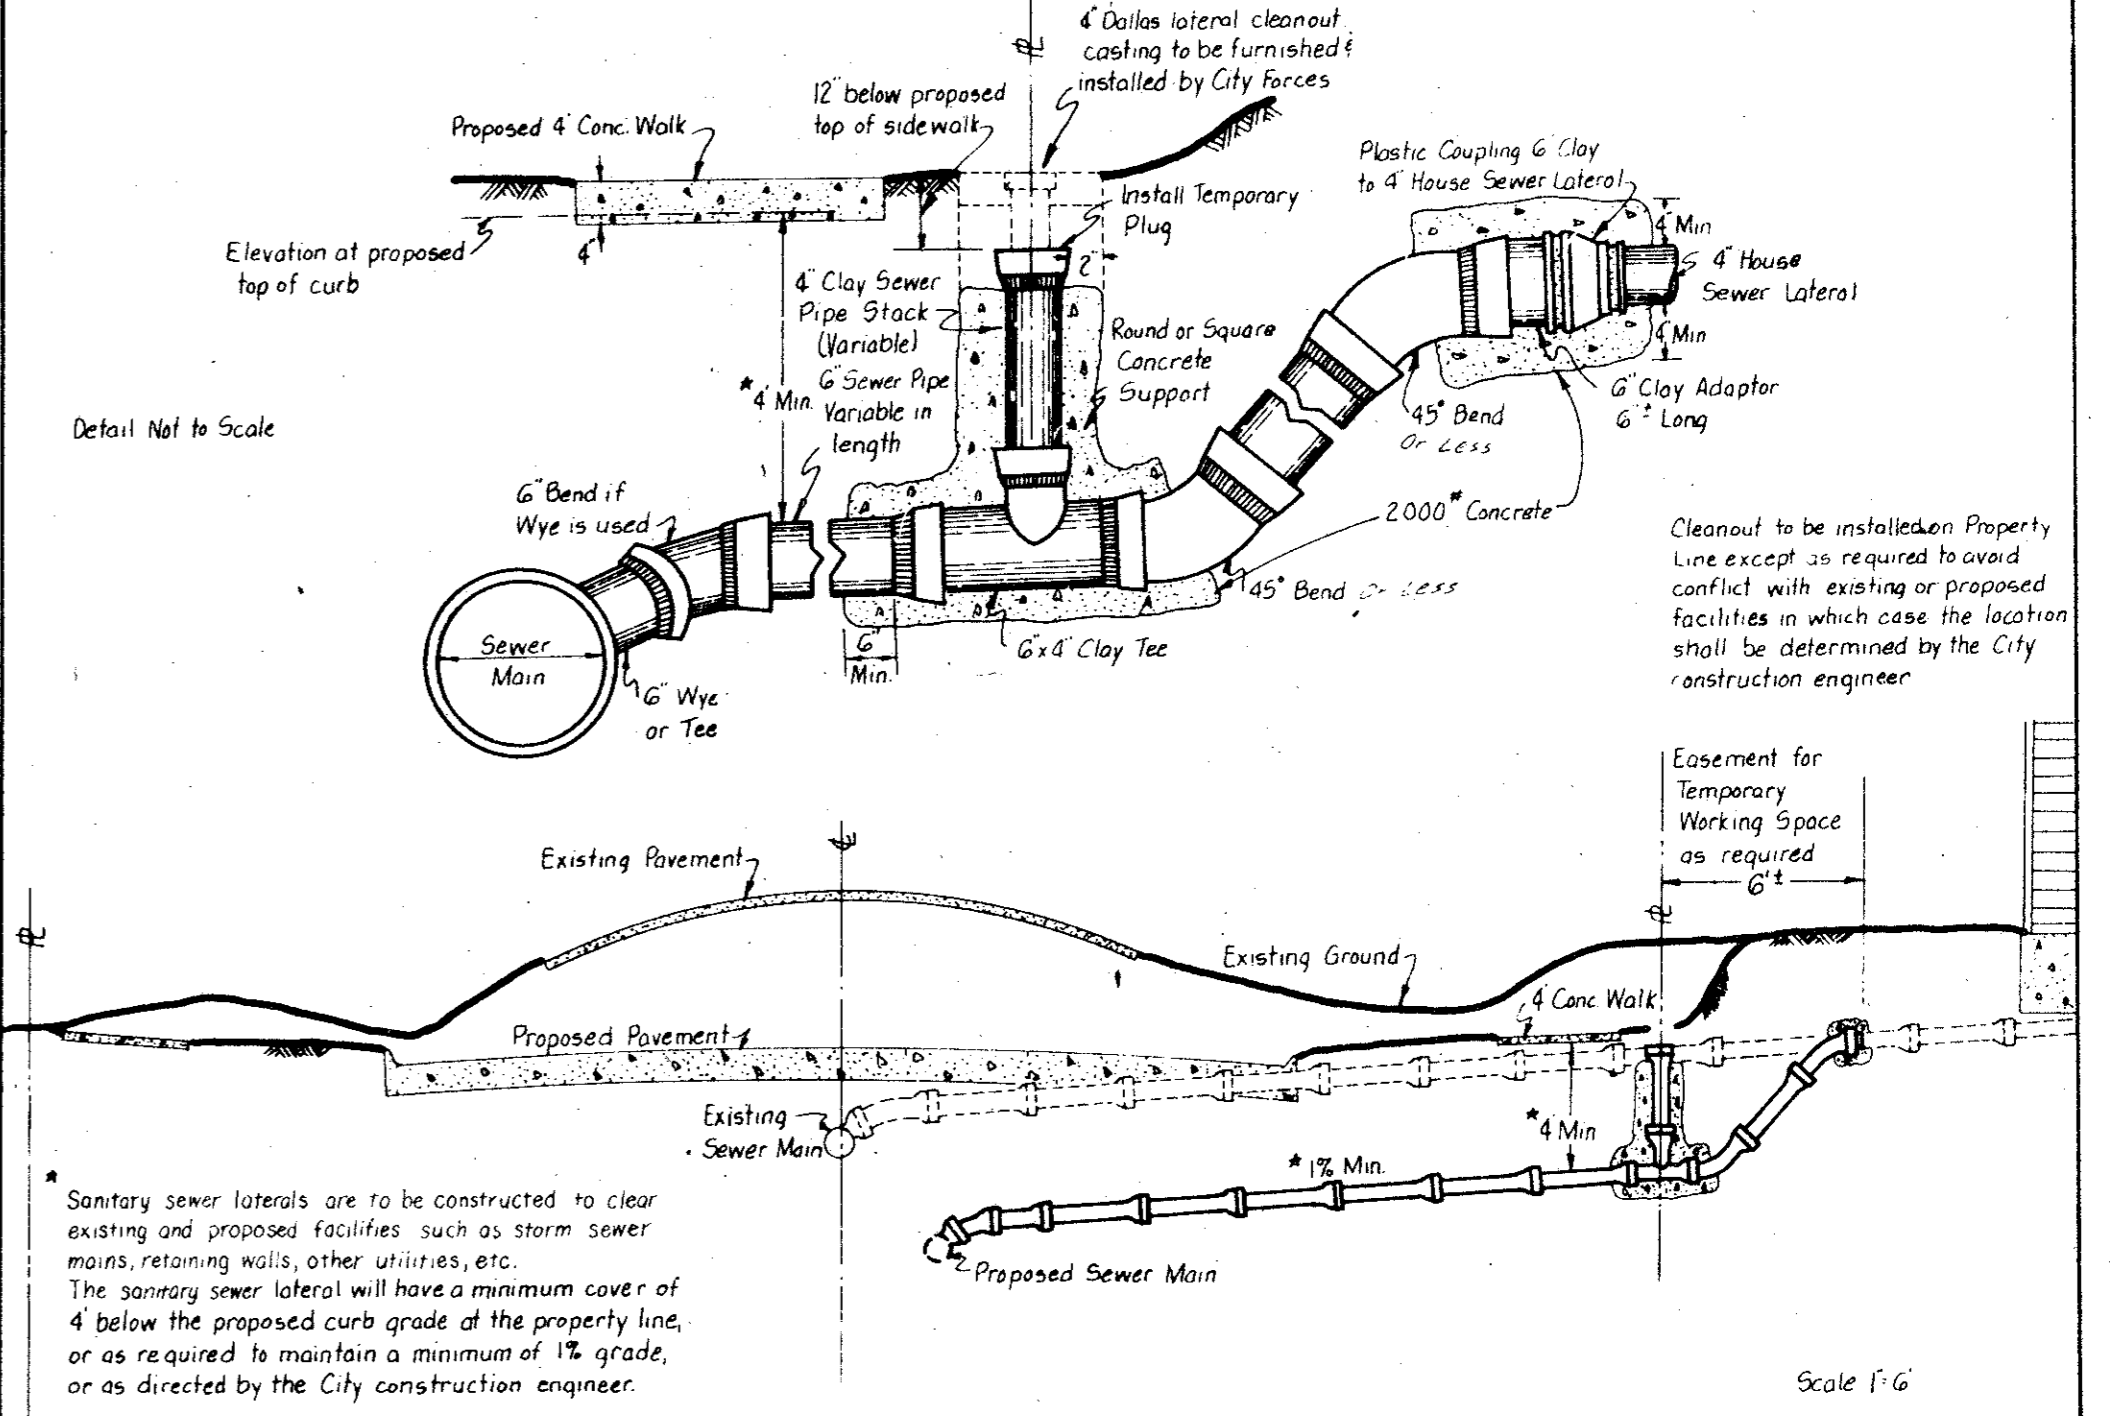


SANITARY SEWER LATERAL REPLACEMENT

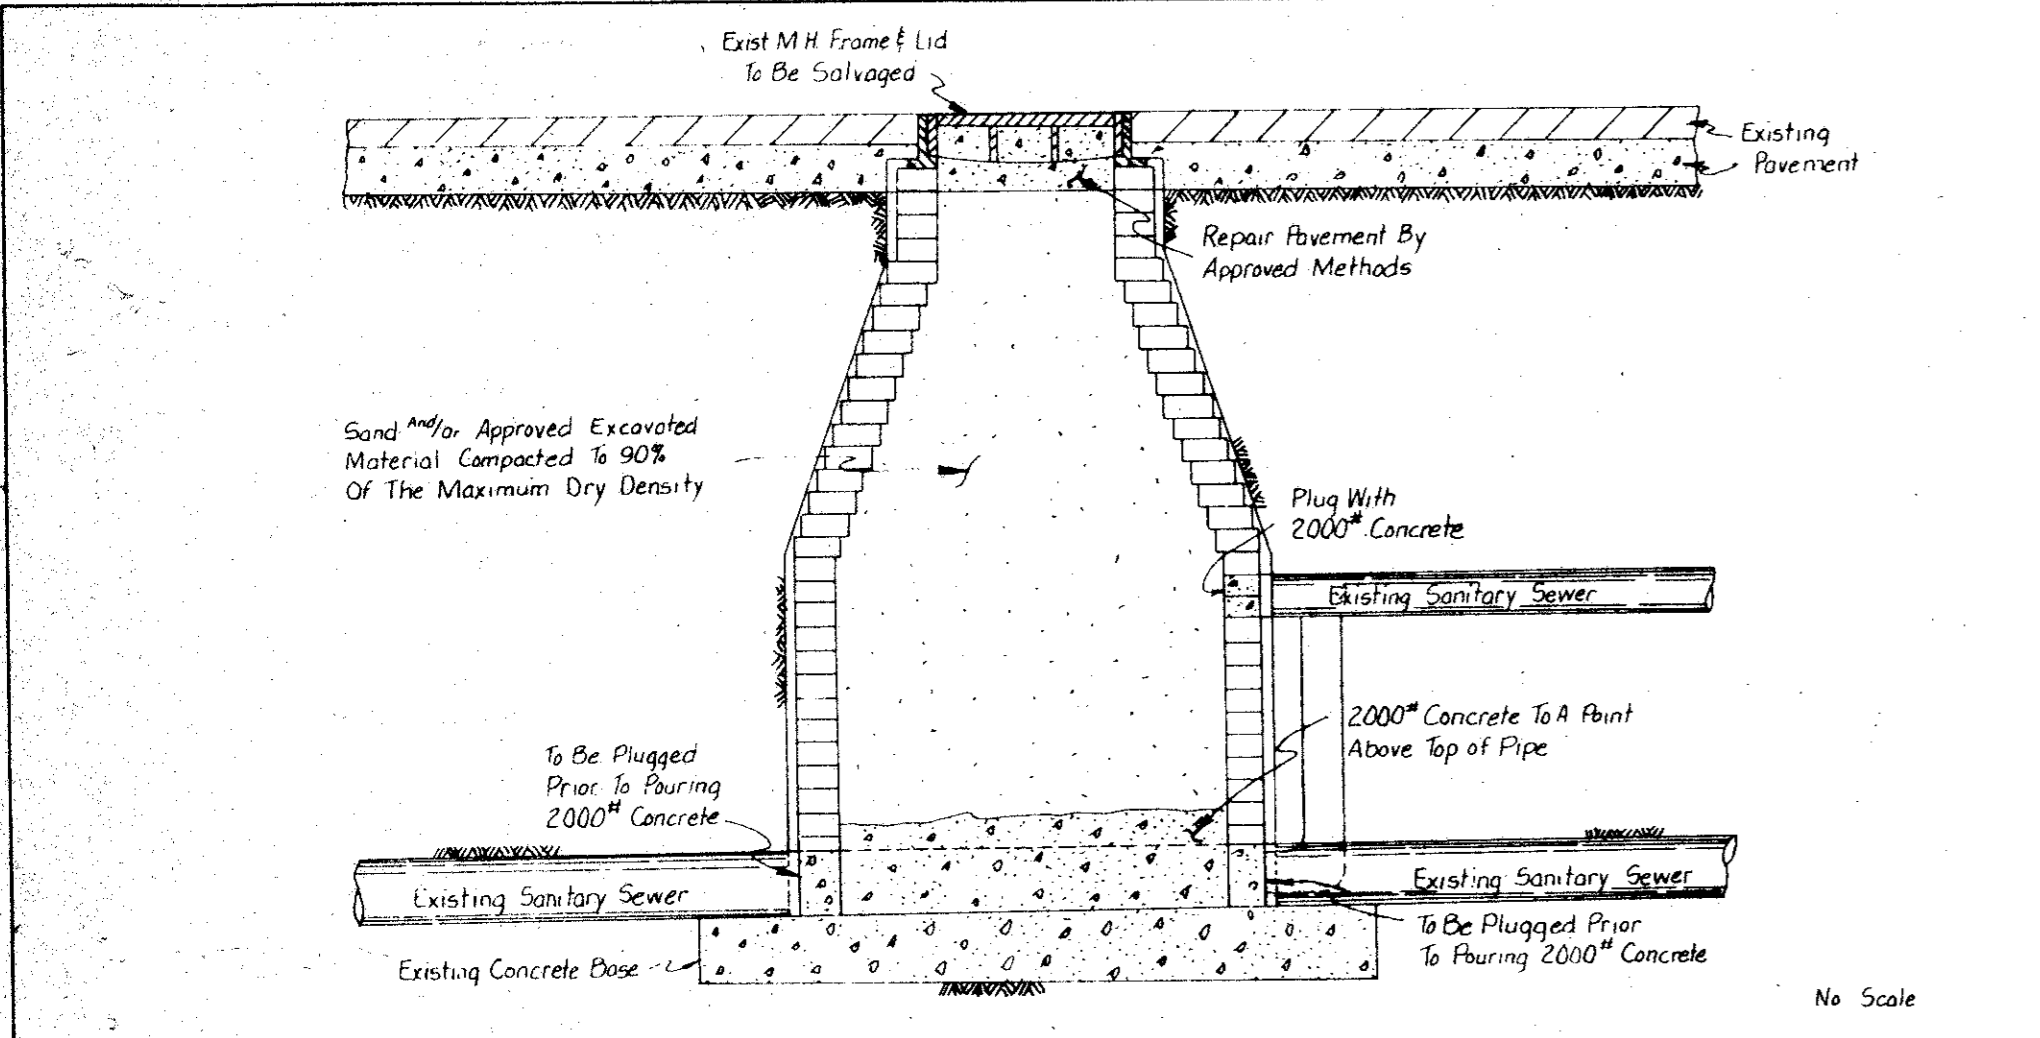


ABANDONMENT OF EXISTING MANHOLE

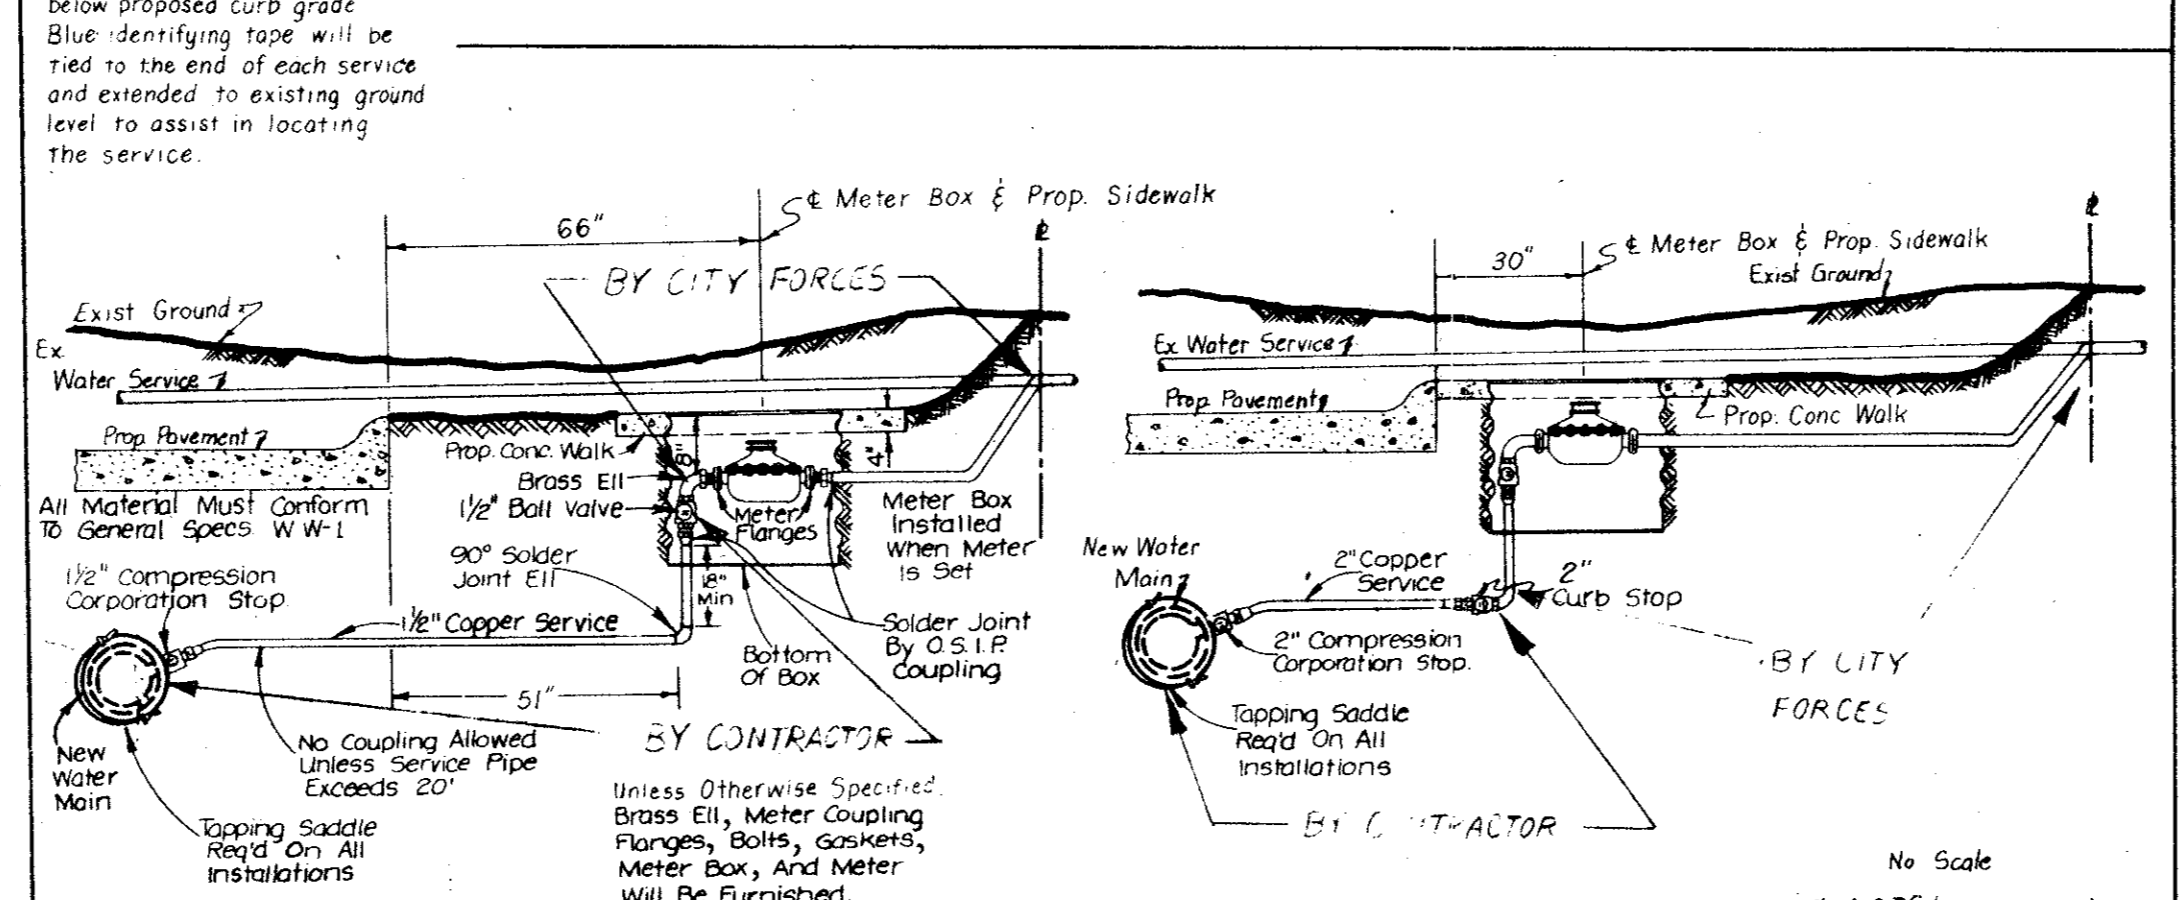


1 1/2" & 2" WATER SERVICE REPLACEMENT

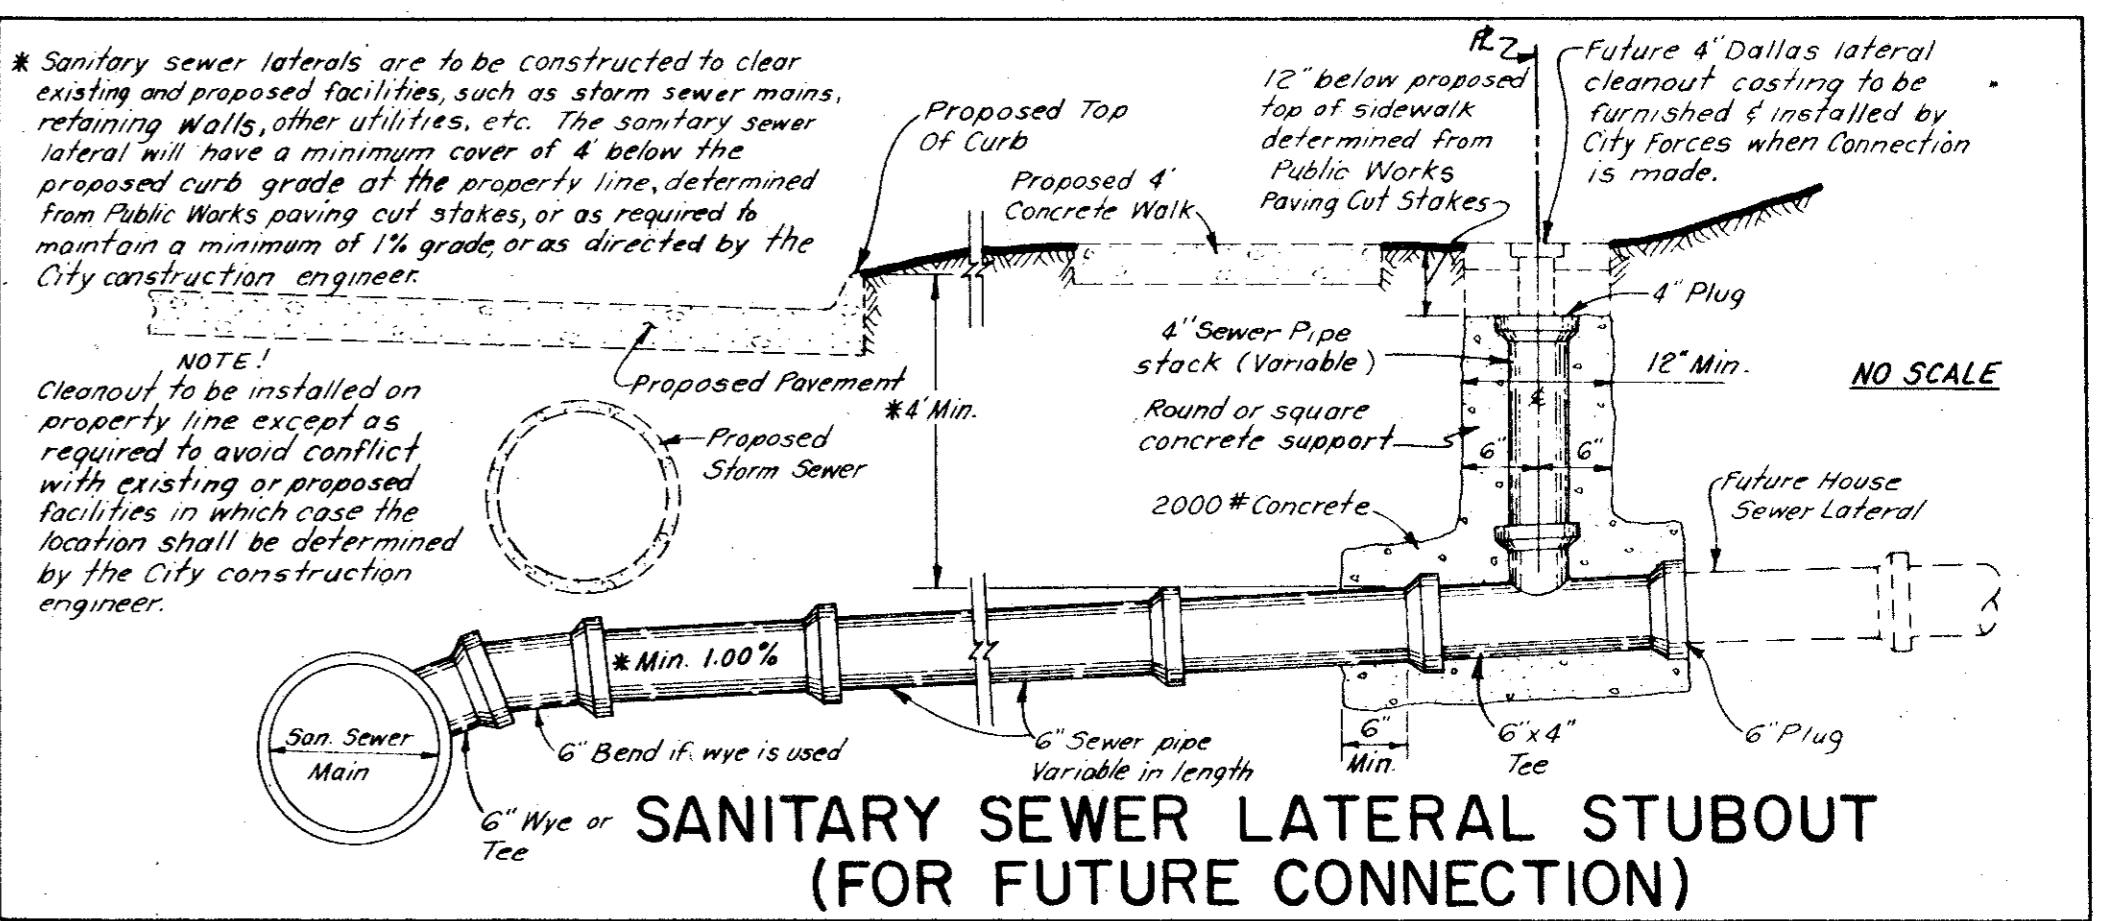

SANITARY SEWER LATERAL STUBOUT (FOR FUTURE CONNECTION)

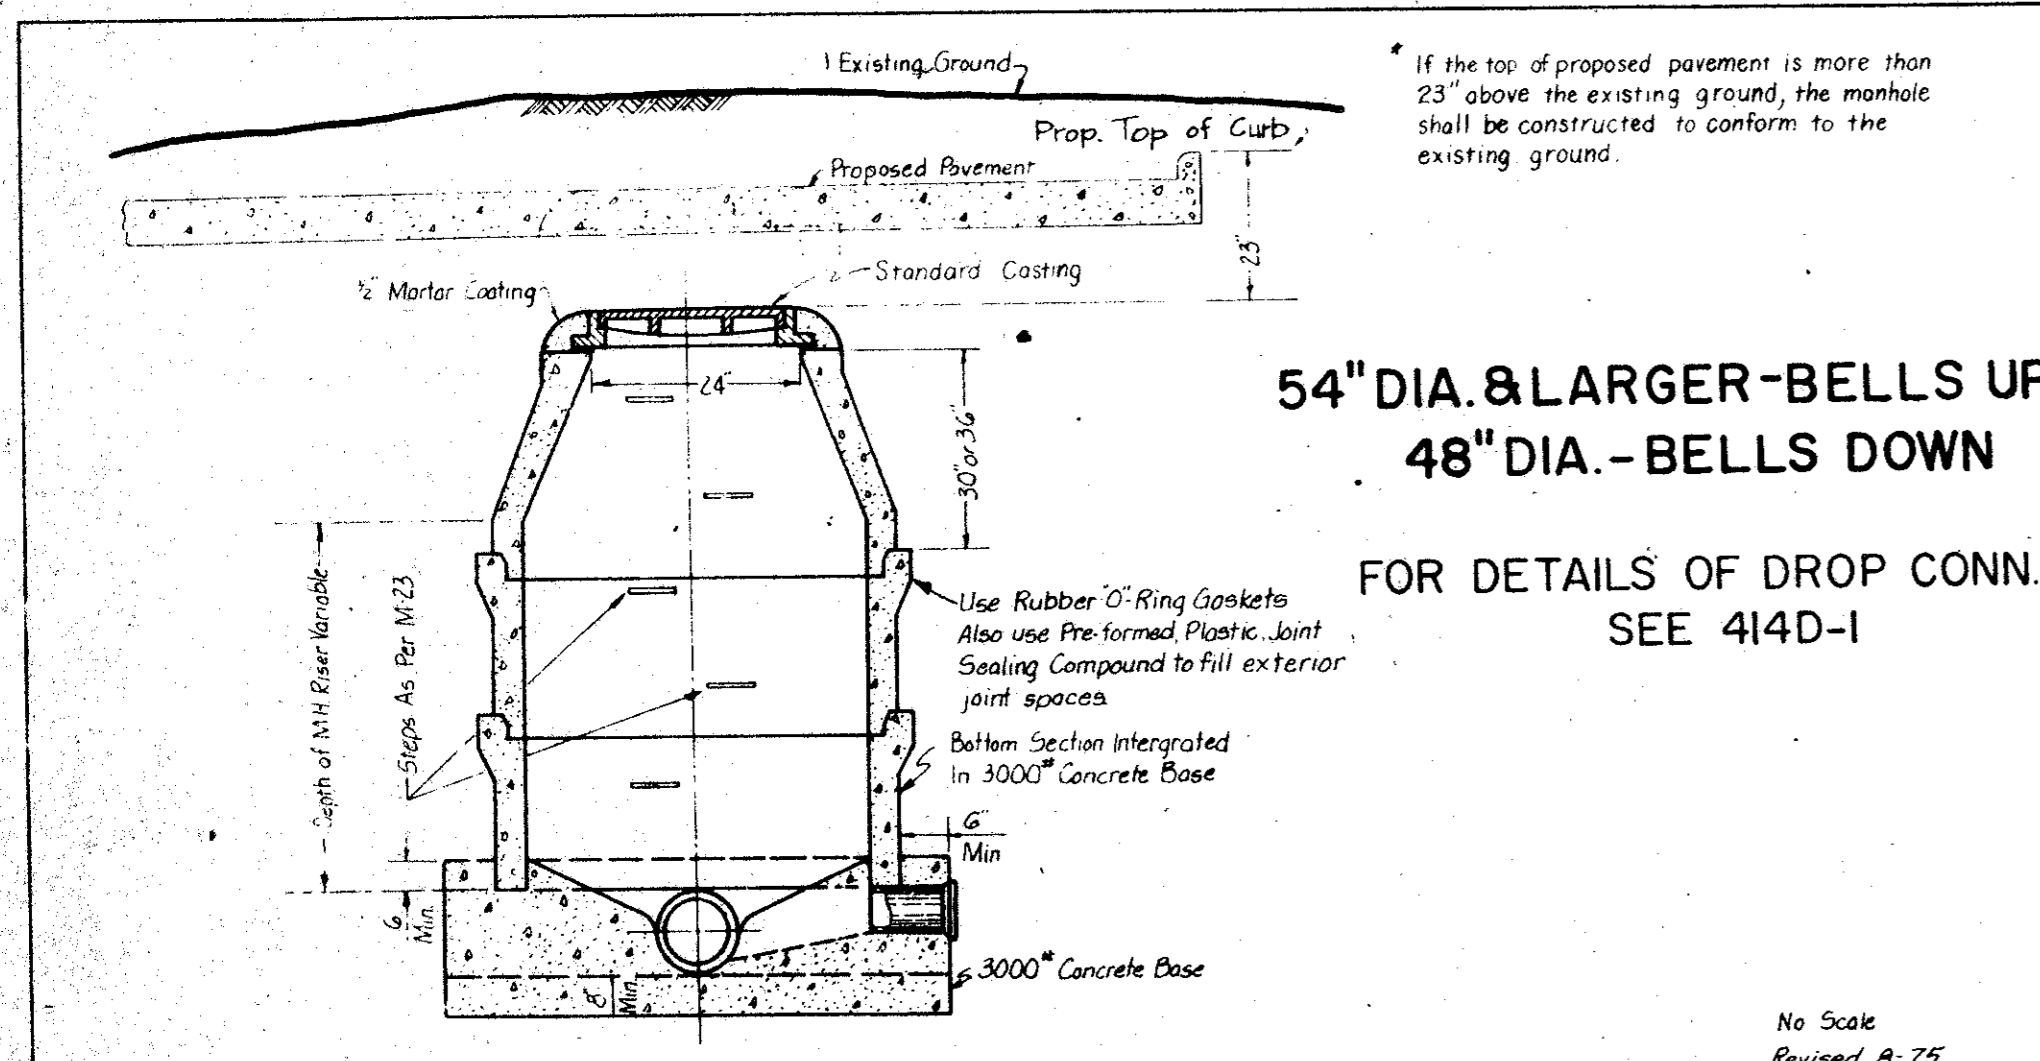

MANHOLE CONSTRUCTION

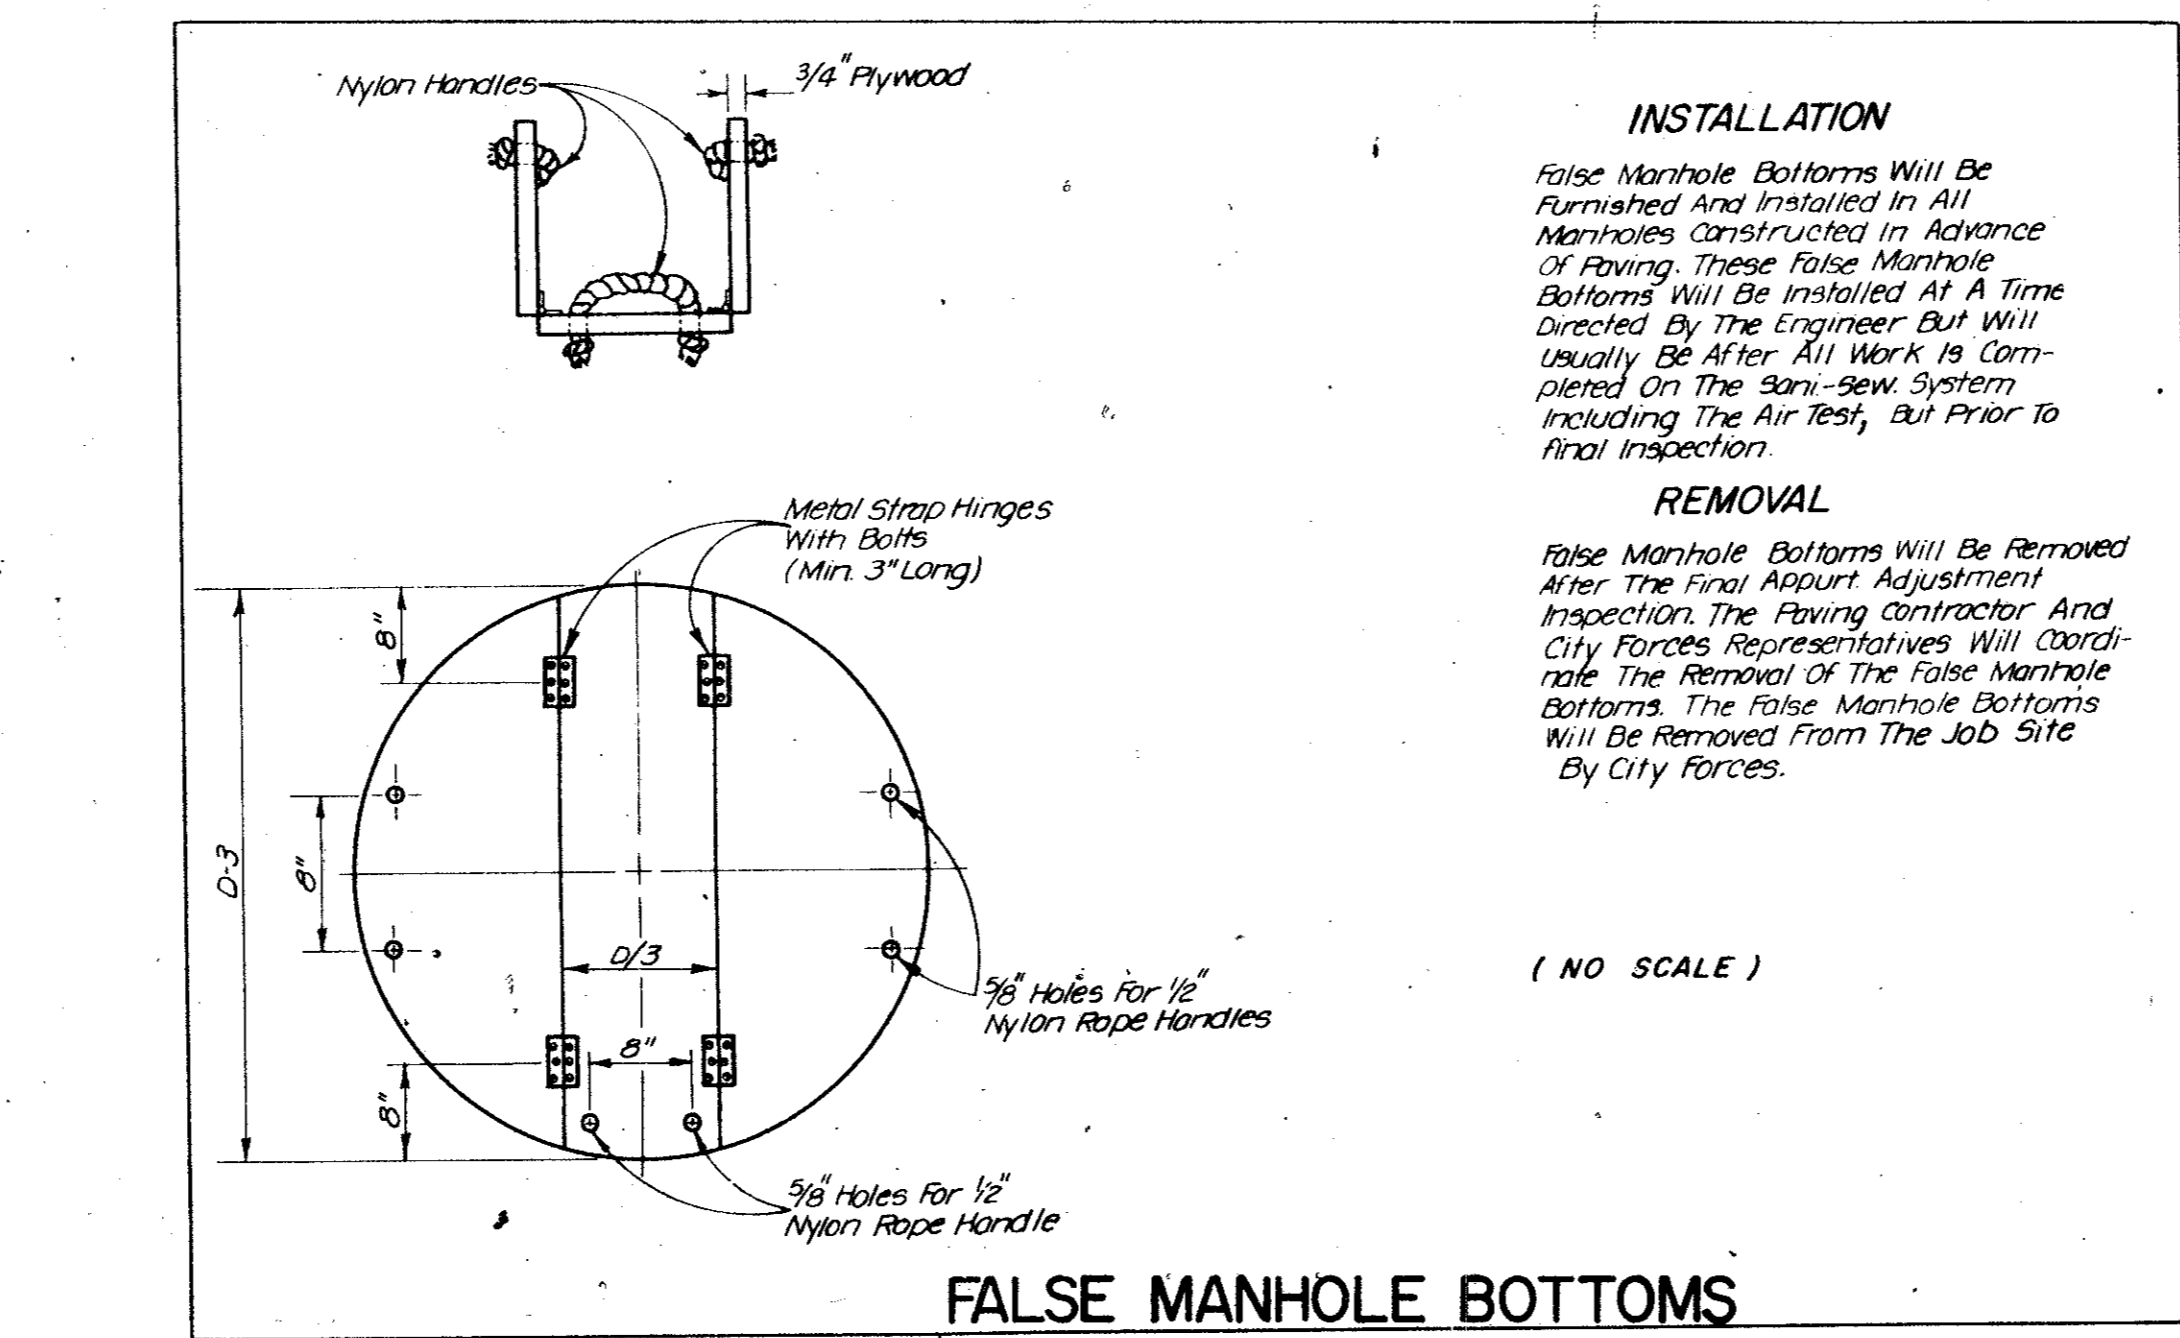

FALSE MANHOLE BOTTOMS

INSTALLATION
False Manhole Bottoms Will Be Furnished And Installed In All Manholes Constructed In Advance Of Paving. These False Manhole Bottoms Will Be Installed At A Time Directed By The Engineer. But Will Usually Be After All Work Is Completed On The San-Sew System Including The Air Test, But Prior To Final Inspection.

REMOVAL
False Manhole Bottoms Will Be Removed After The Final Adjusted Inspection. The Paving Contractor And City Forces Representatives Will Coordinate The Removal Of The False Manhole Bottoms. The False Manhole Bottoms Will Be Removed From The Job Site By City Forces.

LATEST REVISION: *John A. Chalmers* DATE: 4-23-81

ADVANCE OF PAVING						
WATER & SANITARY SEWER						
APPURTENANCES						
DALLAS WATER UTILITIES DEPARTMENT						
CITY OF DALLAS, TEXAS						
DESIGN	DRAWN	DATE	SCALE	NOTES	FILE	NO.
Bouse Cowgill	Geartner	JUNE 1974	As Noted	None	414D	29