

Scale: 1" = 30'

GENERAL NOTES

All Water Mains shall be PVC SDR-18 Water Pipe (blue hatched with wire tracers), except to be fire insulated copper.


All Water Mains shall have minimum cover below finished grades as follows:
 6" & 8" - 48" or as required to clear other utilities.
 Sanitary Sewer laterals to existing Sanitary Sewer Main shall be installed by contractor.

All trench backfill for utilities shall be compacted as required by city, but in no case shall the top 12" be compacted to less than 90% MVD density with the remainder of the ditch being compacted to that of adjoining soil conditions.

All fire hydrants to be set 3' to 6' from curb.

Note:
 Locations of proposed utilities are as per
 ALPHATEC Engineers - Washington, DC

Branch Mark: cut on top of sheet 200' South of N.E. prop. cor.
 ELEV. 653.50
 S.W. corner of cont. site or West Side
 ELEV. 633.95

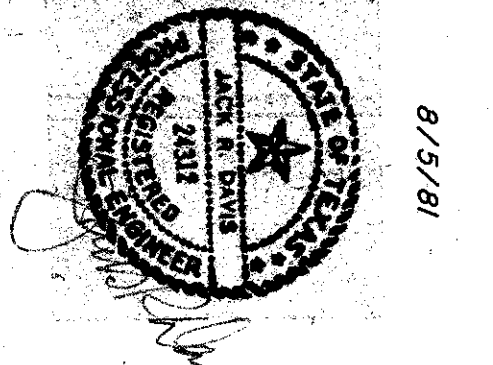

BROCKETTE DAVIS / DRAKE, INC.
 CONSULTING ENGINEERS
 5000 CALLEJA STREET
 DALLAS, TEXAS 75204

Project: Marriott QUORUM V788 ADDISON, TEXAS	Title: WATER & SEWER PLAN	Bogard Haldeman Miller, Inc. Architects and Planning Consultants 5710 L.B. & F.W. Suite 130 Dallas, Texas 75240 214-251-7232	Bogard Haldeman Miller	of sheets C4	Date: 8/4/01
					300 Number: