


- GENERAL NOTES**
1. Water pipe shall be PVC 18 Ring File Bell and spigot integral well as approved by AWWA. Sanitary sewer pipe shall be PVC SDR 35.
  2. Fire hydrants shall be Mueller Contour located 3 feet back of curb or 3 feet off property line.
  3. Gate valves shall be Mueller or Grow.
  4. A No. 12 copper clad tracer wire shall be attached to valves and line.
  5. Water and sanitary sewer mains shall be embedded in sand for a minimum of 6 inches on all sides. If water is encountered, a gravel layer a minimum of 4 inches deep shall be placed in the bottom of trench.
  6. Construction shall conform to city of Addison Standard and Specifications.
  7. Engineering Department is to be notified prior to construction.
  8. The Contractor shall protect existing utilities during the construction of this project.
  9. All manholes to be poured in place.
  10. See Sheet M-1 for extensions of Water & Sewer Services.

**SHEPHERD + BOYD**  
 ARCHITECTS/PLANNERS & INTERIORS  
 1000 DOWLING BUILDING  
 DALLAS, TEXAS 75226  
 TELEPHONE 214/691-9000

**GRADING, DRAINAGE & UTILITY PLAN**  
 RAYMOND L. GOODSON, JR., INC. CONSULTING ENGINEERS  
 3408 OAK GROVE • DALLAS, TEXAS 75204 AIG 214/828-2200  
 Scale: 1" = 30'

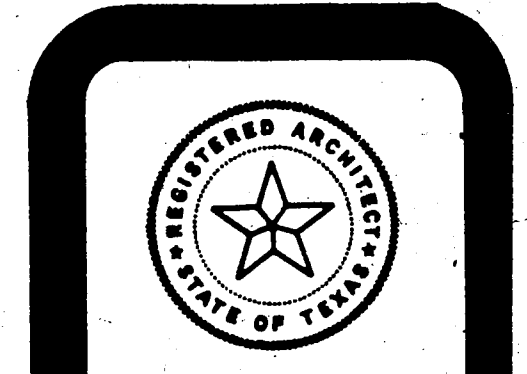

NO.	DATE	REVISIONS
1	2-27-81	
2	3-13-81	
3	3-23-81	
4	5-15-81	5-29-81
5	6-2-81	

**SHEET**  
 102

This PLAN RECEIVED & APPROVED  
 LETTER DATED 6-2-81

