


SIDEWALK MARKINGS SHALL BE GROOVED $\frac{3}{8}$ " DEEP ON 5' CENTERS FOR 5' WIDE WALK, AND LINE UP WITH STREET JOINTS WHERE APPLICABLE.

$\frac{1}{2}$ " EXPANSION JOINTS SHALL BE SPACED AT MAX. 40' INTERVALS AND LINE UP WITH STREET EXPANSION JOINTS OR AS OTHERWISE SPECIFIED AND JOINTS SHALL BE FILLED WITH PRE MOLDED BITUMINOUS EXPANSION JOINT FILLER.

NOTE:
 CONCRETE TO HAVE MINIMUM 4000 PSI COMPRESSIVE STRENGTH AT 28 DAYS AND MINIMUM CEMENT CONTENT OF 5 SACKS PER CUBIC YARD OF CONCRETE.


REINFORCED CONCRETE SIDEWALK - PLAN VIEW

NOT TO SCALE

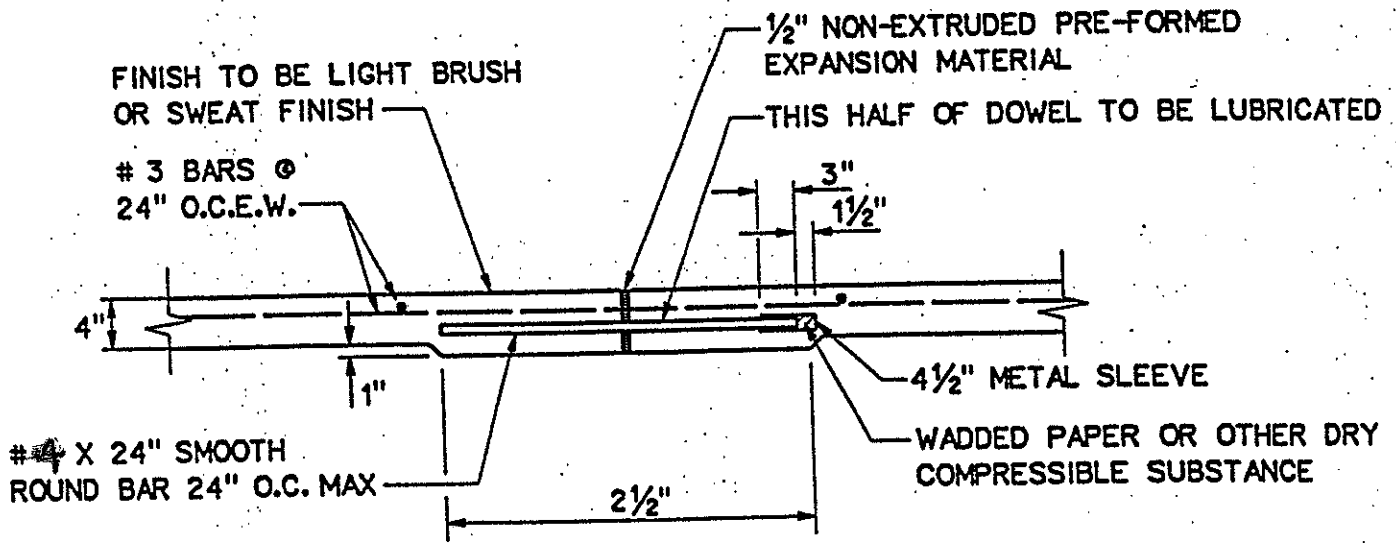

SECTION E-E EXPANSION JOINT DETAIL

NOT TO SCALE

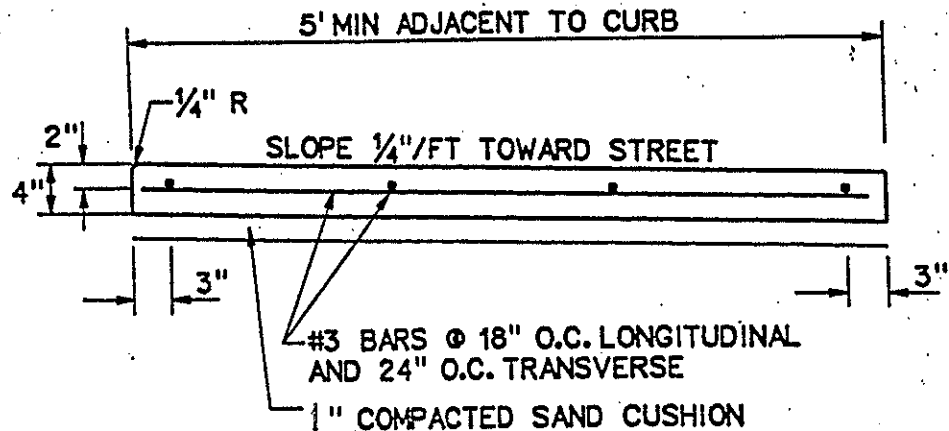

SECTION D-D TYPICAL SECTION