
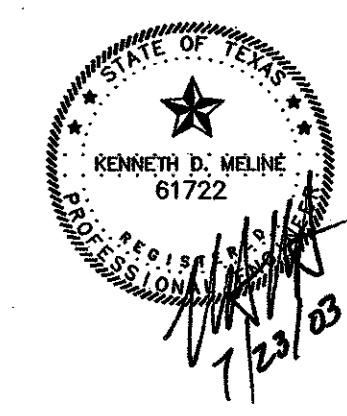


**01 LEVEL P-1 PARTIAL PLAN - CONDENSER WATER LOOP - PHASE B**  
 SCALE: 1/8" = 1'-0"

- GENERAL PHASING NOTE(S):**
- 1.) INSTALL NEW 4" OVERHEAD CONDENSER PIPING UP TO EXISTING 6" CS & CR AT CL42/AS.
  - 2.) INSTALL TEMPORARY AC UNITS.
  - 3.) VALVE CRAC P1A-2 SO IT IS SERVED BY THE EXISTING 4" CS & CR UF.
  - 4.) CONNECT NEW CONDENSER PIPING INTO EXISTING 6" CS & CR ABOVE CEILING. THE EXISTING 6" CS & CR UF IS NOW ABANDONED.

- KEYED NOTES BY SYMBOL "O"**
- 1) INSTALL VFD'S & BAS PANEL AS PART OF PHASE A.
  - 2) REFER TO M3.03 FOR RISER DIAGRAMS, THIS AREA.
  - 3) INSTALL NEW THERMOWELL WHILE SYSTEM IS RUNNING ON CITY WATER.
  - 4) FURR OUT AROUND 2 1/2" CS AND CR PIPING DROPS TO CRAC UNITS TO ENCLOSE PIPING FROM COMPUTER ROOM FLOOR TO CEILING LEVEL. PAINT TO MATCH EXISTING.
  - 5) PROVIDE (2) TWO 14" FLEX DUCTS FOR TEMPORARY S/A DISTRIBUTION FROM EACH TEMPORARY SPOT COOLER. REROUTE TEMPORARY S/A DUCTWORK AS REQUIRED FOR TEMPORARY CONDITIONING WHEN PERFORMING PIPING MODIFICATIONS TO INDIVIDUAL UNITS. ROUTE 26" CONDENSER FLEX DUCT TO ABOVE LAY-IN CEILING.
  - 6) PROVIDE 5 TON SPOT COOLER FOR TEMPORARY CONDITIONING EQUAL TO SPOT COOLERS MODEL 50 HU.
  - 7) 2 1/2" TAPS WITH 2 1/2" BALL VALVE AND CAP FOR FUTURE CRAC INSTALLATION.
  - 8) NEW DIFFERENTIAL PRESSURE TRANSMITTER.

**DFW Consulting Group, Inc.**  
 8410 Sterling  
 Irving, TX 75063  
 (972) 929-1199

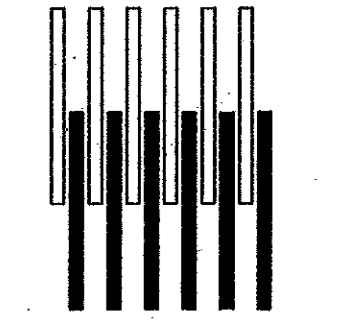

**Mary Kay, Inc.**  
 Corporate 1  
 Addison, Texas  
 Cooling Tower Addition

Project Revisions

Project Number  
 02110

Issue Date  
 JULY 23, 2003

Sheet Title  
**MECHANICAL**  
**PARTIAL PLAN**  
**PHASE B**  
 Sheet Number  
**M2.01B**