


R:\Projects\MARY KAY\Cooling Tower\from carol\MKCT-S-4.dwg, 08/06/2003 03:39:47 PM

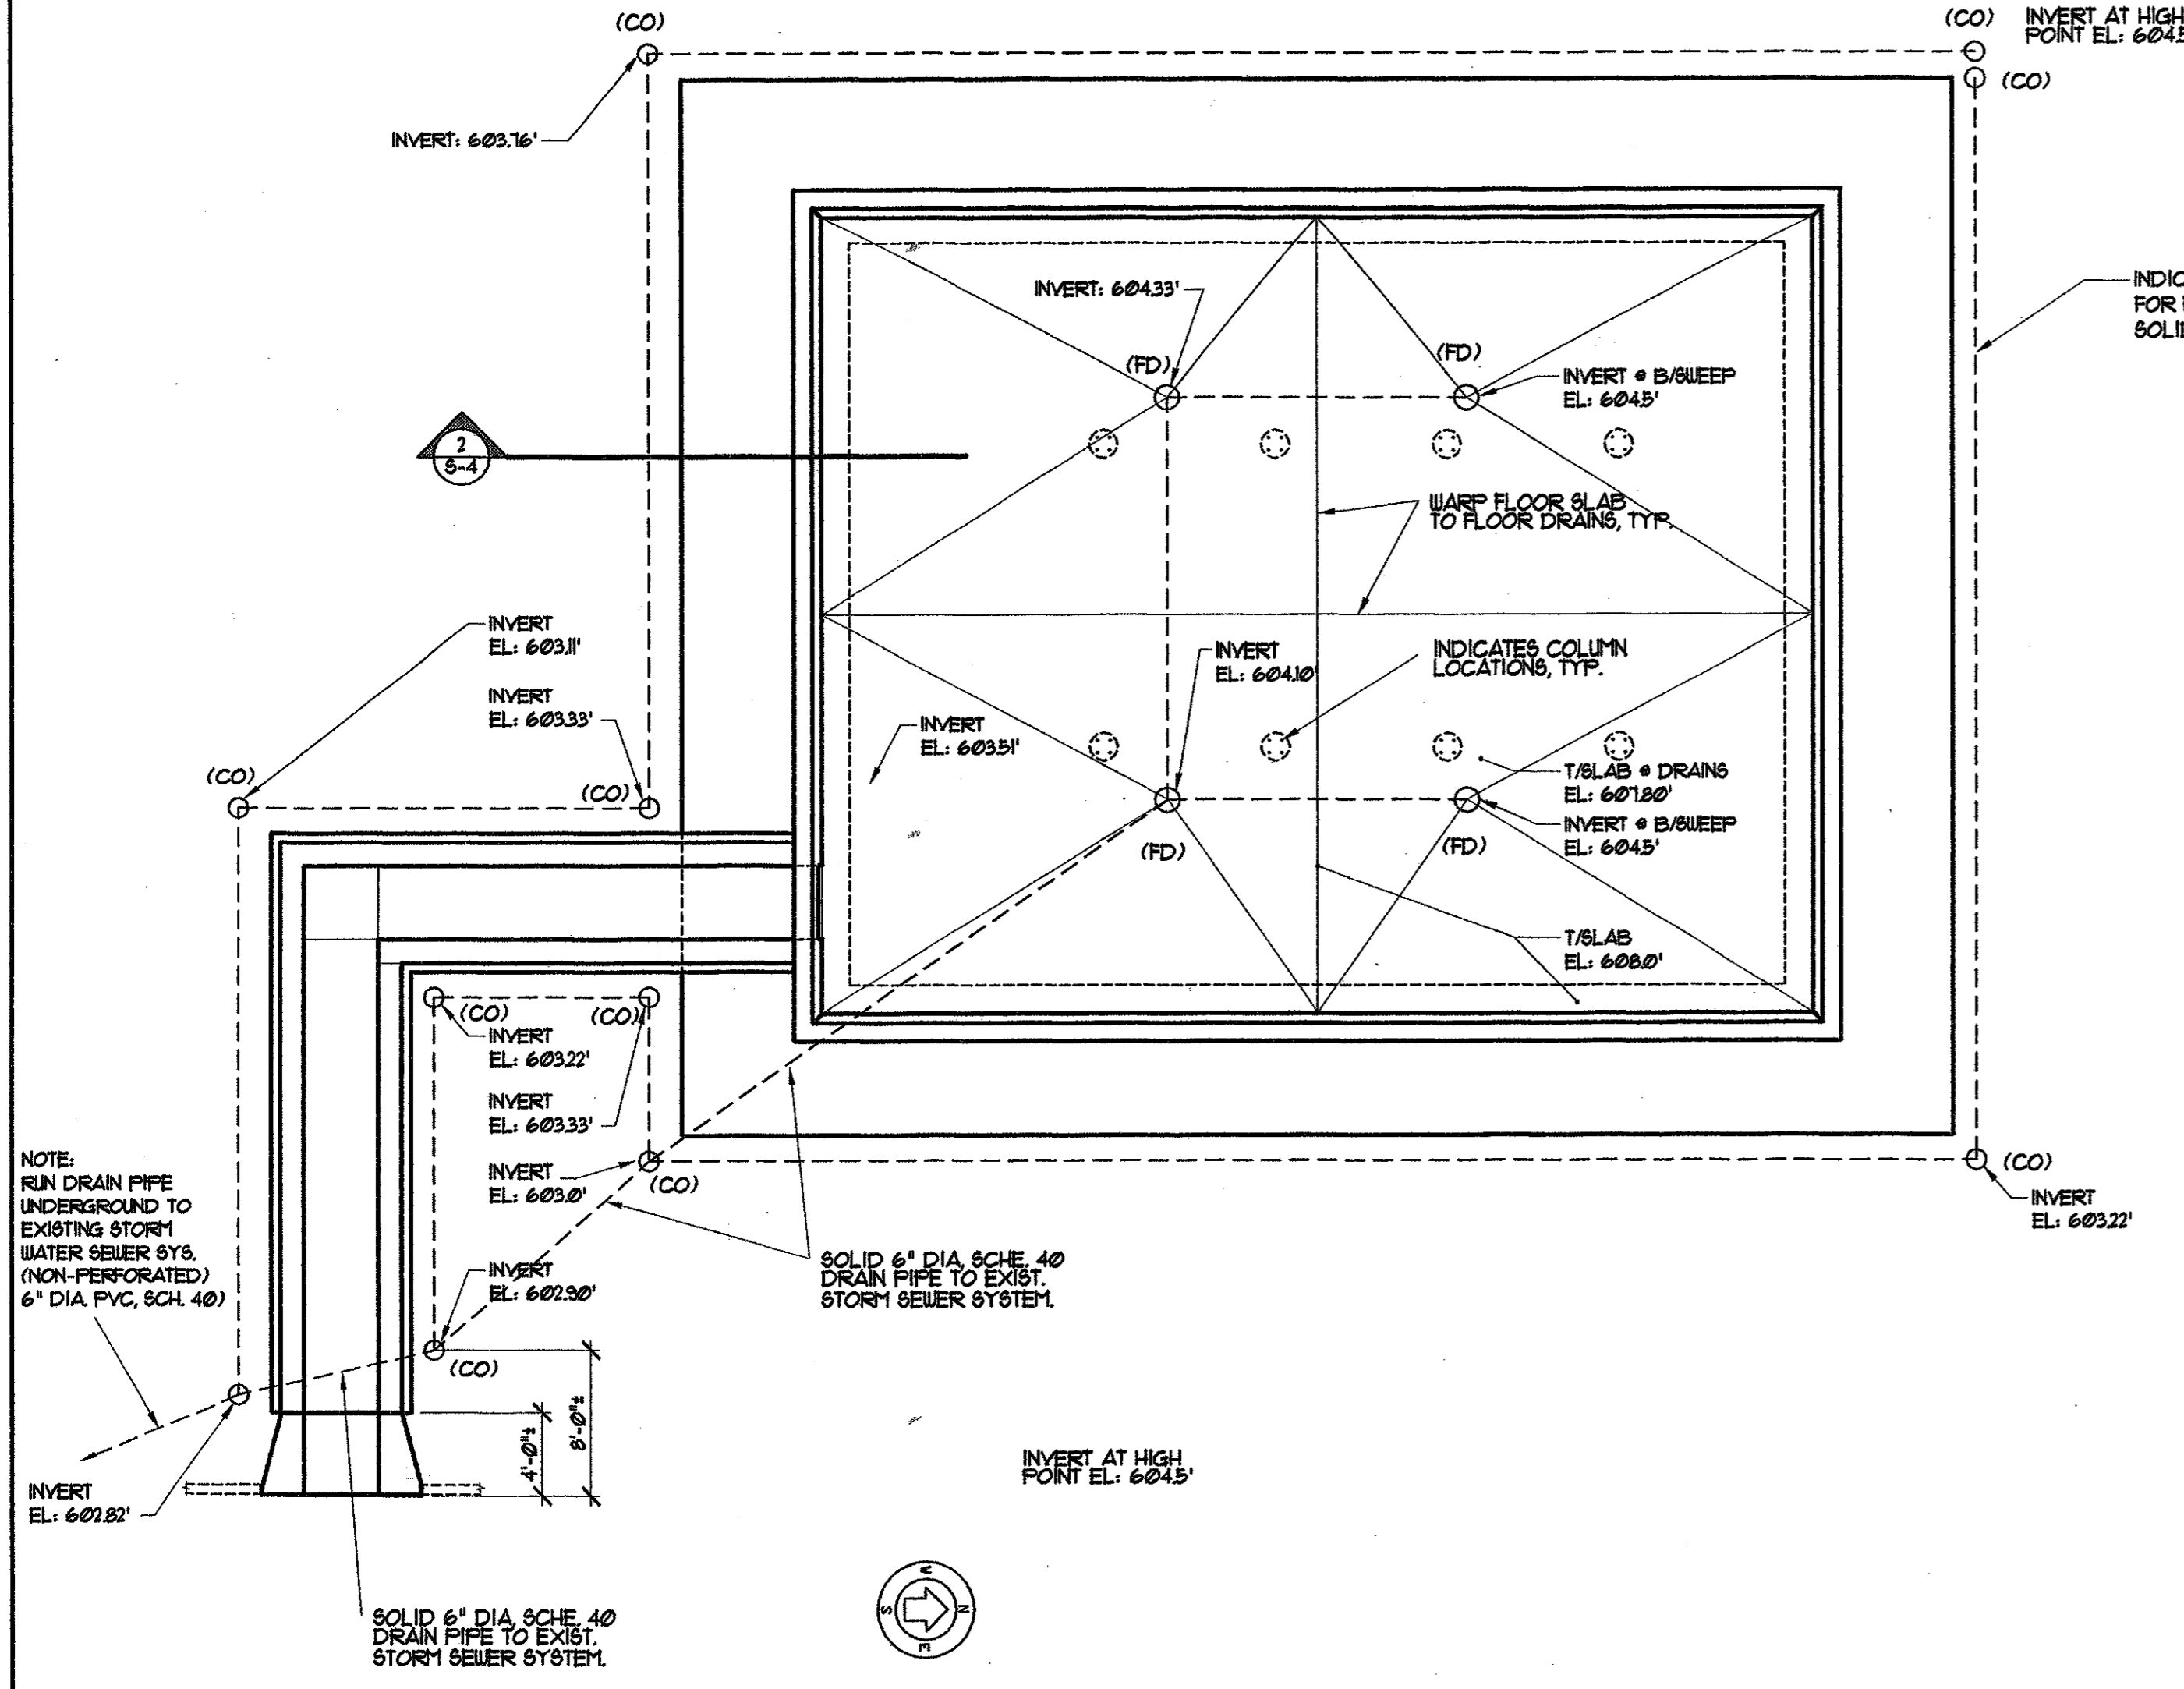

1 WATER PROOFING & DRAINAGE KEY PLAN
SCALE: 1/8" = 1'-0"

INDICATES DRAIN PIPE FOR FRENCH DRAIN SYSTEM. SOLID 6" DIA. SCHE. 40, TYP.

CONTINUOUS CAULK JOINT
PROVIDE A CONTINUOUS 12 GA. TERMINATION BAR AT THE TOP OF THE WATERPROOFING SYSTEM, TYP.

PROVIDE PENETRATING CONCRETE SEALER ON ALL CONCRETE EXPOSED TO WEATHER PER SPECIFICATIONS.

MIRADRI SHEET WALL WATERPROOFING MEMBRANE INSTALLED IN ACCORDANCE W/ MFG. INSTRUCTIONS

MIRADRAIN SHEET FRENCH DRAIN FABRIC INSTALLED IN ACCORDANCE W/ MFG. INSTRUCTIONS

COMPACTED CLAY FILL WITH A 5% SLOPE TO BED THE MIRADRAIN SHEET FABRIC

CONTINUOUS WATERSTOP, TYP. W/ CON'T 2 x 4 KEY, TYP.

MIRAFI FABRIC WRAP AROUND DRAIN PIPE AND SETTING BED INSTALLED IN ACCORDANCE W/ MFG. INSTRUCTIONS


GRANULAR FILL

6" PVC PERFORATED DRAIN PIPE W/ CLEAN CUTS PER PLAN SET ON 3" GRANULAR FILL LEVELING BED GRADED TO MAINTAIN A DOWNWARD FALL TO GRAVITY DRAIN TO ADJACENT CITY CURB AND GUTTER (SCHED. 40 PVC, TYP.)


PVC SHALL BE PERFORATED W/ 2 ROWS OF 1/2" DIA. HOLES SPACED AT 1'-0" O.C. AND PLACED 60 DEGREES APART FROM PIPE CENTER LINE.

2 SECTION @ RETAINING WALL
SCALE: 3/4" = 1'-0"

DFW Consulting Group, Inc.
8410 Sterling
Irving, TX 75063
(972) 929-1199

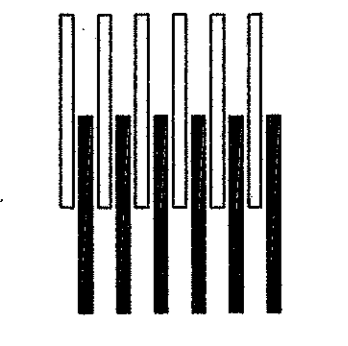

Structural Engineering
Architectural Engineering
8688 Northwest Plaza Drive
Suite 214
Dallas, Texas 75225
214-373-0164
214-373-0170 Fax
reedyrf@swbell.net

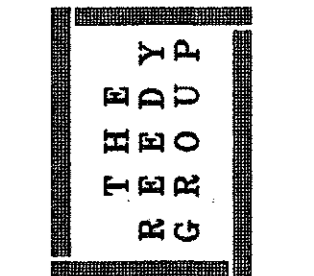

Mary Kay, Inc.
Corporate 1
Addison, Texas
Cooling Tower Addition

Project Revisions
ADDENDUM 1, 8/6/03

Project Number
02110

Issue Date

23 July 2003

Sheet Title
WATERPROOFING & DRAINAGE PLAN

Sheet Number
S-04

