



1 SECTION
SCALE: 3/4" = 1'-0"


NOTE: PROVIDE VERTICAL CONTINUOUS CONTROL JOINTS AS FOLLOWS TO ALL EXPOSED TO VIEW CONCRETE WALLS AND RETAINING WALLS. CONTROL JOINTS SHALL BE 1/4" WIDE BY 1/2" DEEP AND SPACED AT 20'-0" O.C. MAX. COORD. W/ ENGINEER PRIOR TO CONSTRUCTION. TYP. ALL WALLS.

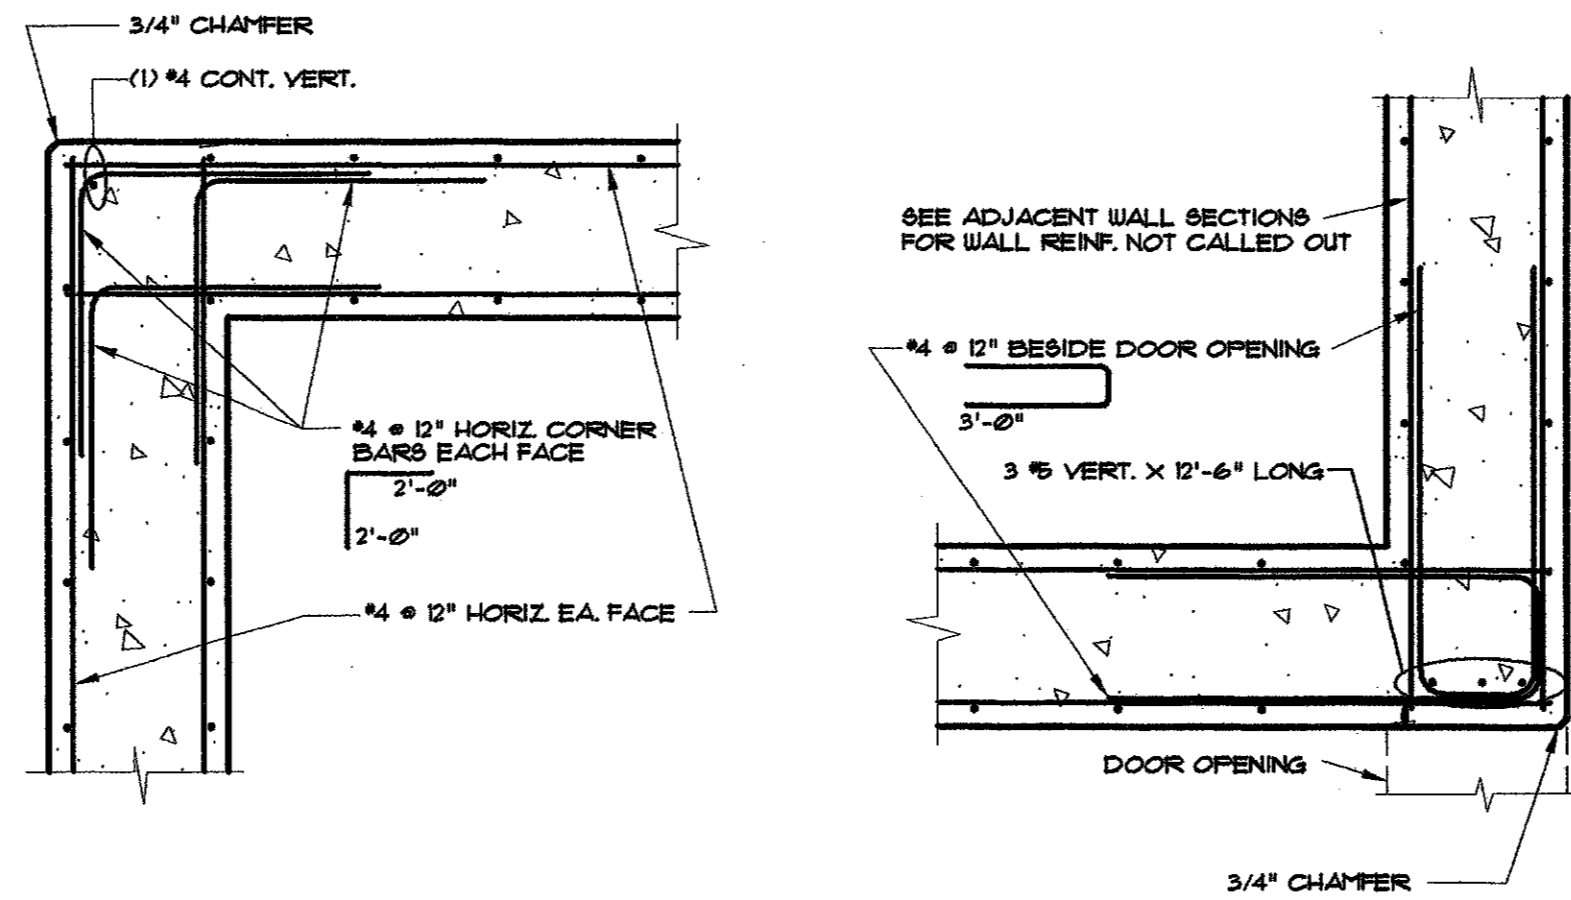


ENTRANCE WALLS
2 PLAN
SCALE: 3/4" = 1'-0"

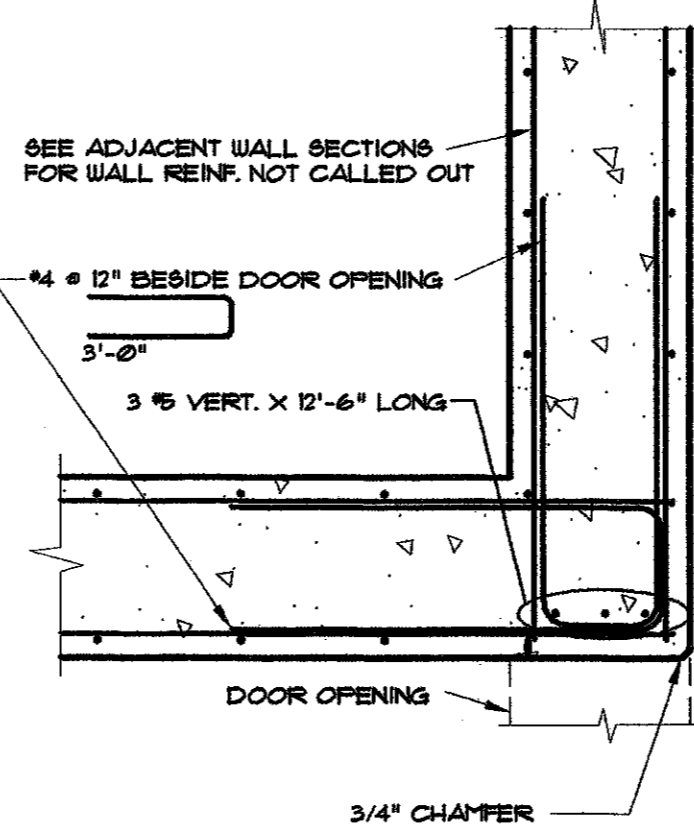

DOOR JAMB
3 PLAN
SCALE: 3/4" = 1'-0"

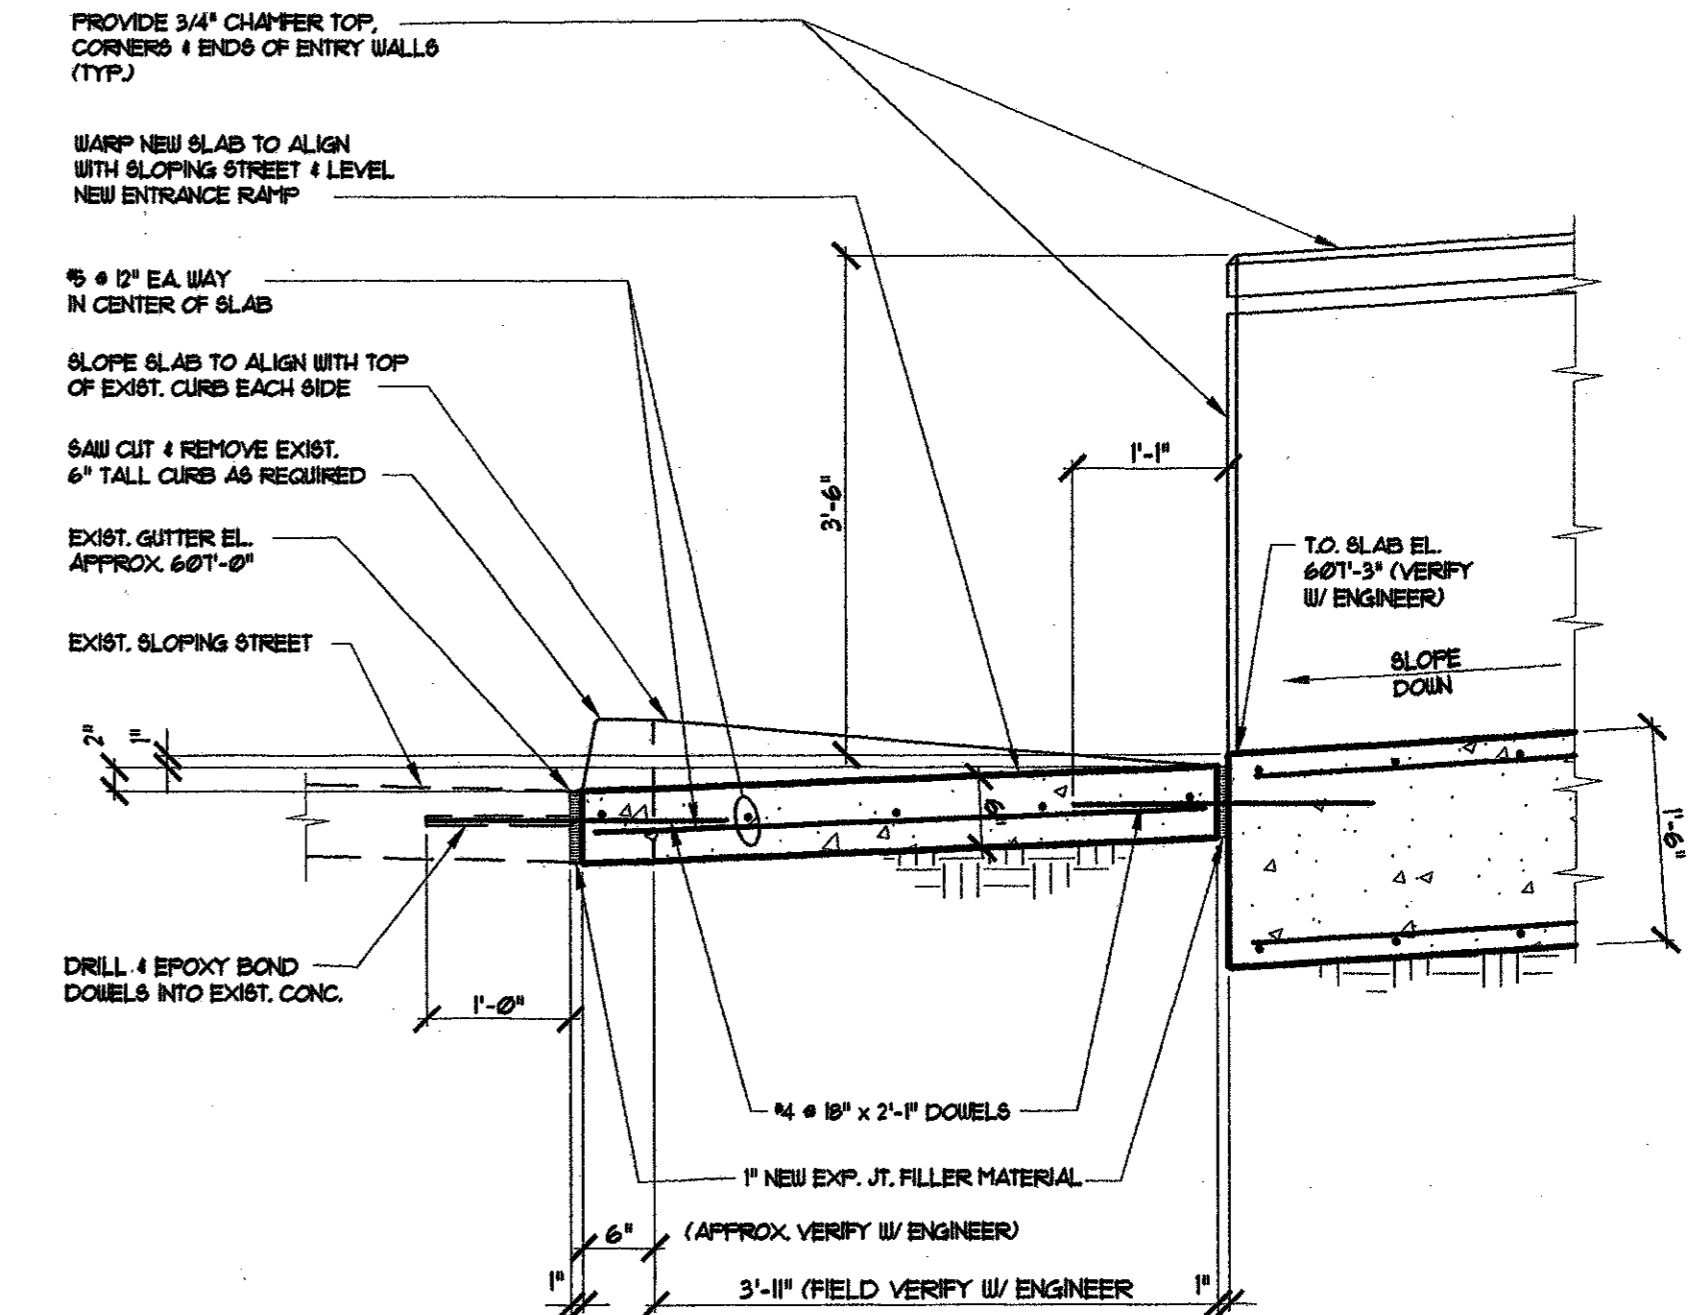


SECTION
SCALE: 3/4" = 1'-0"

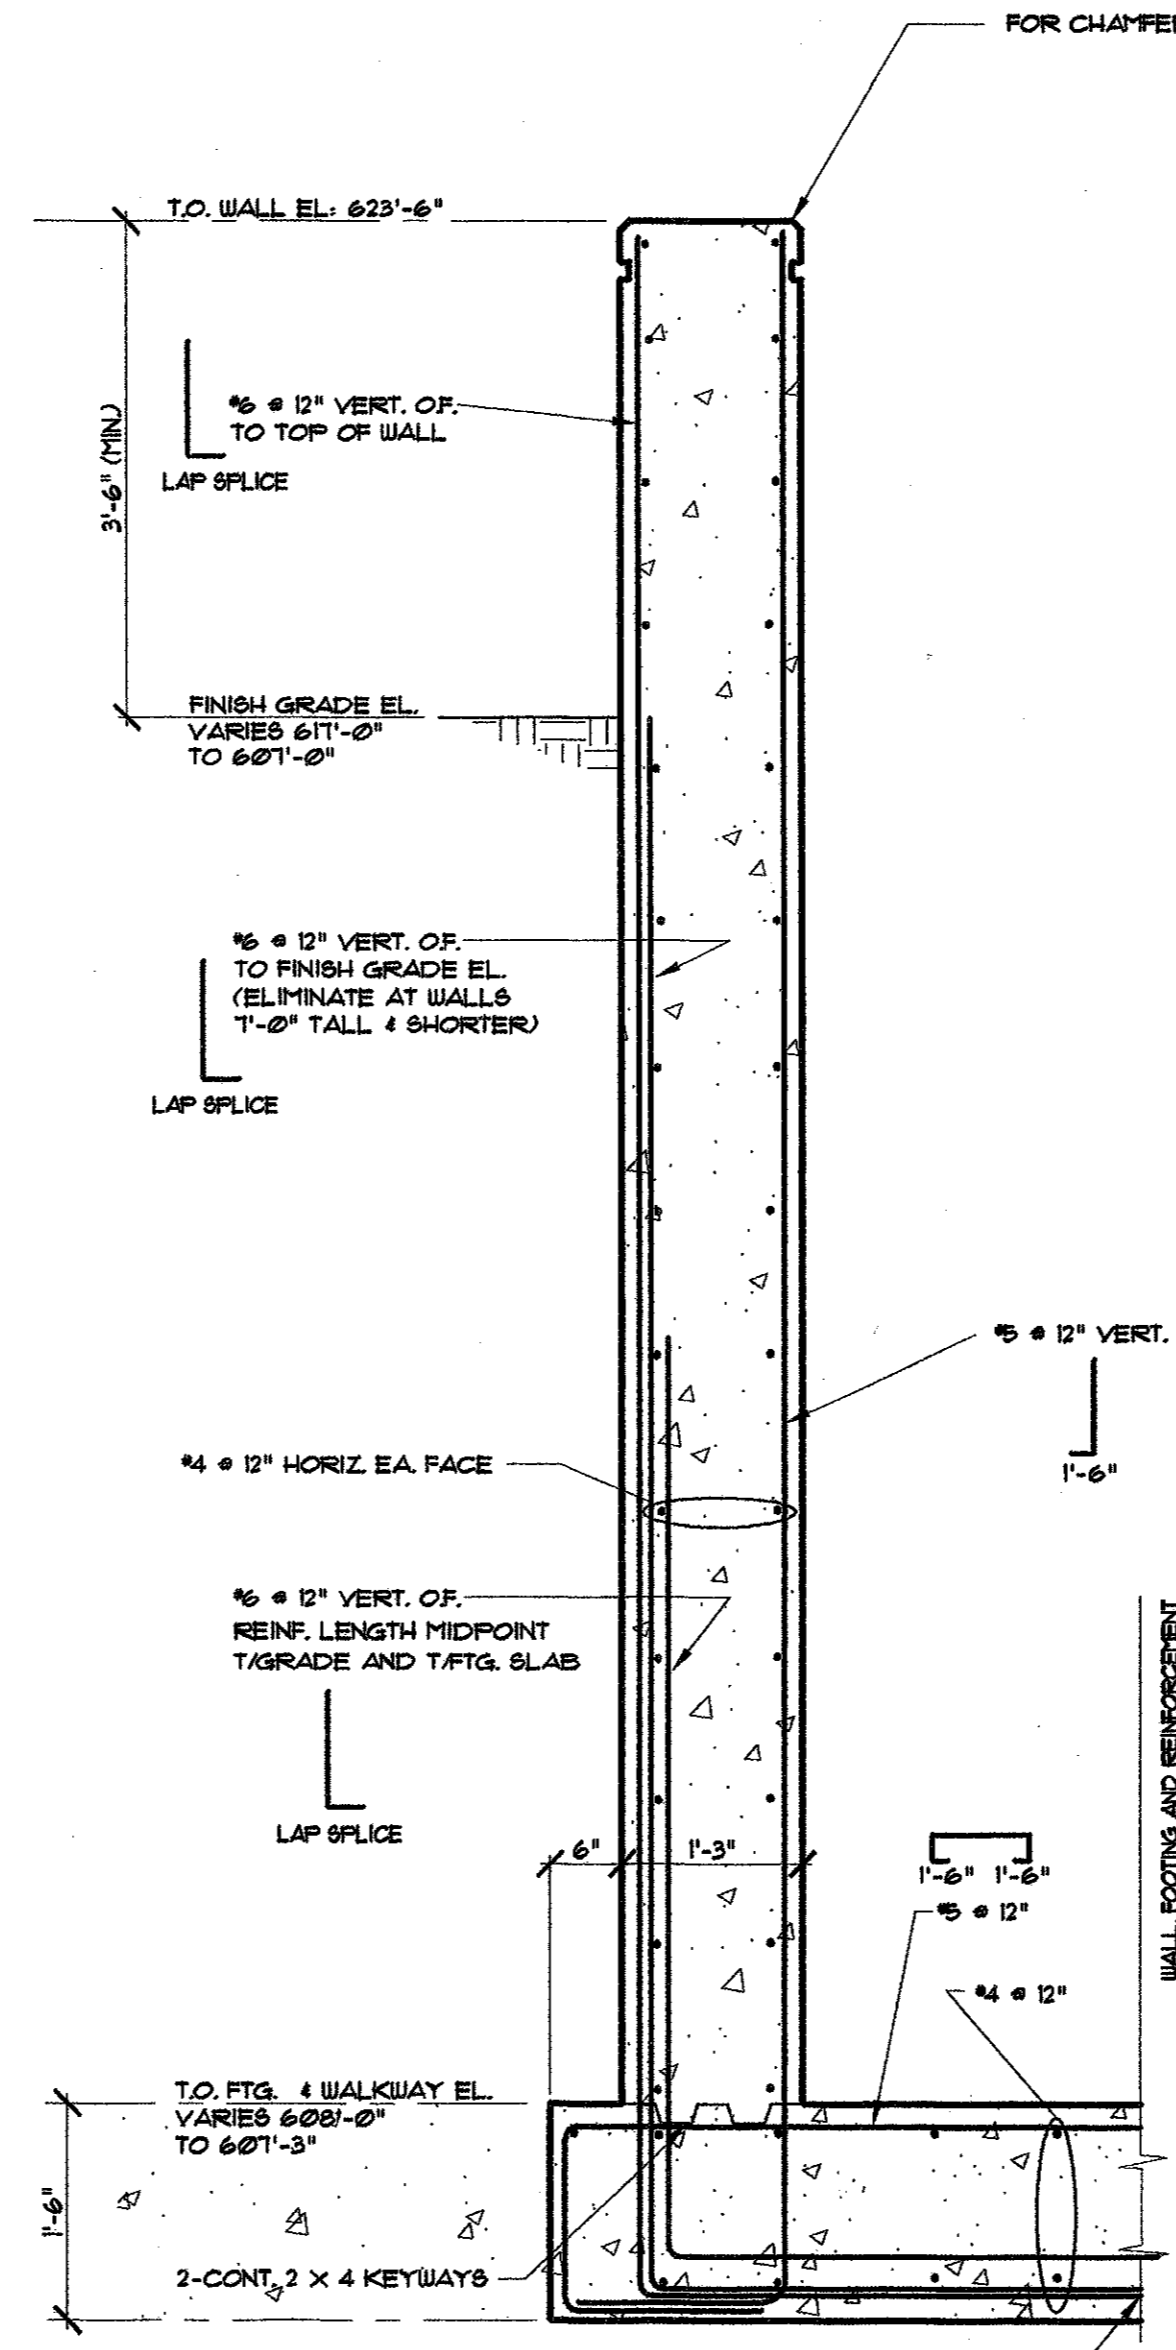

4 SECTION
SCALE: 3/4" = 1'-0"


NOTE: PROVIDE BEHIND WALL WATERPROOFING IN ACCORDANCE WITH 2-6-04 TYPICAL ALL RETAINING WALLS AND CHILLER ENCLOSURE WALLS.

NOTE: PROVIDE VERTICAL CONTINUOUS CONTROL JOINTS AS FOLLOWS TO ALL EXPOSED TO VIEW CONCRETE WALLS AND RETAINING WALLS. CONTROL JOINTS SHALL BE 1/4" WIDE BY 1/2" DEEP AND SPACED AT 20'-0" O.C. MAX. COORD. W/ ENGINEER PRIOR TO CONSTRUCTION. TYP. ALL WALLS.

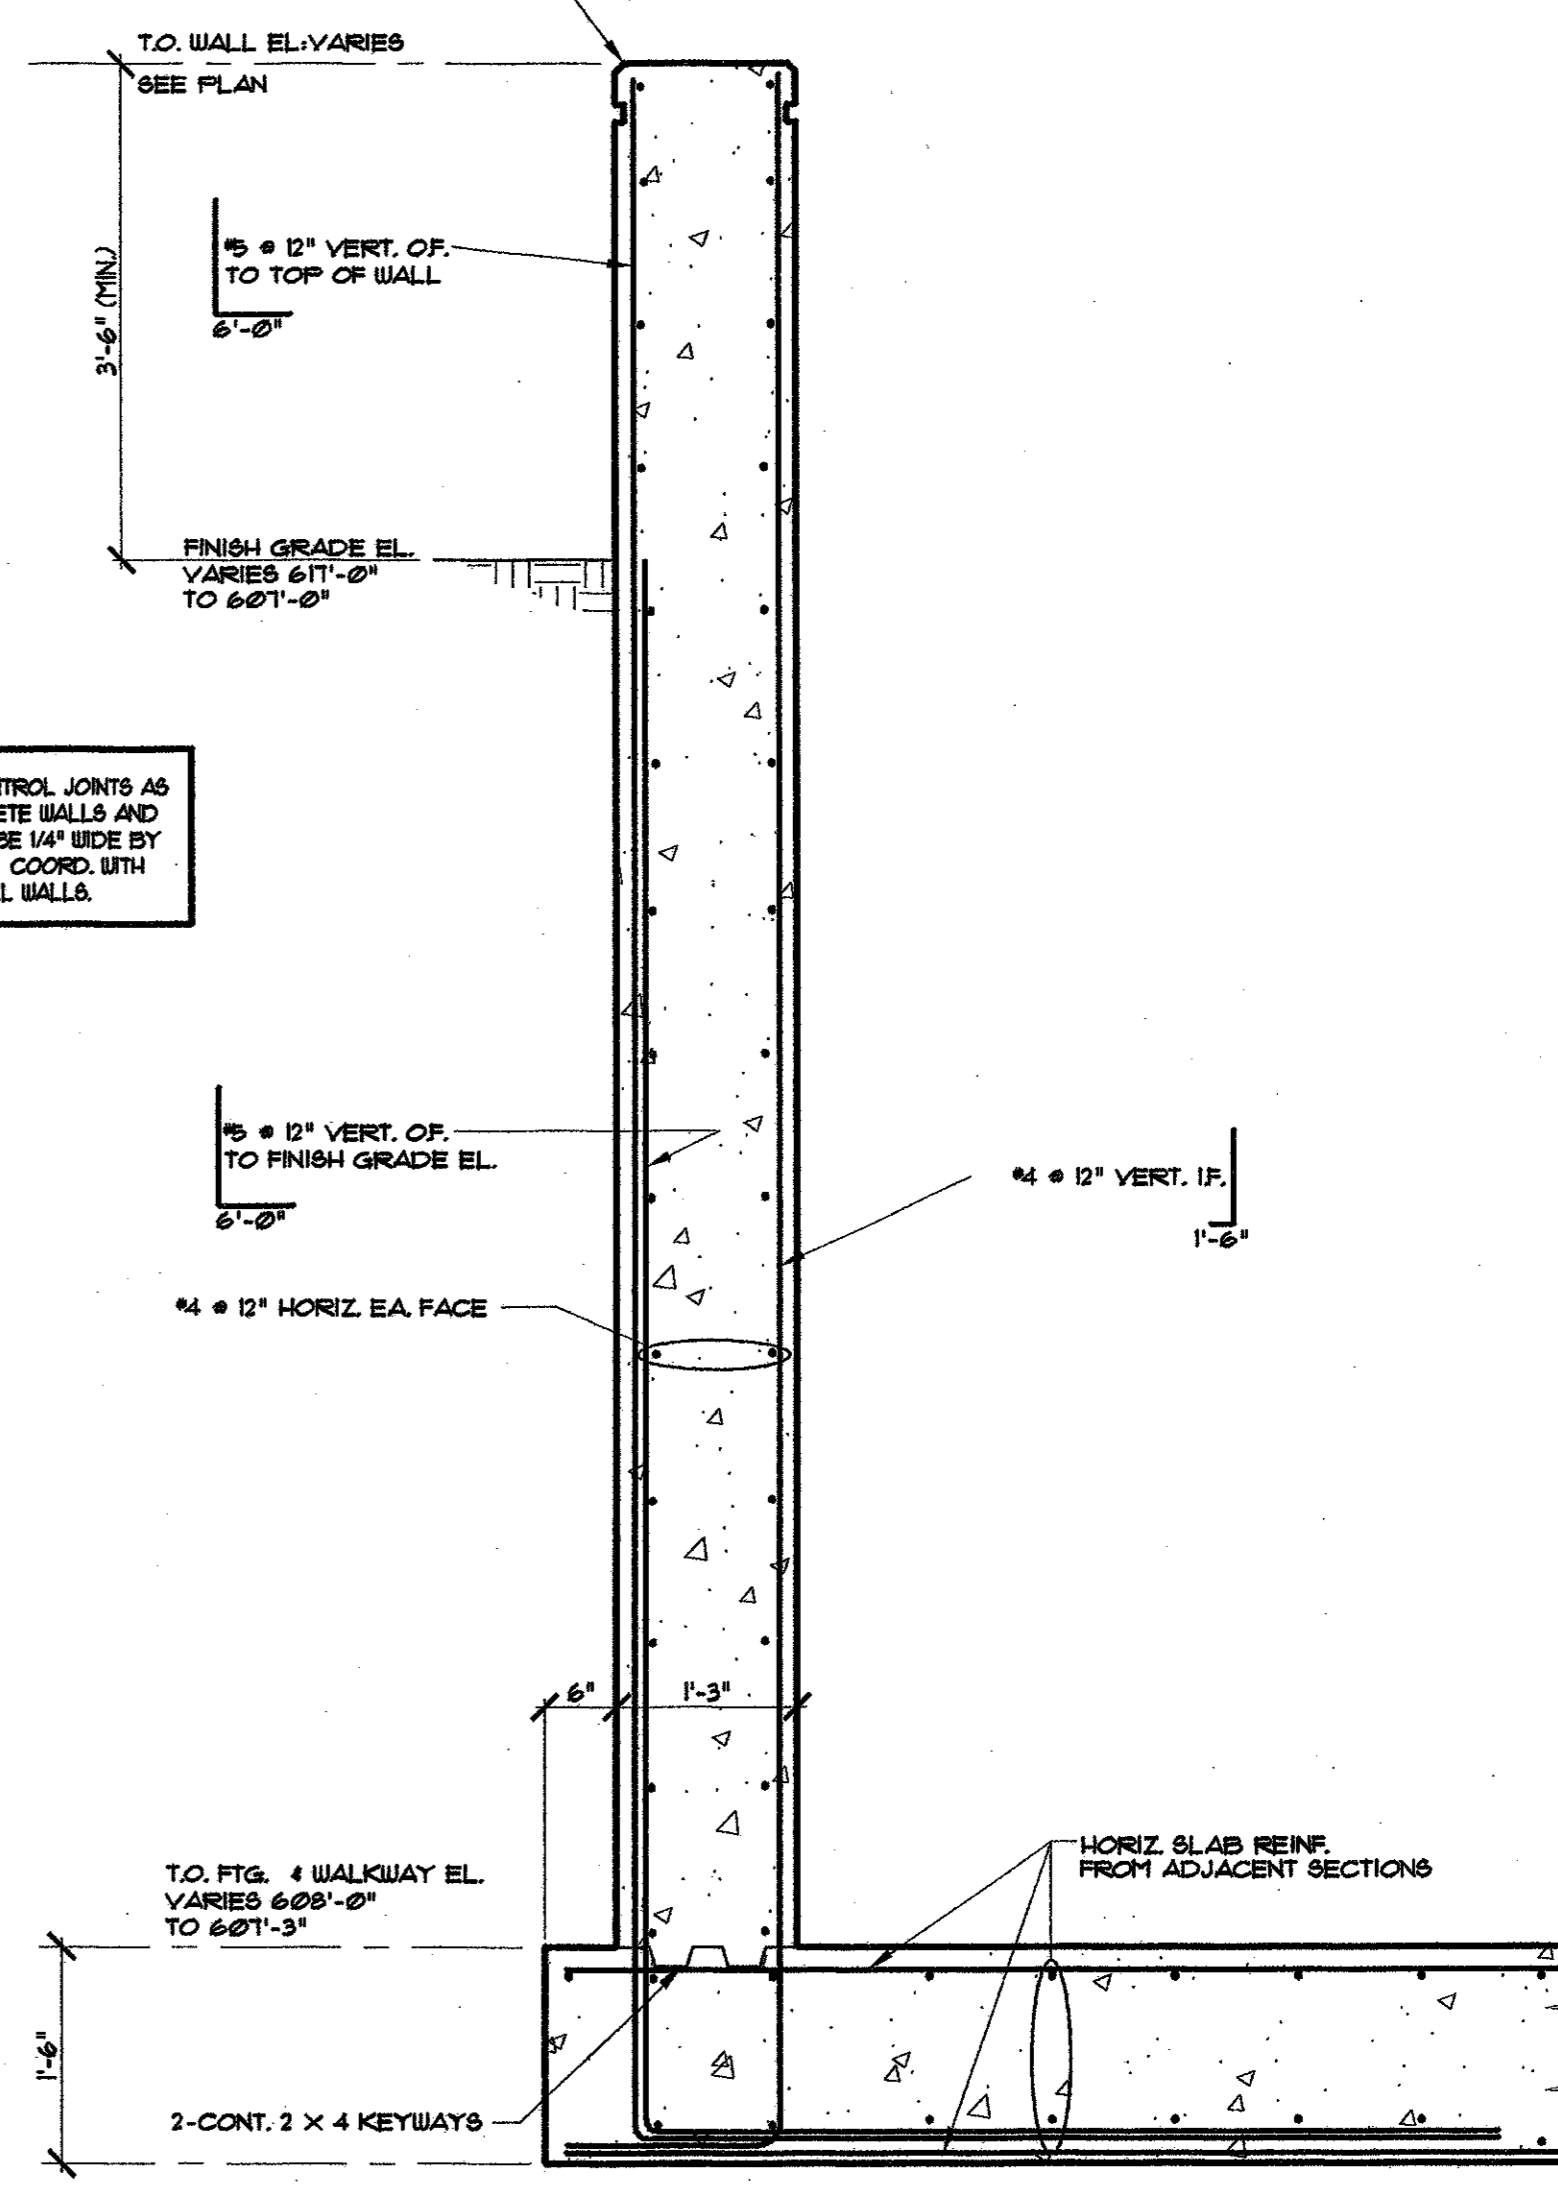

5 SECTION
SCALE: 3/4" = 1'-0"

NOTE: PROVIDE BEHIND WALL WATERPROOFING IN ACCORDANCE WITH 2-6-04 TYPICAL ALL RETAINING WALLS AND CHILLER ENCLOSURE WALLS.

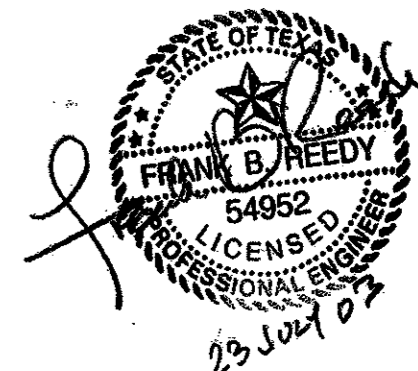

DFW Consulting Group, Inc.
8410 Sterling
Irving, TX 75063
(972) 929-1199

Structural Engineering
Architectural Engineering
8588 Northwest Plaza Drive
Suite 214
Dallas, Texas 75225
214-373-0164
214-373-0170 Fax
reedygrp@swbell.net

T
H
E
R
E
D
U
P
R
E
G
R
O

Mary Kay, Inc.
Corporate 1
Addison, Texas
Cooling Tower Addition

Project Revisions

Project Number
02110

Issue Date
23 July 2003

Sheet Title
SECTIONS
& DETAILS

Sheet Number
S-07