


CONT. # 84-45
CITY OF ADDISON

NOTE!
 * Install 430 L.F. of Temp. 2" Water Line Above The Ground, Prior To The Const. Of The 84" Water Main.
 * Conn. Ex. House Services To The Temp. Line.
 * #5505, #5510, #5434, Will Be Served From The 2" Temp. Line During The Const. Time.
 * Cut & Plug Ex. 8" Water East Of Ex. Tee Station 149+44.52.

JHY Corporation
 A Texas Corporation
 100' Temp. Working Space For The 84" Water Main
 From Sta. 143+80.1 To Sta. 149+57.1
 Abat. No. 157 Blk. 816A
 In The City of Addison
 C.O.
 Vol. 38112 Pg. 351 Date:

WATER MAP
 8-29 W
 SEWER KEY MAP
 F-2

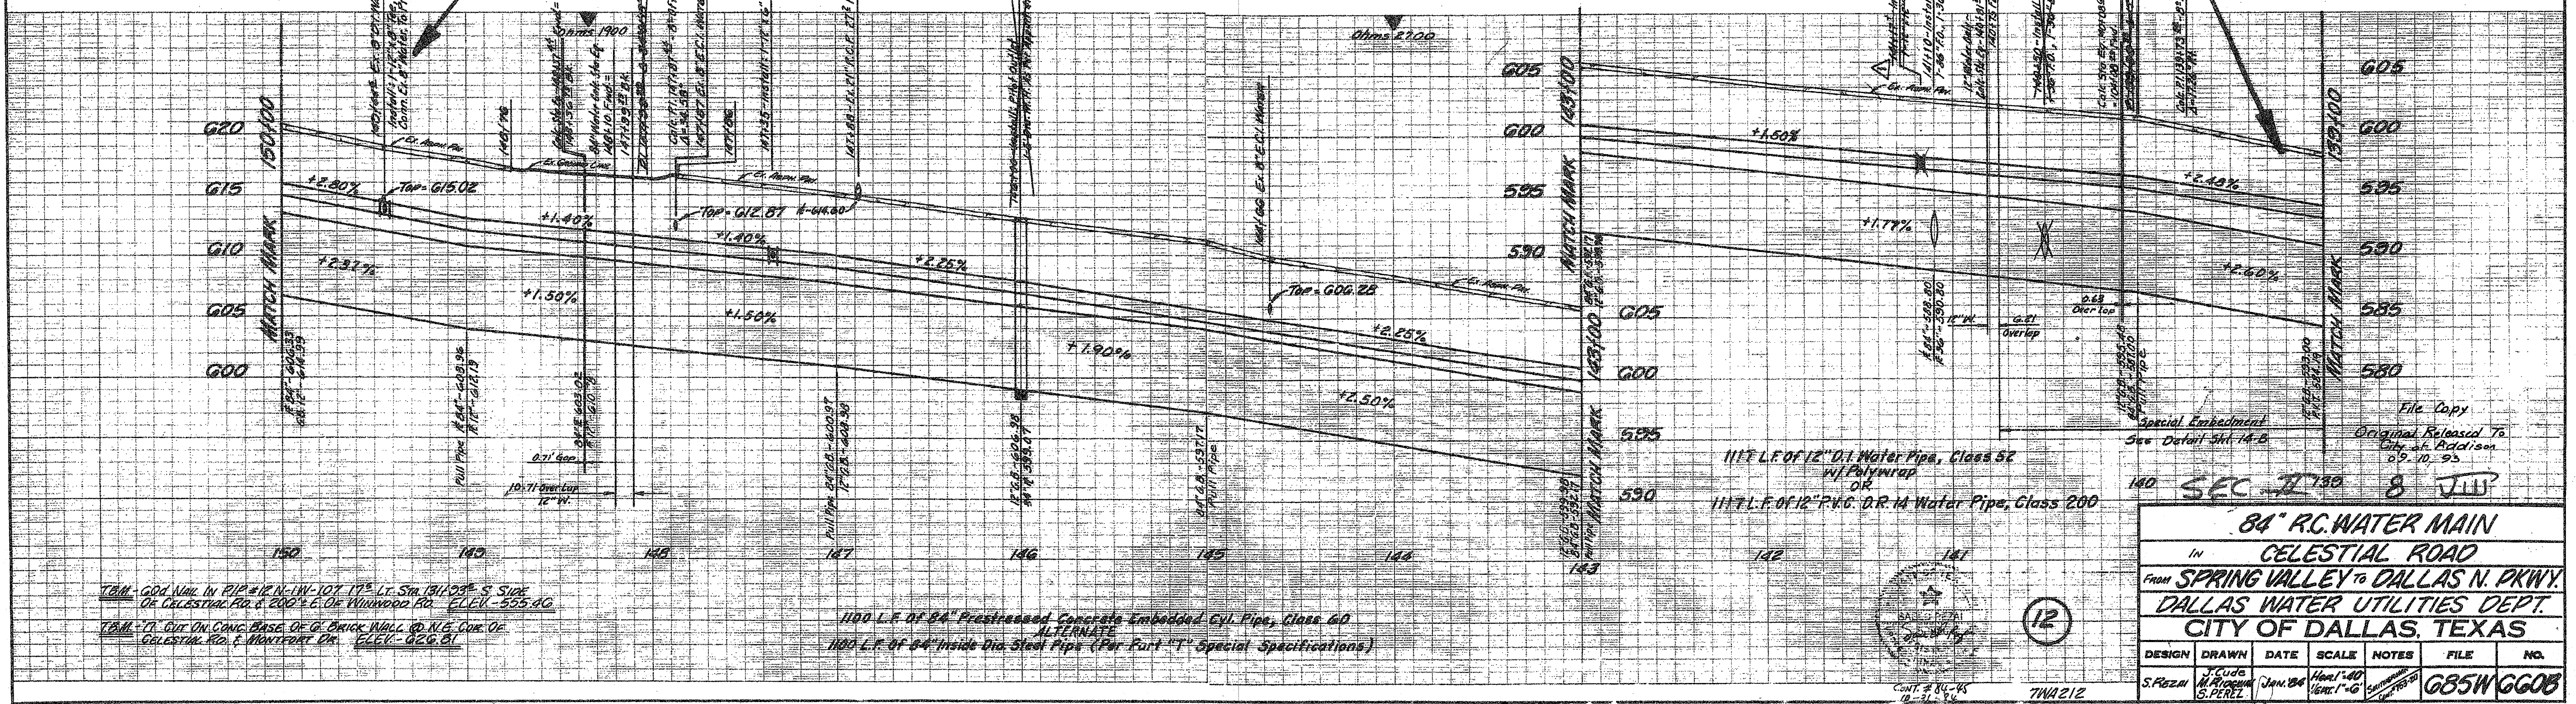

100' L.F. OF 84" Prestressed Concrete Embedded Cyl. Pipe, Class 60
 ALTERNATE
 100' L.F. OF 84" Inside Dia. Steel Pipe (Per Part "T" Special Specifications)

100' L.F. OF 12" P.V.C. D.R. 14 Water Pipe, Class 200

111' L.F. OF 12" P.V.C. D.R. 14 Water Pipe, Class 200

84" R.C. WATER MAIN
 IN
 CELESTIAL ROAD
 FROM SPRING VALLEY TO DALLAS N. PKWY.
 DALLAS WATER UTILITIES DEPT.
 CITY OF DALLAS, TEXAS

DESIGN	DRAWN	DATE	SCALE	NOTES	FILE	NO.
S. REEM	G. PERL	JAN. 86	1"=40'	1-10	685W6608	

Revised By: S. Regal 5-8-85
 Nov. 14, 1985