


**SECTION A**  
SCALE: 1/2" = 1'-0"  
(STA. 3+60 TO STA. 4+20)

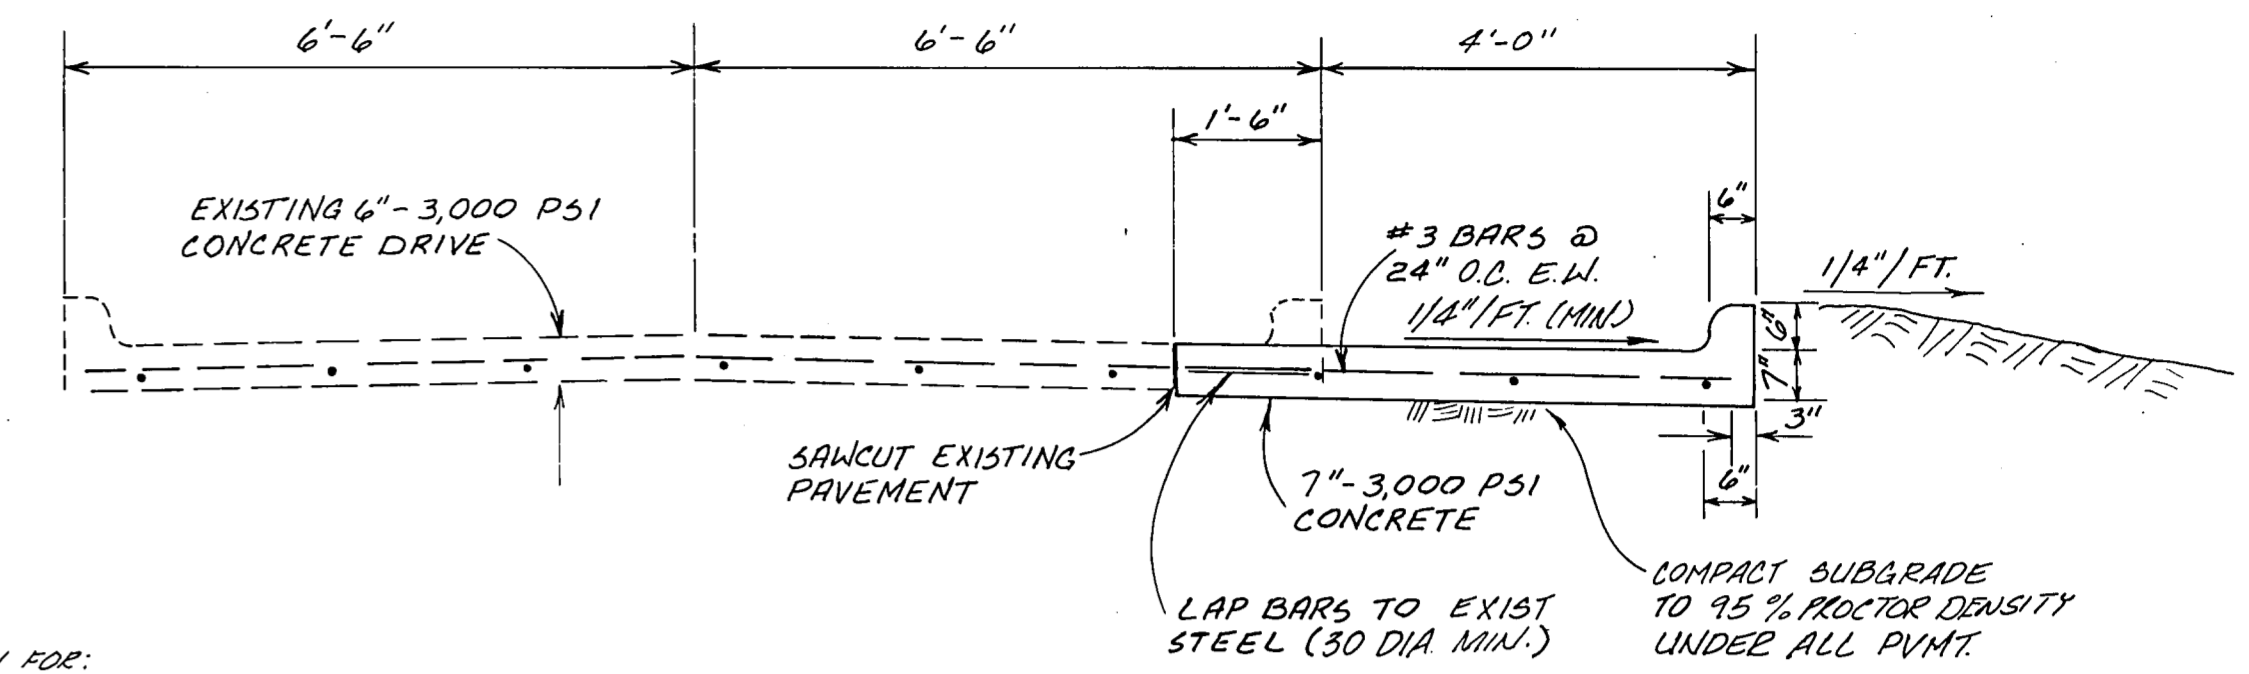

**SECTION D**  
SCALE: 1/2" = 1'-0" (TYP)


SPECIFICATION FOR:

GRAVEL	
SIEVE SIZE	% FINER
3/4"	100
3/8"	55-100
No. 4	15-100
No. 8	0-50
No. 16	0-15
No. 20	0-5
No. 200	0-5

HARDWARE CLOTH	
MAX. WIDTH OF MESH OPENING	MIN. WIDTH OF MESH OPENING
1/4"	1/16"

FILTER FABRIC	
MAX. EQUIVALENT OPENING	SIEVE
1/4"	No. 60
1/2"	No. 30


\* P.V.C. PIPE SHALL BE SCHEDULE 40

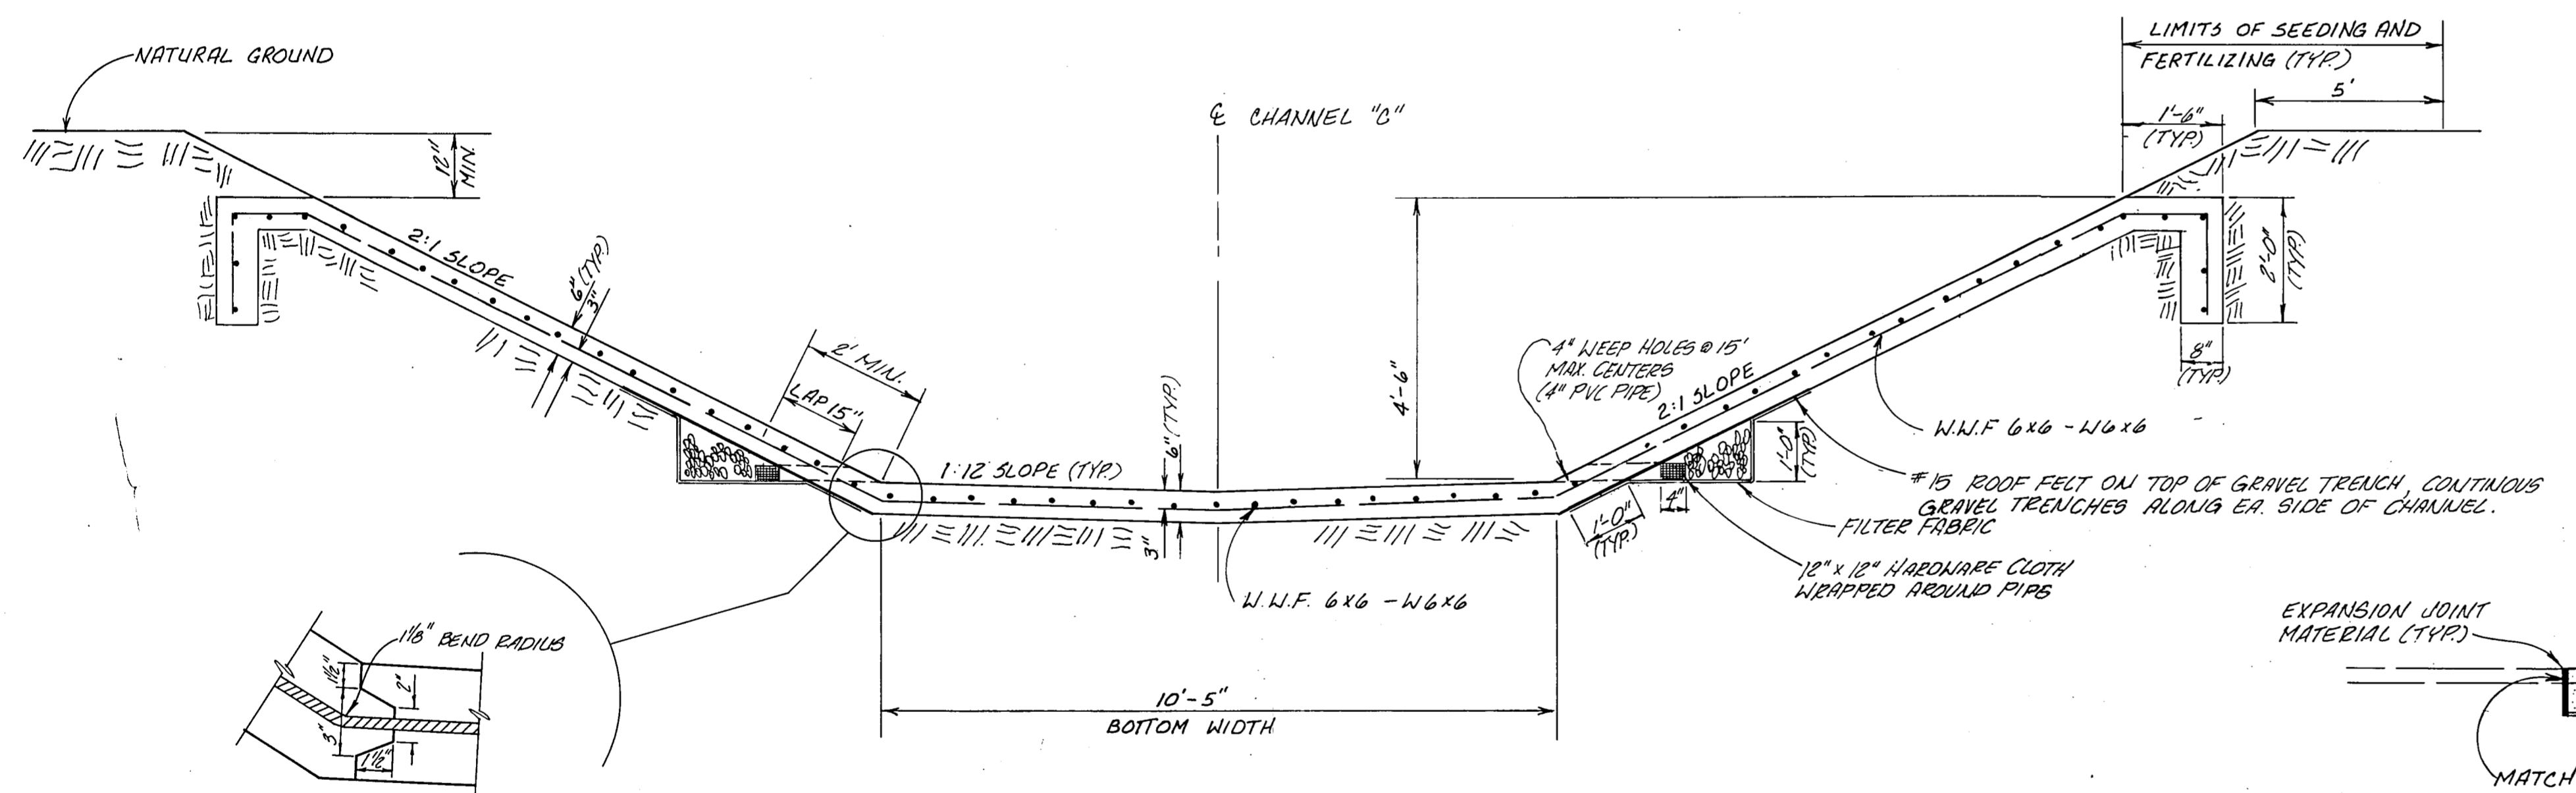


**SECTION C**  
SCALE: 1/2" = 1'-0"

**PERMISSIBLE CONSTRUCTION JOINT**  
N.T.S.


3/4" TRANSVERSE EXPANSION JOINT TO BE PROVIDED AT 80' C-C. (MAX.) SEE SH. 4 FOR CONSTRUCTION DETAILS. WATERSTOP NOT REQUIRED.

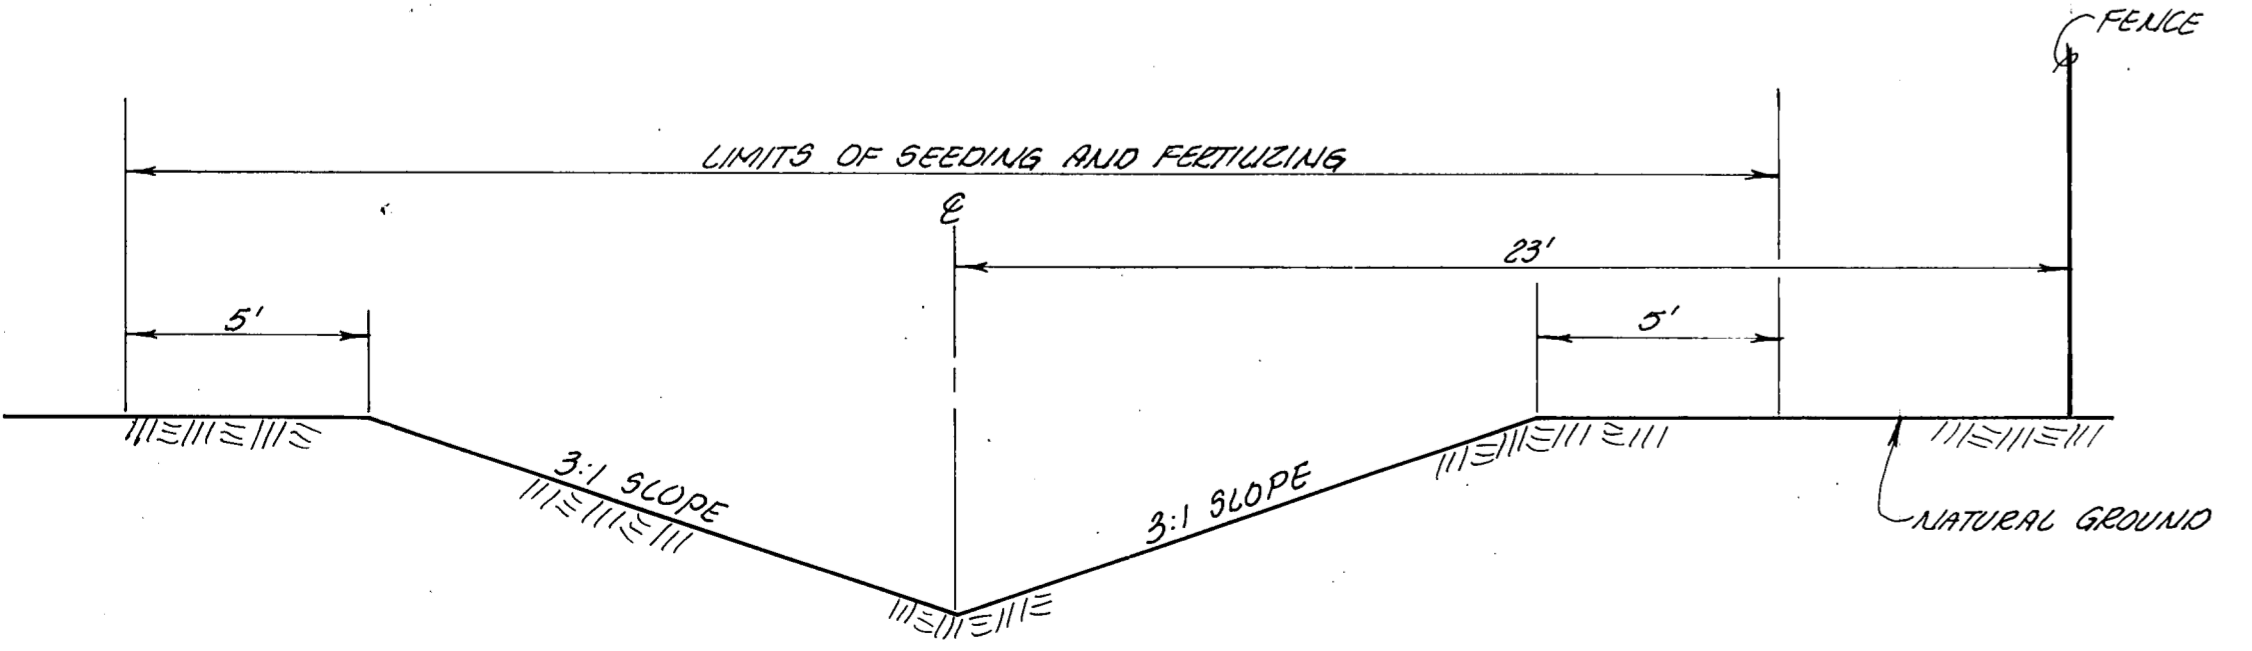

**SECTION B**  
SCALE: 1/4" = 1'-0"

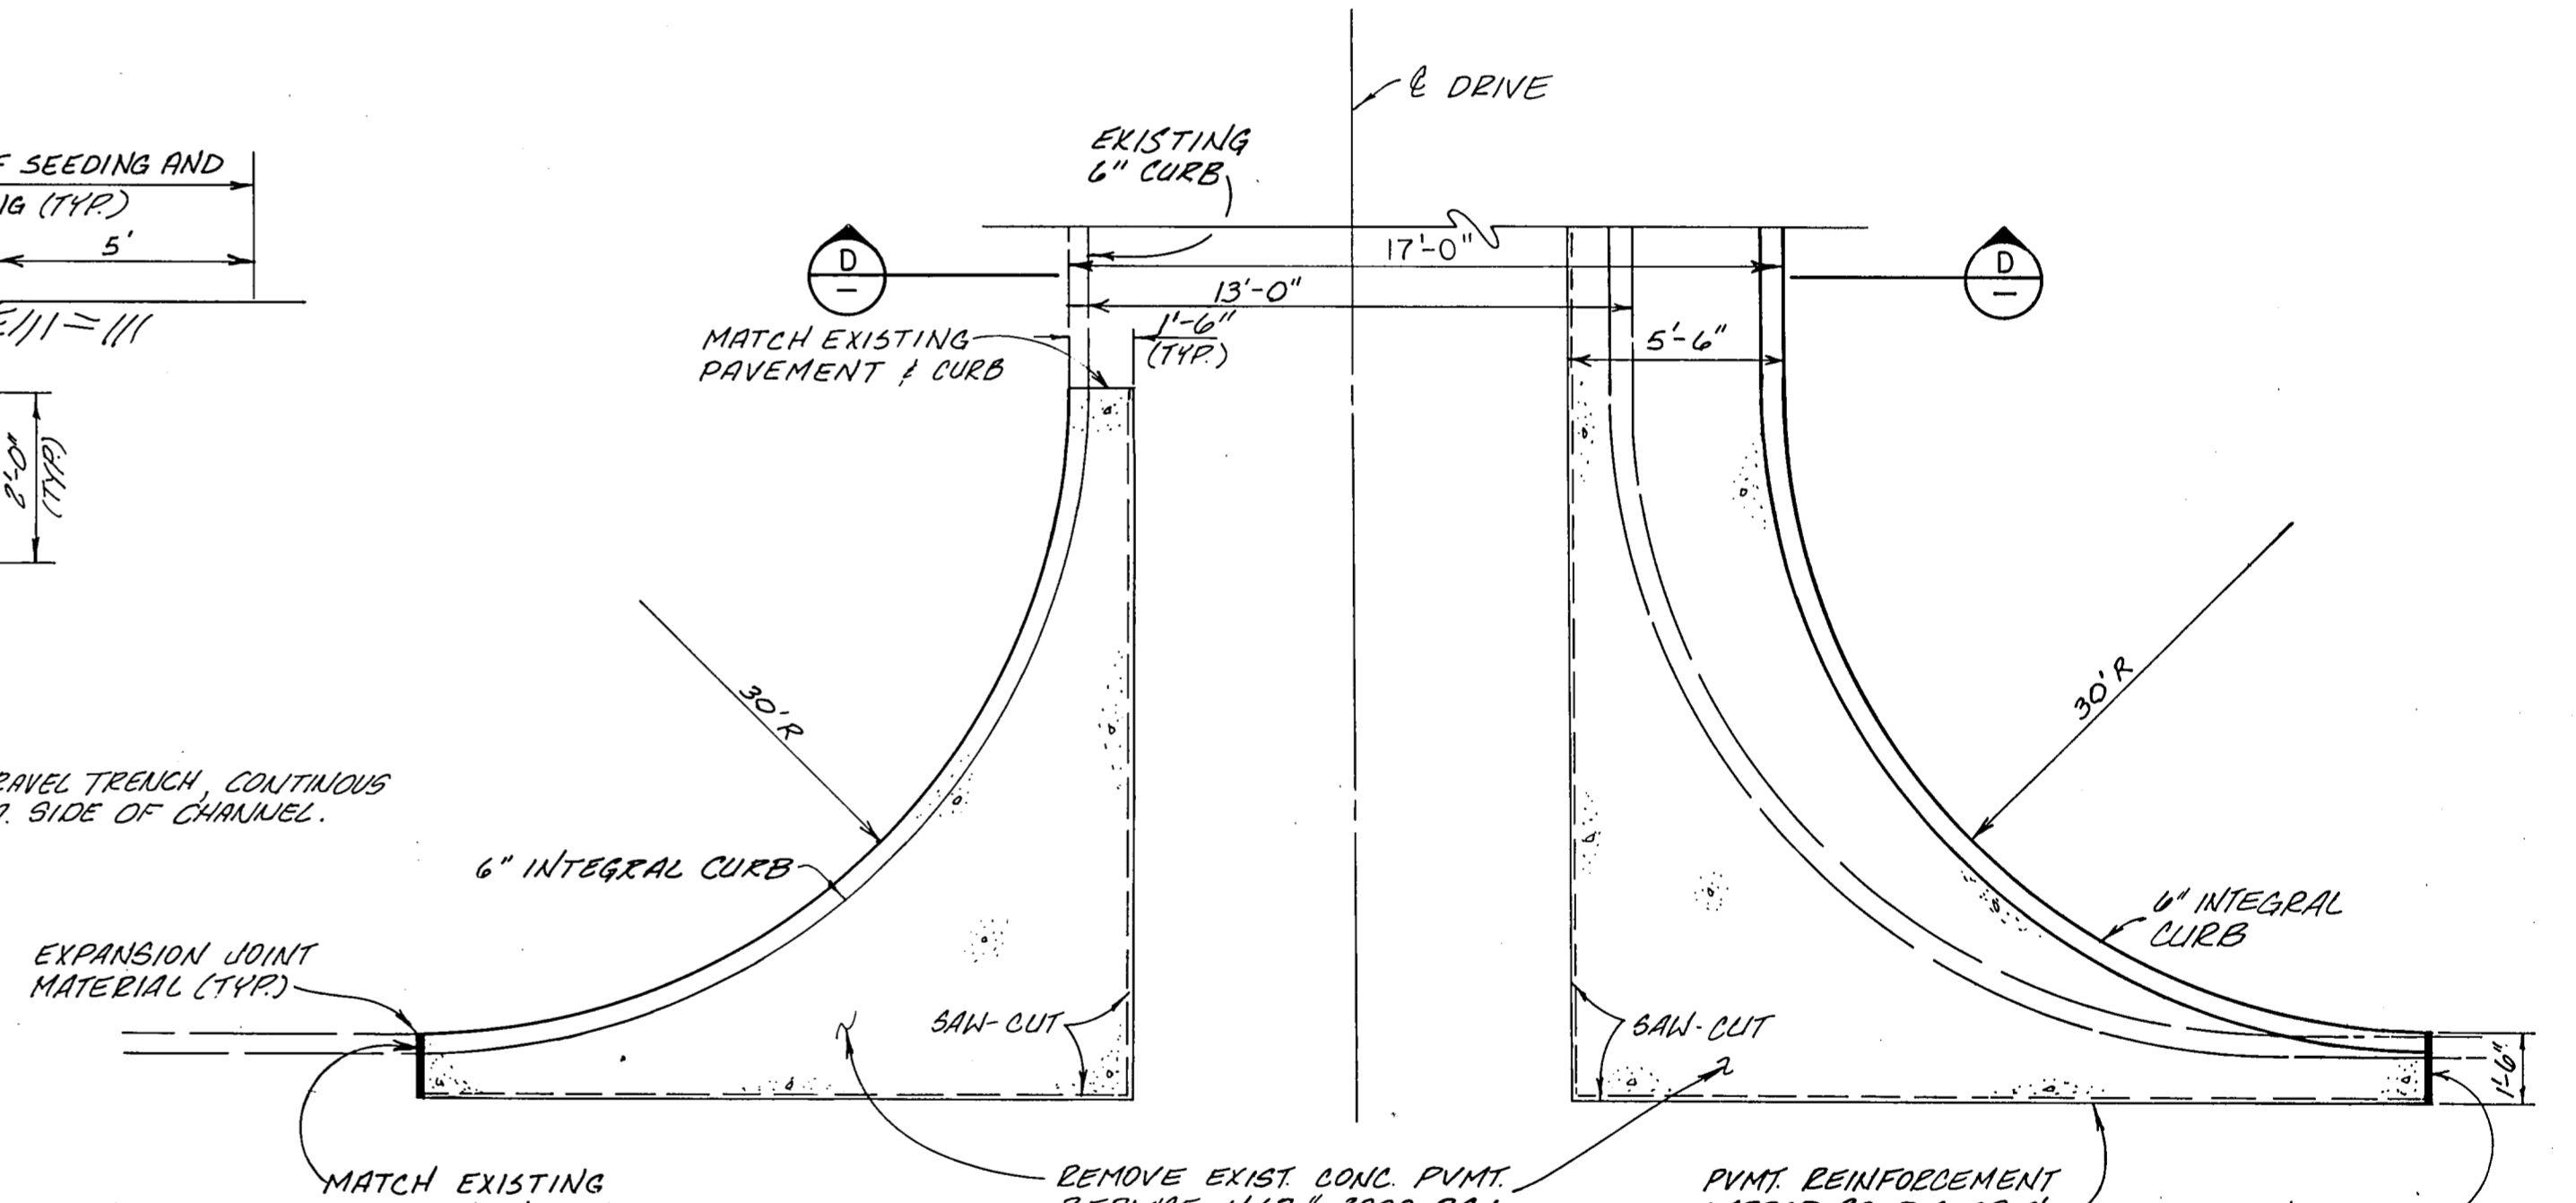

**ENTRANCE DRIVE DETAIL**  
N.T.S.

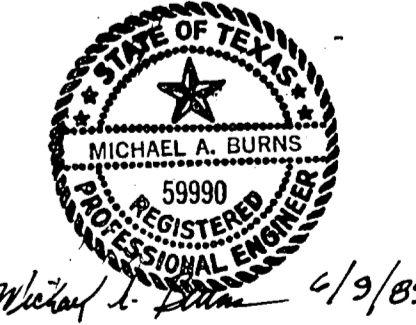

Michael A. Burns 4/9/89

NO.	DATE	REVISION	APPROVED
BELTWOOD RESERVOIR EXPANSION PAVING AND DRAINAGE DETAILS			
DALLAS WATER UTILITIES CITY OF DALLAS, TEXAS Turner Collier & Braden Inc.			
DESIGN	M.A.B.	CONTRACT NO.	SHEET NO.
DRAWN	C.A.	89-79	6
TRACED		FILE NO.	
CHECKED		630 Q 700.F	
DATE	5/89		OF 44