





- NOTES
1. FOR STRUCTURAL NOTES & DETAILS, SEE SHEET 34 OF 44.
  2. ROOF SLAB REINFORCING STEEL NOT SHOWN FOR CLARITY.
  3. ALL OPENINGS TO HAVE EXTRA REINF. STEEL AS SHOWN IN DETAIL 3 ON SHEET 34 OF 44.
  4. STEEL REINF. LAP LENGTHS AS SHOWN IN DETAIL 1 ON SHEET 34 OF 44.
  5. ALL HOOKS SHOWN TO BE STANDARD A.C.I. HOOKS.
  6. EXCAVATE WITHIN LIMITS OF PROPOSED RESERVOIR TO ROCK. EXCAVATED AREAS TO BE REPLACED WITH SELECT FILL PER SPECIFICATIONS.
  7. CEMENT STABILIZED SAND TO BE PLACED BETWEEN EXISTING & PROPOSED RESERVOIR.

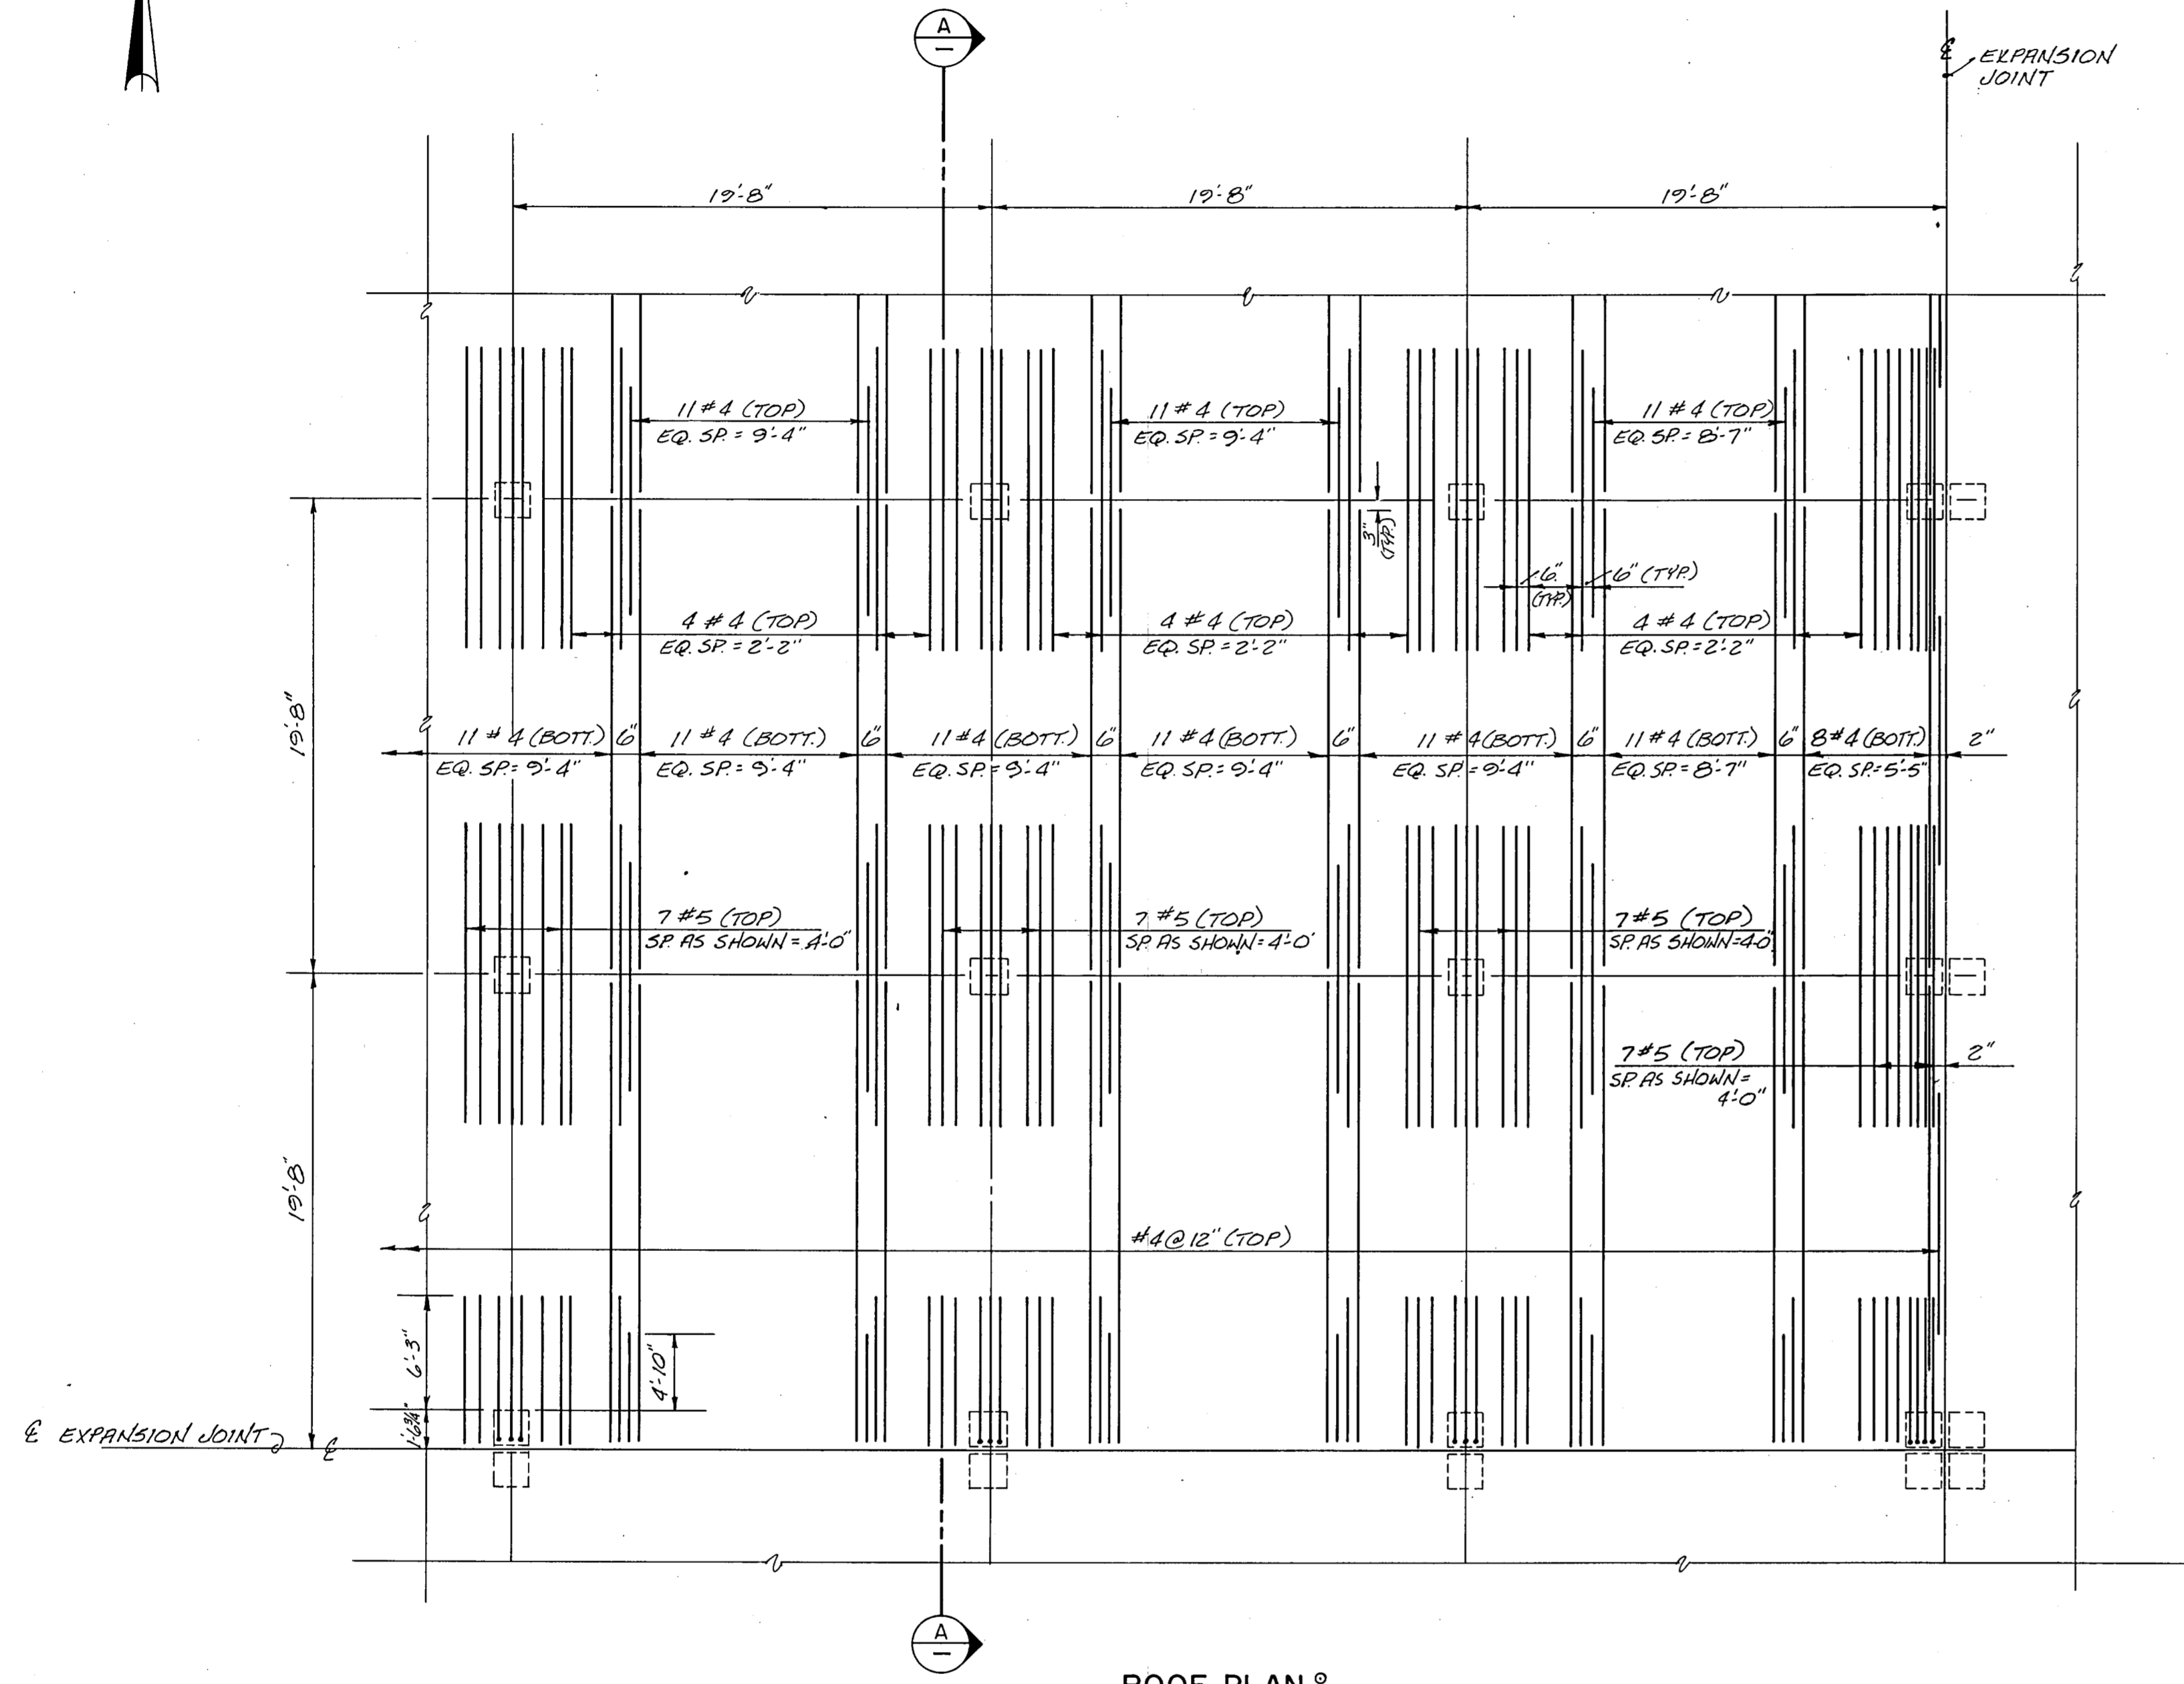

ROOF PLAN °  
INTERIOR BAYS NEAR EXPANSION JOINTS


SCALE: 3/16" = 1'-0"

° EAST/WEST REINFORCEMENT STEEL NOT SHOWN FOR CLARITY. REINFORCEMENT STEEL SIZE AND SPACING IS SIMILAR TO THAT SHOWN IN THE NORTH/SOUTH DIRECTION.

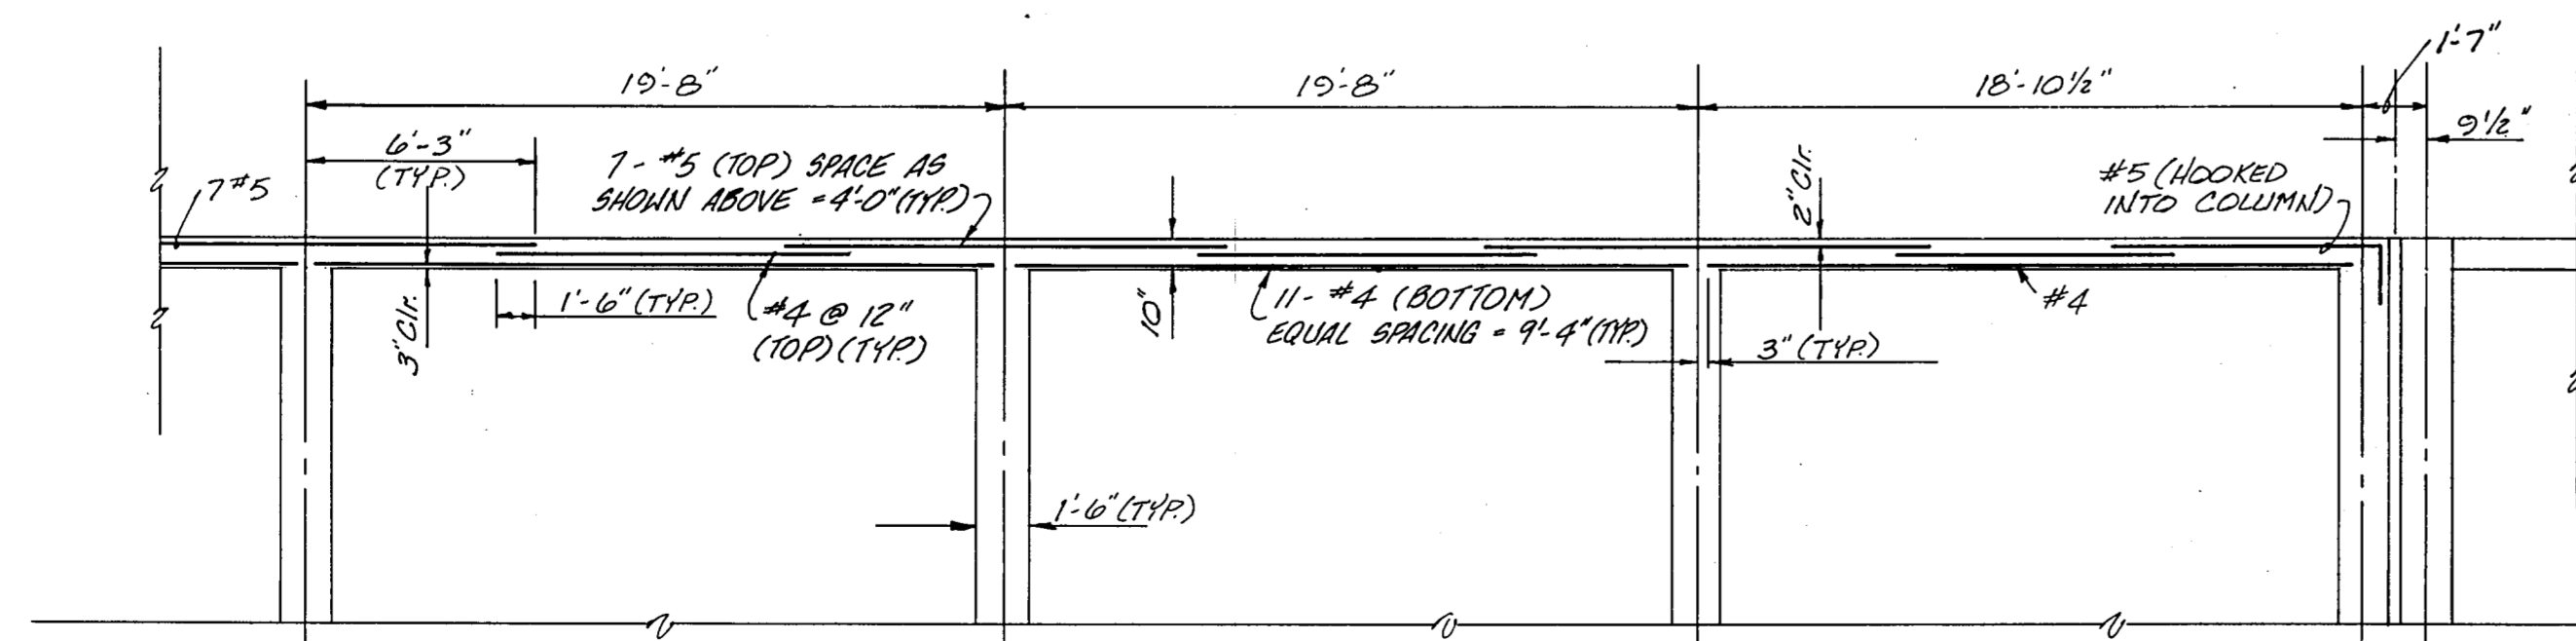

SECTION °  
SCALE: 3/16" = 1'-0"

° NORTH/SOUTH REINFORCEMENT STEEL NOT SHOWN FOR CLARITY. SEE PLAN VIEW FOR SPACING REQUIREMENTS.

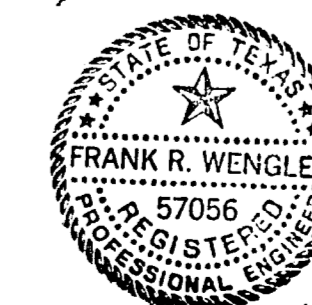

NO.	DATE	REVISION	APPROVED
BELTWOOD RESERVOIR EXPANSION RESERVOIR ROOF DETAILS			
DALLAS WATER UTILITIES CITY OF DALLAS, TEXAS			
TurnerCollie & Braden Inc.			
DESIGN	ERW	CONTRACT NO.	89-79
DRAWN	C.A.	FILE NO.	630 Q 700 F
TRACED			
CHECKED			
DATE	5/89		
			SHEET NO. 33 OF 44