

DALLAS COUNTY PUB. WKS. Approval
 For 8" Water Along E. Side Of
 DALLAS NORTH PARKWAY From
 I.H. 635 To BELT LINE RD. By
 Letter Of OCTOBER 26, 1970
 JOHN PARRISH


NOTE:
 Due to soil resistivity readings of
 less than 1500 OHMS per C.C., all
 C.I. Water Pipe shall have 8 mil
 thickness Polyethylene tube wrap.
 To obtain specifications contact
 R.T. Cook
 500 South Ervay Room 307A

FOR PROP. WATER
 RELOCATION SEE
 411Q-1909A SH. 15

2" COPPER
 DEADHEAD

F.B.K. 418 PG. 51
 Village On The Parkway
 411Q 1960 SH. 34-38

Storm Sewer Profile Sh. 26/27
 BENCH MARK:
 40d Nail in Power Pole 144 feet Left
 of Sta. 98+12 in R.O.W. Fence Line.
 Elev. 633.89

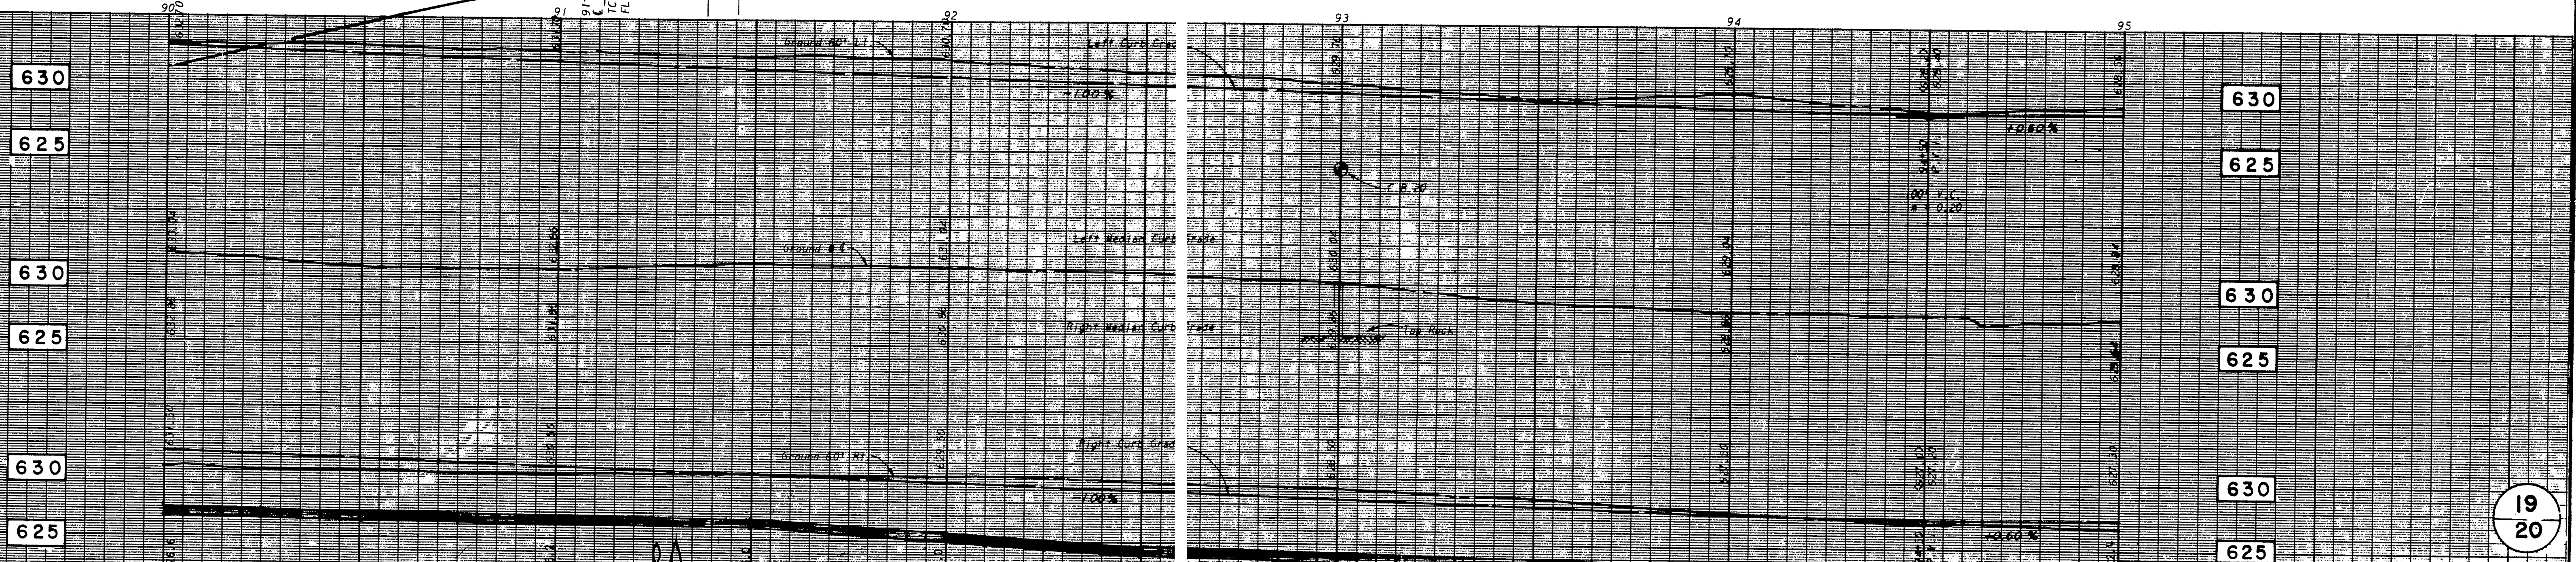

19
 20

PROPOSED WATER MAIN
 DALLAS NORTH EXPRESSWAY
 FROM I.H. 635 TO BELT LINE ROAD
 DALLAS WATER UTILITIES DEPT
 CITY OF DALLAS, TEXAS

DESIGN	DRAWN	DATE	SCALE	NOTES	FILE	NO.
			1" = 20' Hor			

R.O.W. APPROVED *John Parrish 11-17-70*
W.D. Sample 11-17-70
 ENGINEER OF DESIGN, DALLAS WATER UTILITIES DEPT.
 CONTRACT NO. 70-217-P-Cullum-11-17-70

ALBRITTON & ASSOCIATES, INC.
 CONSULTING ENGINEERS
 404 UCC BLDG. 741-4884
 DALLAS, TEXAS 75207

