



**TEMPERATURE CONTROL AND AIR FLOW DIAGRAM**  
VAV AIR HANDLING UNIT AHU-1 (BASE BUILDING MECH RM)

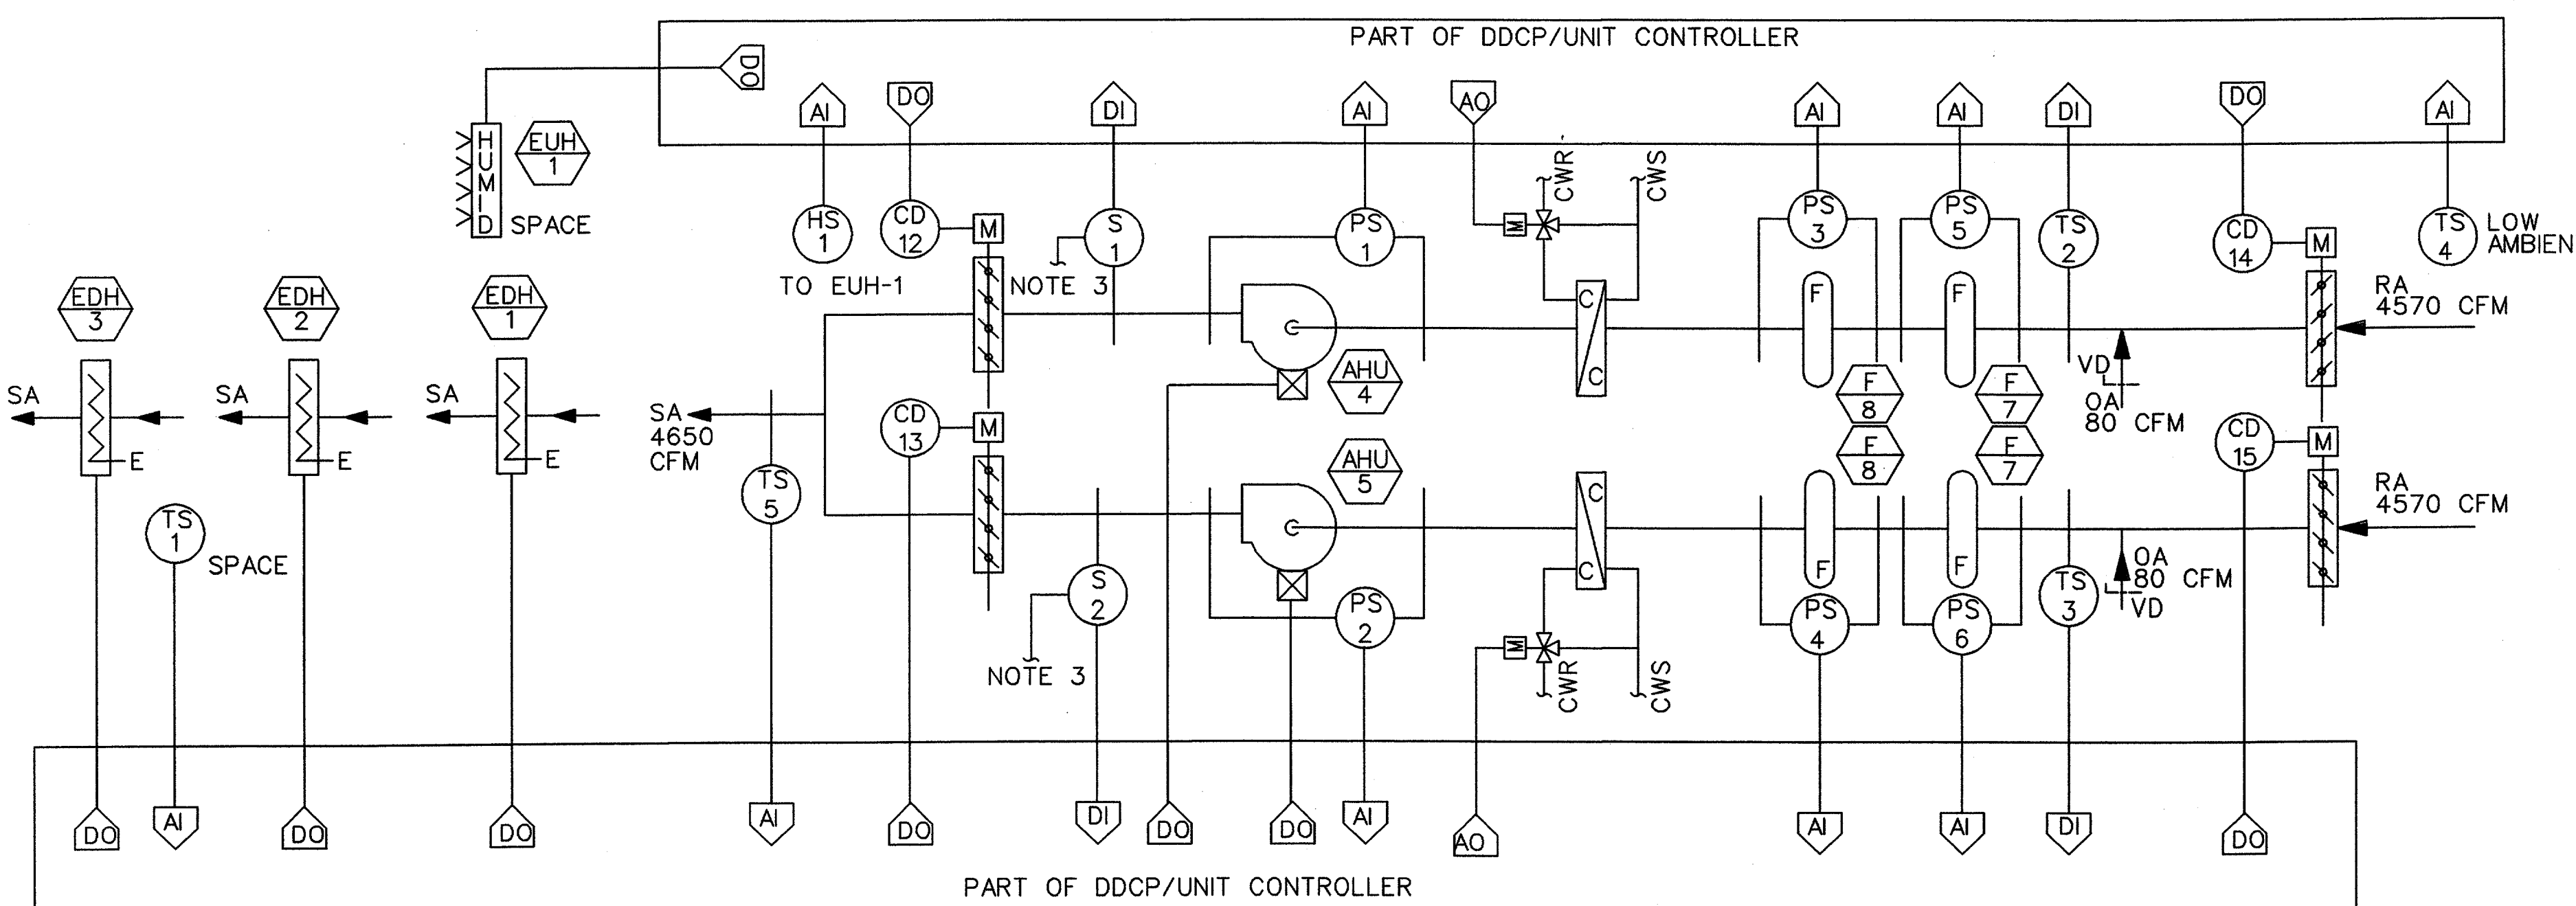

**TEMPERATURE CONTROL AND AIR FLOW DIAGRAM**  
AHU-4 AND AHU-5 (EQUIPMENT ROOM)

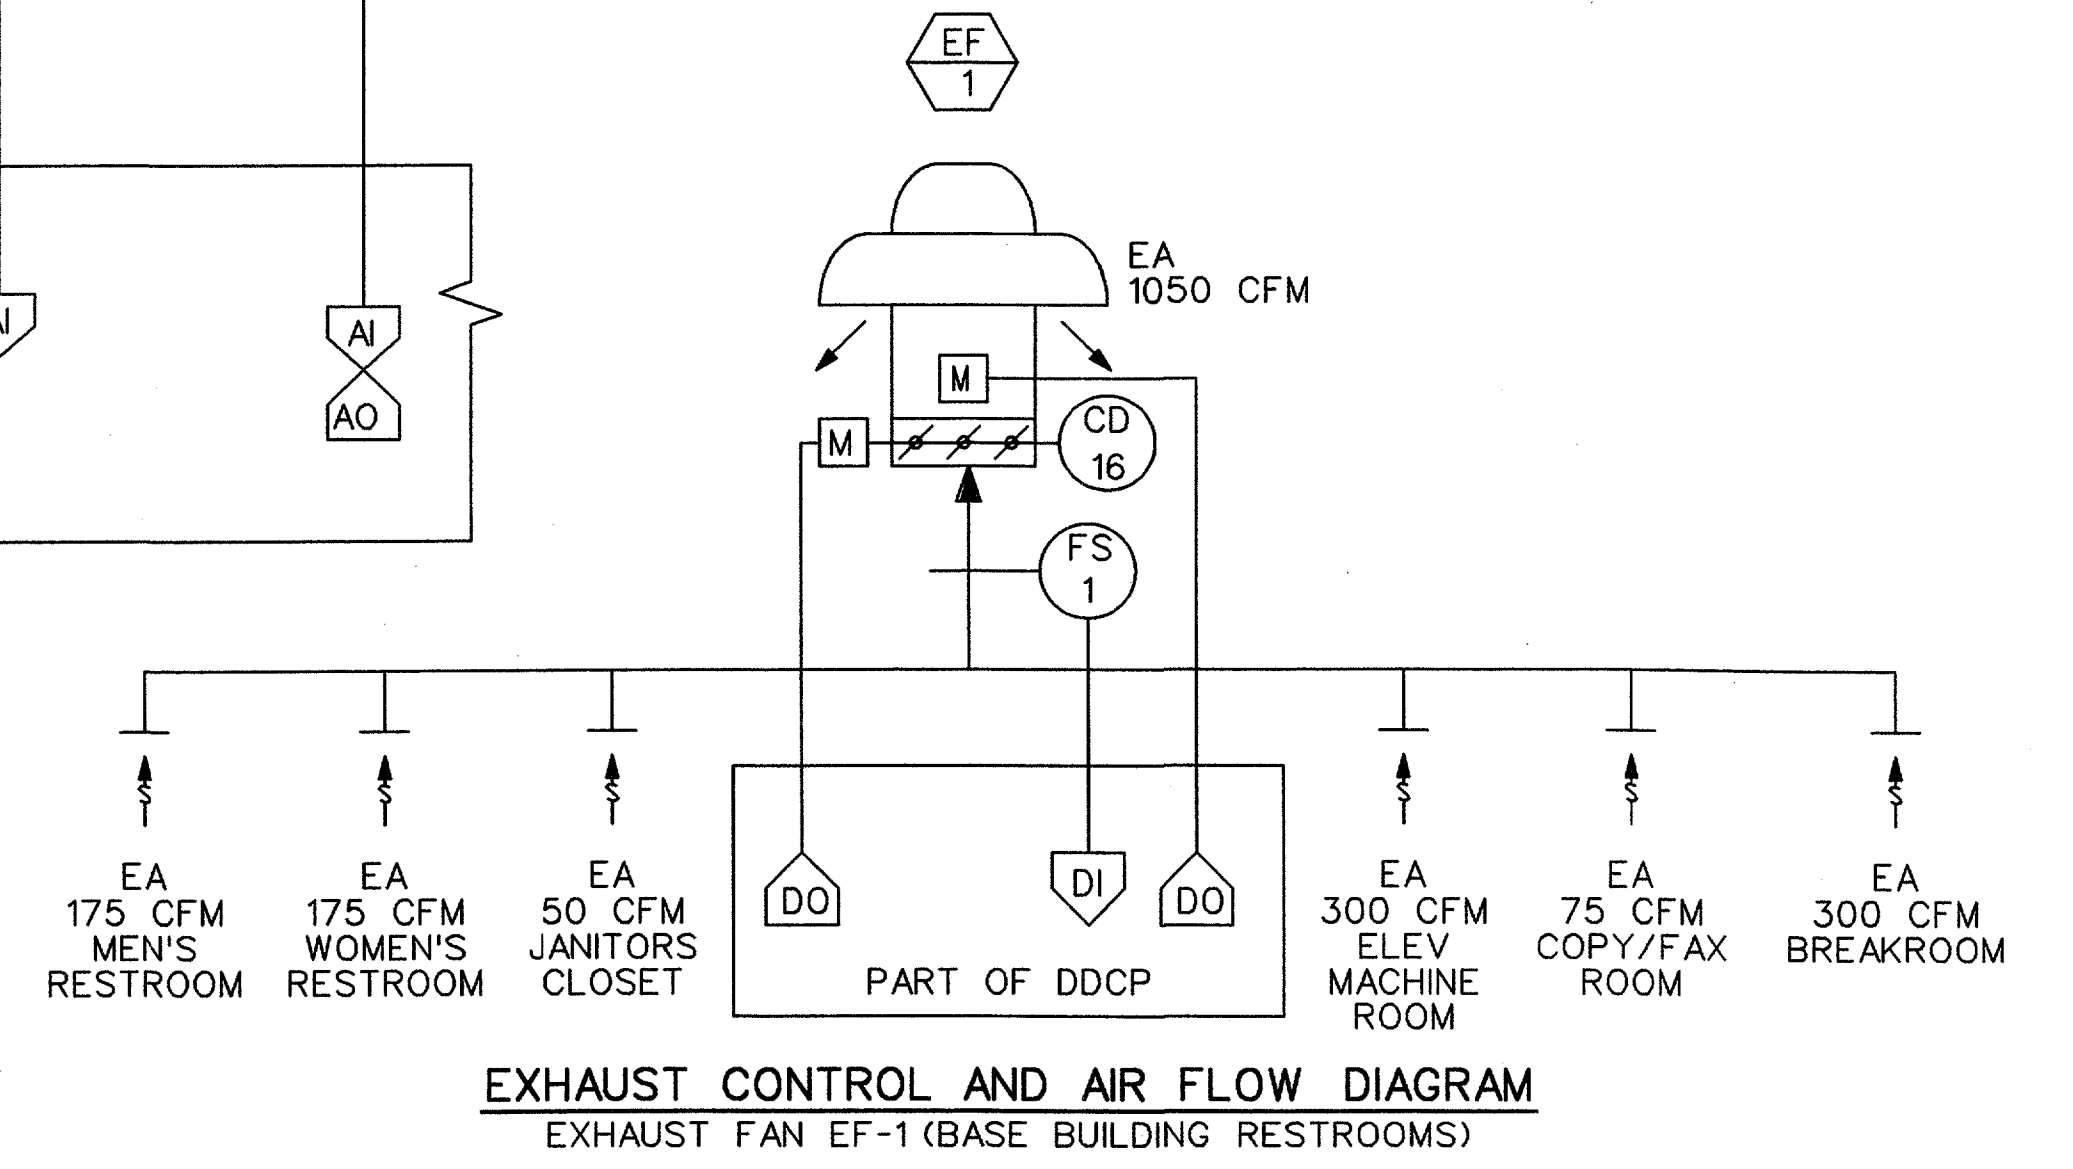

**EXHAUST CONTROL AND AIR FLOW DIAGRAM**  
EXHAUST FAN EF-1 (BASE BUILDING RESTROOMS)

- NOTES:**
- FOR GENERAL NOTES, SEE DRAWING M001-A.
  - FOR SEQUENCE OF OPERATION, SEE SPECIFICATION SECTION 15975.
  - PROVIDE CONNECTION TO THE FIRE ALARM CONTROL PANEL.

REV	DATE	DESCRIPTION	JCN	REDLINE DATE	APVD
A	06-23-03	FAA REDESIGN OF HVAC, JON 21874.	9700164	06-23-03	
DEPARTMENT OF TRANSPORTATION <b>FEDERAL AVIATION ADMINISTRATION</b> FORT WORTH IMPLEMENTATION CENTER FORT WORTH, TX LOW ACTIVITY LEVEL ATCT HVAC CONTROL DIAGRAMS BASE - EG BUILDING					
ADDISON		ADDISON AIRPORT		TX	
REVIEWED BY	SUBMITTED BY	APPROVED BY			
	<i>Ruben Medrano</i>	<i>Johnny L. White</i>		7/16/03	
DESIGNED	R. MEDRANO	ISSUED BY	DATE	JON 06-23-03	
DRAWN	KS	NAS IMPLEMENTATION	AN-600	DRAWING NO	9700164
CHECKED		AN-600		ADS-D-ATCT-M004	REV A