THIS DRAWING PRODUCED ON THE SOUTHWEST REGION MICROSTATION SYSTEM

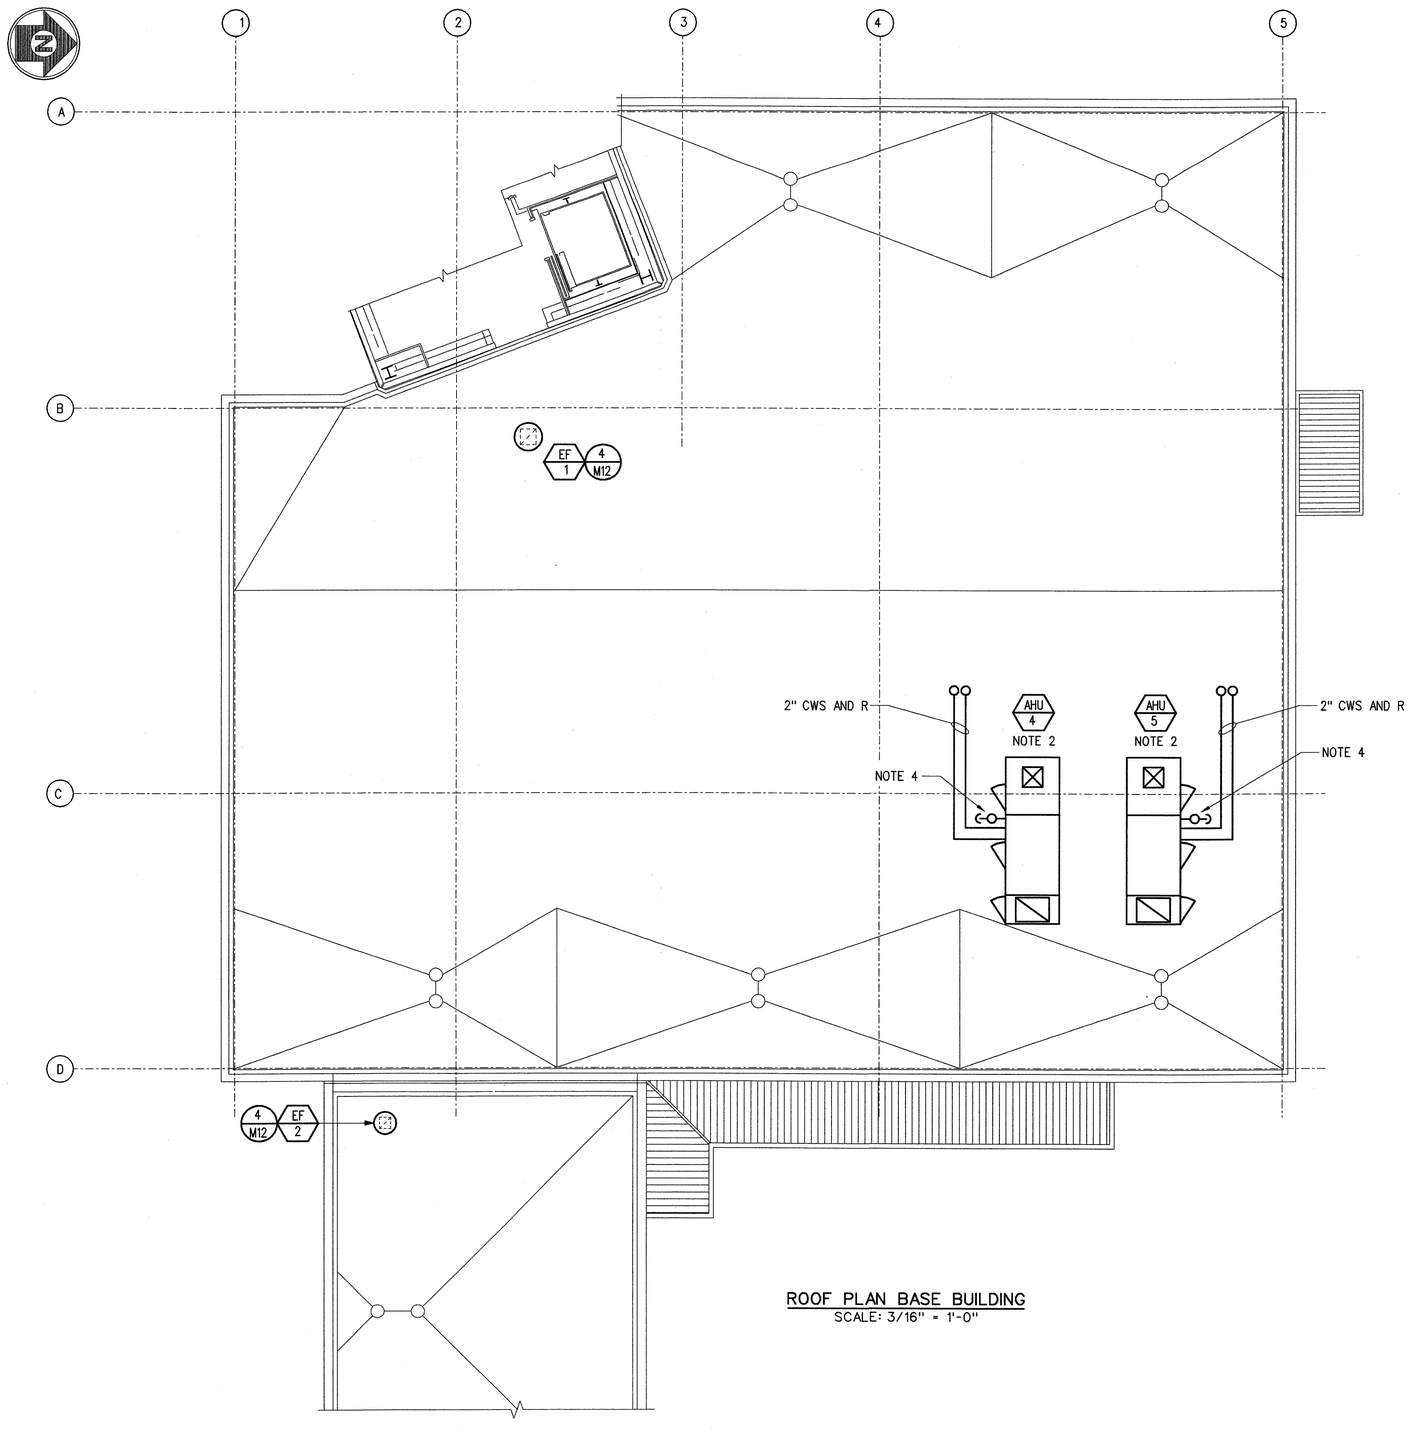

ROOF PLAN BASE BUILDING
SCALE: 3/16" = 1'-0"

NOTES:

1. FOR GENERAL NOTES, SEE DRAWING M001-A.
2. MOUNT ROOFTOP AIR HANDLING UNITS ON FACTORY MADE ROOF CURBS.
3. COORDINATE APPROVED ROOF MOUNTED WALKWAY EQUIPMENT WITH WALKWAY SHOWN ON SHEET A006-A.
4. 1 1/4" CONDENSATE LINE FOR EACH UNIT. ROUTE TO FS-1 IN ROOM 113.



4' 0 4' 8' 12'
SCALE: 3/16" = 1'-0"

REV	DATE	DESCRIPTION	JCN	REDLINE DATE	APVD
A	06-23-03	FAA REDESIGN OF HVAC, JON 21874.	9700164	06-23-03	

DEPARTMENT OF TRANSPORTATION
FEDERAL AVIATION ADMINISTRATION
FORT WORTH IMPLEMENTATION CENTER — FORT WORTH, TX

LOW ACTIVITY LEVEL ATCT
HVAC
ROOF PLAN
BASE-EG BUILDING

ADDISON — ADDISON AIRPORT — TX

REVIEWED BY
SUBMITTED BY: 7/21/03 — PROJECT ENGINEER, ANI-630
APPROVED BY: 7/18/03 — PLATFORM MANAGER, ANI-630
DESIGNED: M. DOERR
DRAWN: LTM
CHECKED
ISSUED BY: NAS IMPLEMENTATION ANI-600
DATE: 06-23-03
JCN: 9700164
DRAWING NO: ADS-D-ATCT-M009
REV: A

m:\ads\atct\active\ads-d-atct-m009-a.dgn
07/17/2003 04:54:04 PM kasm