
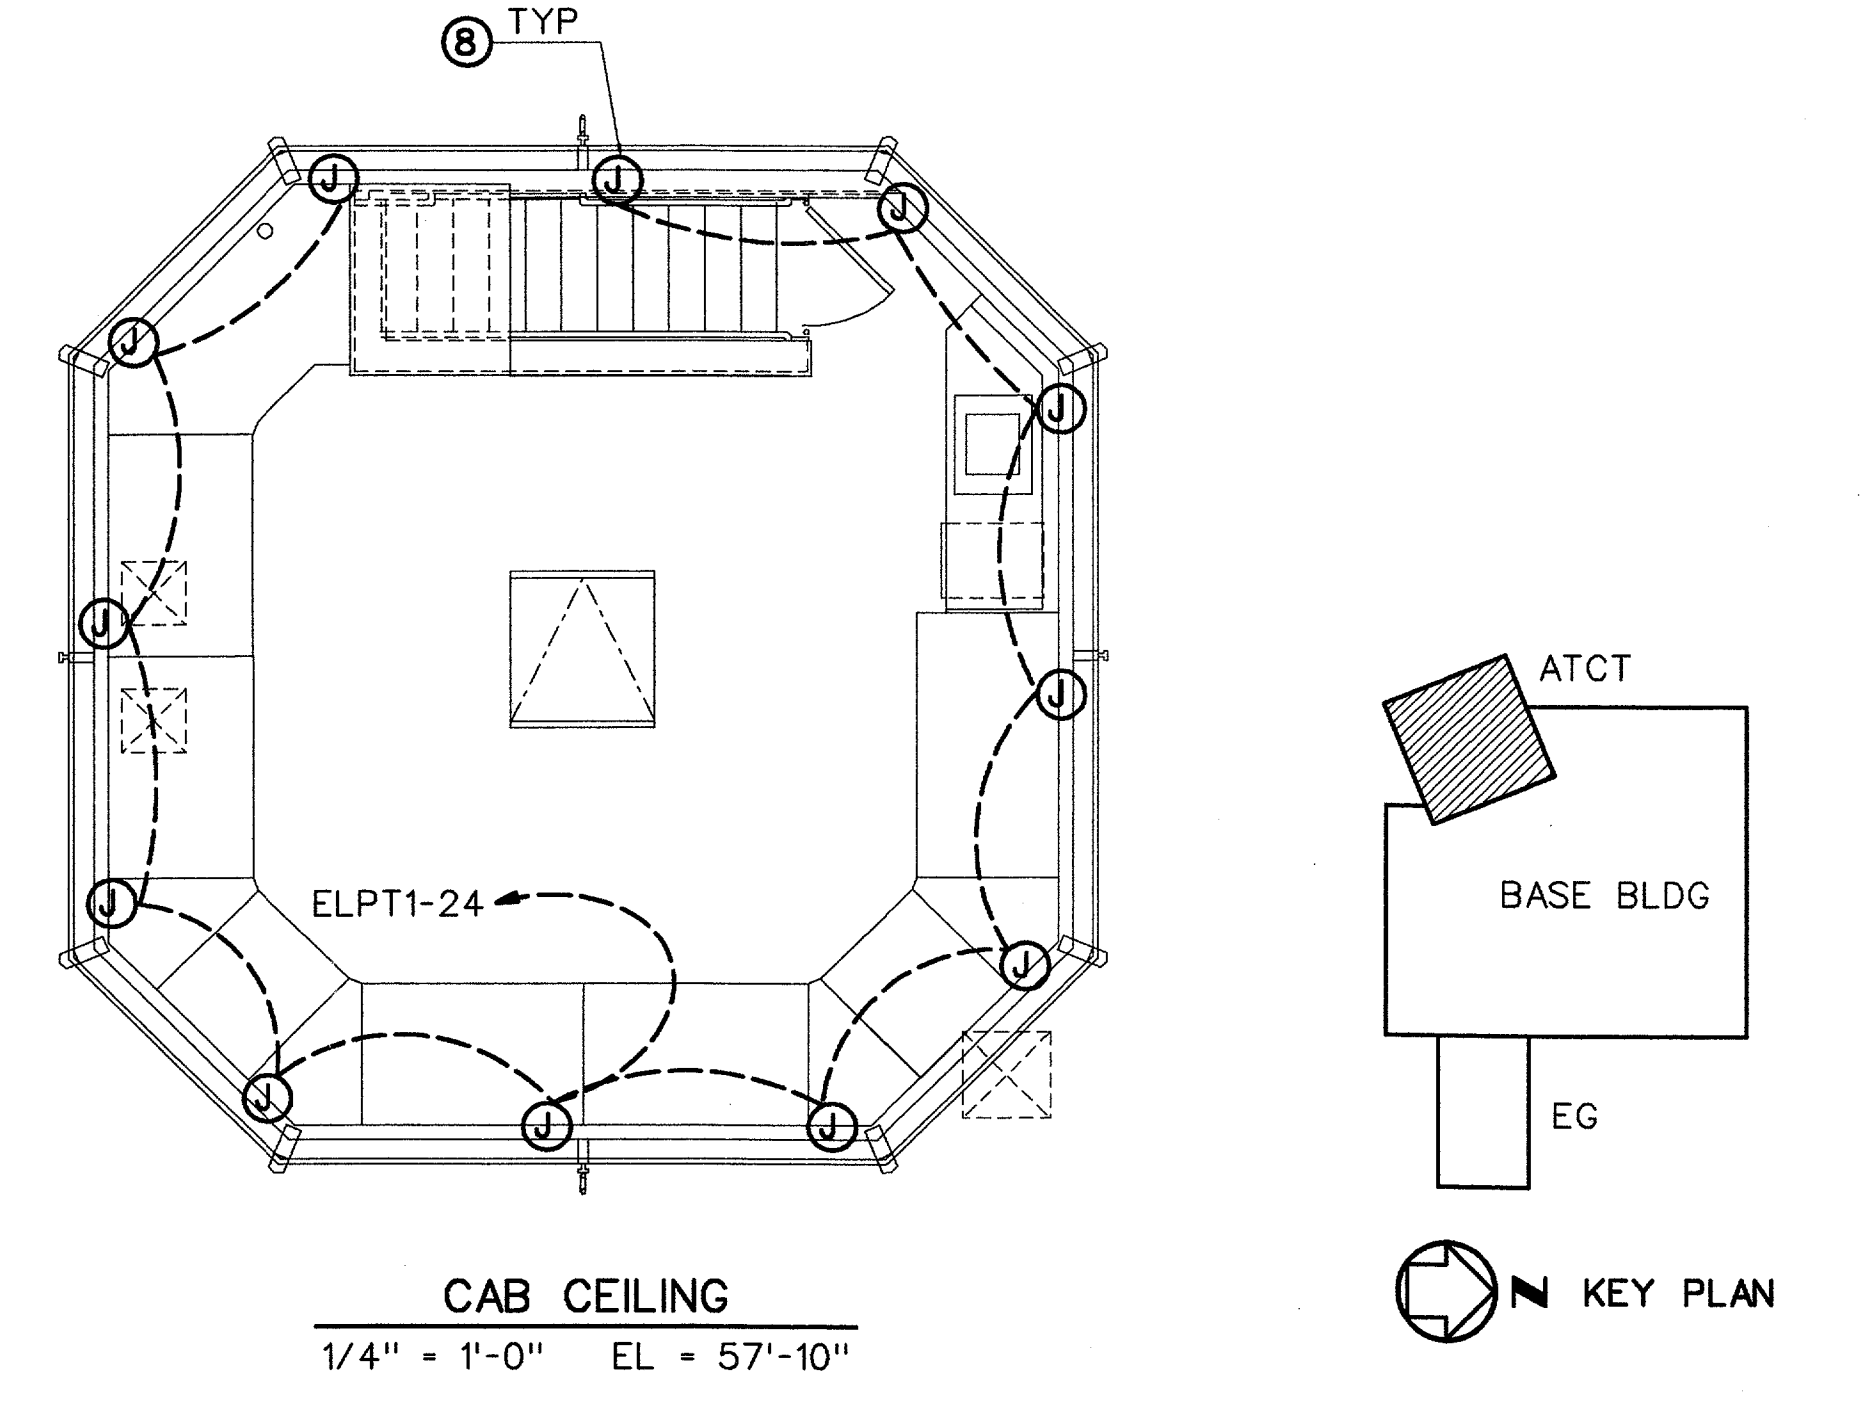


THIS DRAWING PRODUCED ON THE SOUTHWEST REGION MICROSTATION SYSTEM


ROOM SCHEDULE	
RM NO.	ROOM NAME
CA1	CABLE ACCESS
CAB	CAB
S2	CAB STAIR

- NOTES:**
- TWO SECURITY MONITORS, SWITCHER AND REMOTE DOOR RELEASE PANEL SHALL BE PROVIDED IN THE CAB. COORDINATE EXACT LOCATION WITH COR.
 - INSTALL NO.6 BARE COPPER GROUND WIRE IN ALL CABLE TRAY.
 - REFER TO DRAWING E041 FOR CONDUIT SIZE AND CIRCUIT INFORMATION ON MECHANICAL EQUIPMENT.
 - INSTALL CONTROL STATION FOR HOIST ON END OF SIX FOOT "SO" TYPE CABLE SO CONTROLLER CAN BE STORED AWAY.
 - COORDINATE EXACT LOCATION OF EQUIPMENT IN THIS AREA WITH COR.
 - PROVIDE CONDUIT AND WIRES, PER MANUFACTURERS WIRING DIAGRAMS, TO E/G MONITOR PANEL.

- SPECIAL NOTES:**
- TO RECEPTACLE ABOVE
 - TO RECEPTACLE BELOW
 - TO CAB WINDOW DEFOGGER SWITCH PANEL.
 - TO VACUUM OUTLET IN CAB.
 - EXTEND WIRING FROM J-BOX UP WINDOW MULLION TO HOIST.
 - MOUNT ABOVE COUNTER TOP FOR COFFEE MAKER.
 - MOUNT UNDER COUNTER FOR REFRIGERATOR
 - JUNCTION BOX. LOCATE FOR ELECTRICAL WINDOW SHADE. (TYP FOR 12). CONNECT SHADE. VERIFY LOCATION.

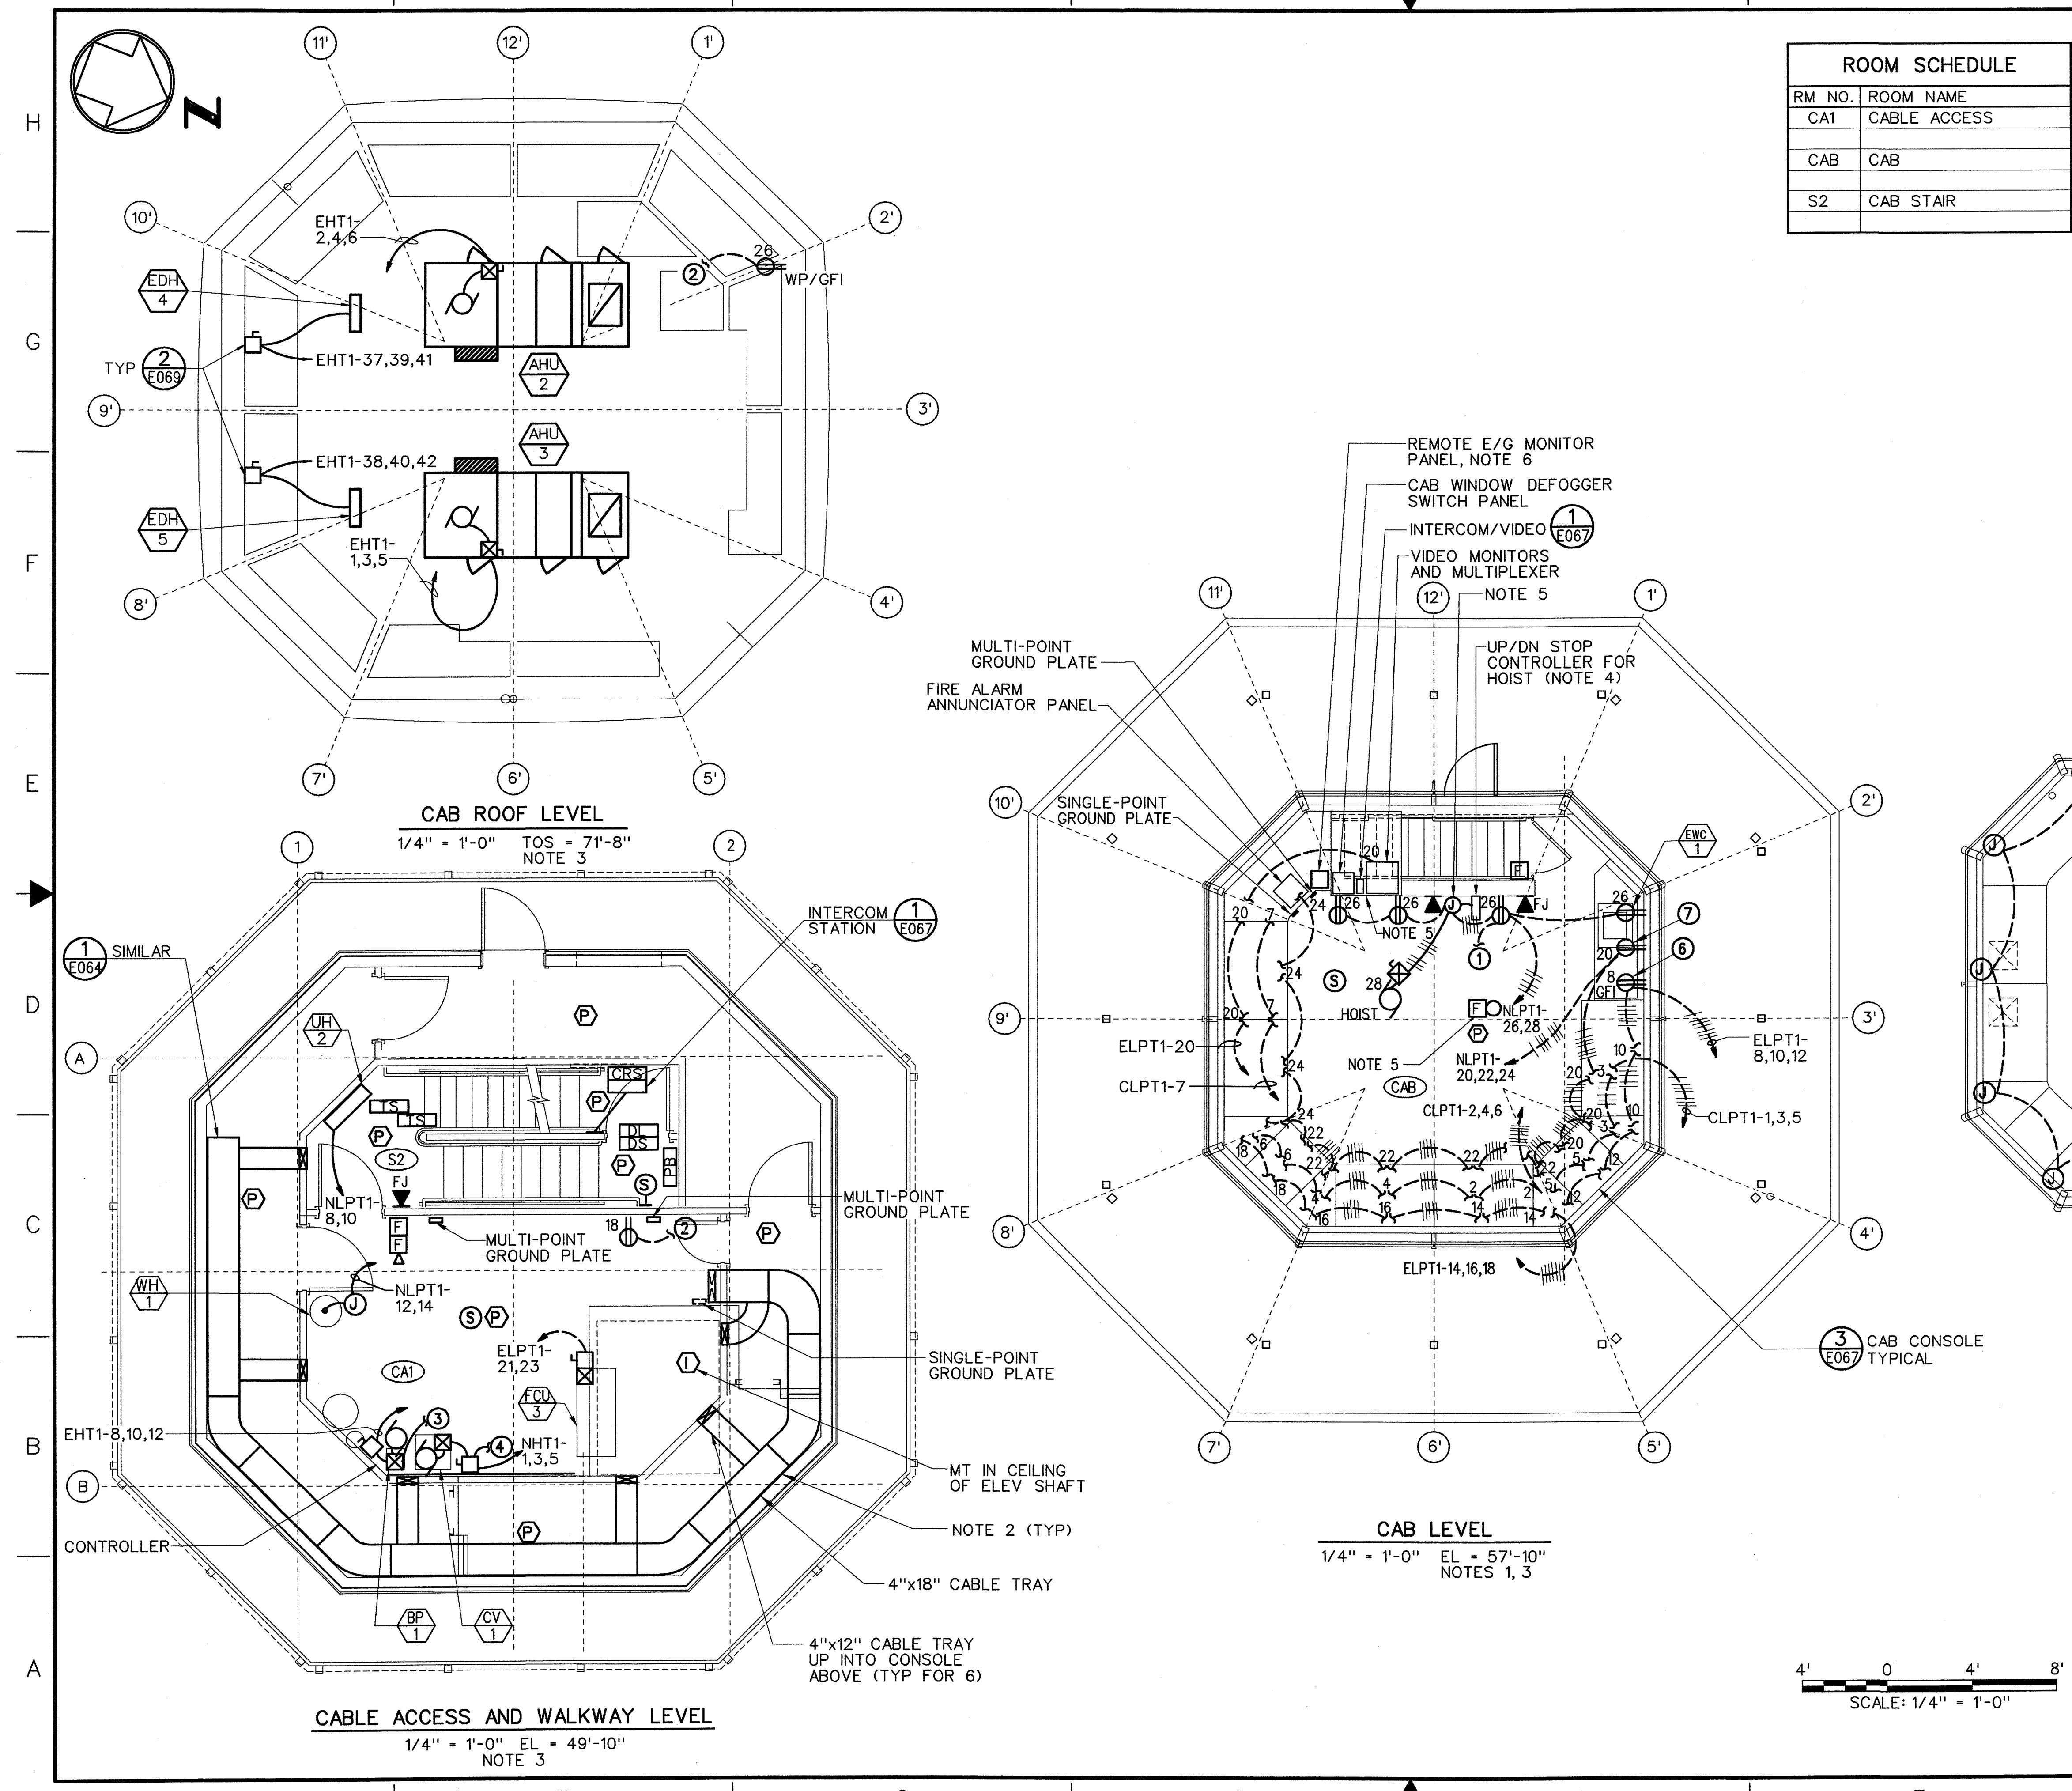

A 06-23-03		FAA REDESIGN OF HVAC, JON 21874.	9700164	06-23-03
REV	DATE	DESCRIPTION	JCN	REDLINE DATE
DEPARTMENT OF TRANSPORTATION FEDERAL AVIATION ADMINISTRATION PORT WORTH IMPLEMENTATION CENTER PORT WORTH, TX LOW ACTIVITY LEVEL ATCT POWER PLANS ATCT				
ADDISON		ADDISON AIRPORT		TX
REVIEWED BY	SUBMITTED BY		APPROVED BY	
	<i>M. A. Lu...</i> 7/18/03		<i>Johnnie A. White</i> 7/18/03	
DESIGNED	PROJECT ENGINEER, ANI-630		PLATFORM MANAGER, ANI-630	
DRAWN	M. DOERR	ISSUED BY	DATE	06-23-03
CHECKED	RR/LB	NAS IMPLEMENTATION ANI-600	DRAWING NO	9700164
			REV	A
			ADS-D-ATCT-E012	

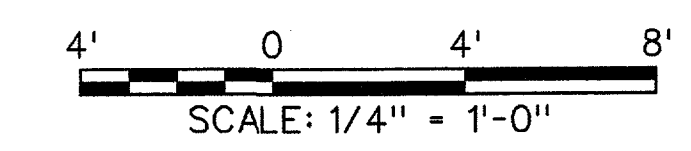

m:\data\active\addison-airport\atct-e012-a.dgn 07/17/2003 04:55:16 PM ksem