




Door Schedule															
Arch No.	Ext.	S / PR.	Width	Height	Thickness	Fire Label	Frame Mat.	Frame Type	Jamb Depth	Head	Jamb	Door Mat.	Door Type	HDW.	Comments
A101	Yes	PR	6'-8"	7'-10"	2"		Alum.	H2		12/A301	13/A301	Alum.	B	Set 10.10.73	
A102	Yes	S	3'-0"	7'-0"	1 3/4"		H.M.	H1	5 7/8"	13/A301	13/A301	H.M.	A	Set 26.00.73	
A103	No	S	3'-4"	7'-0"	1 3/4"		Wd.	-	6 1/2"	8/A301	9/A301	Wd.	A	Set 96.30.00	
A104	No	S	3'-4"	7'-0"	1 3/4"		Wd.	-	6 1/2"	8/A301	9/A301	Wd.	A	Set 96.30.00	
A105	No	S	3'-4"	7'-0"	1 3/4"		Wd.	-	6 1/2"	8/A301	9/A301	Wd.	A	Set 96.60.00	
A106	No	S	3'-4"	7'-0"	1 3/4"		Wd.	-	6 1/2"	8/A301	9/A301	Wd.	A	Set 96.60.00	
A201	No	S	3'-0"	7'-0"	1 3/4"		H.M.	-	5 7/8"	3/A301	4/A301	H.M.	A	Set 26.40.01	

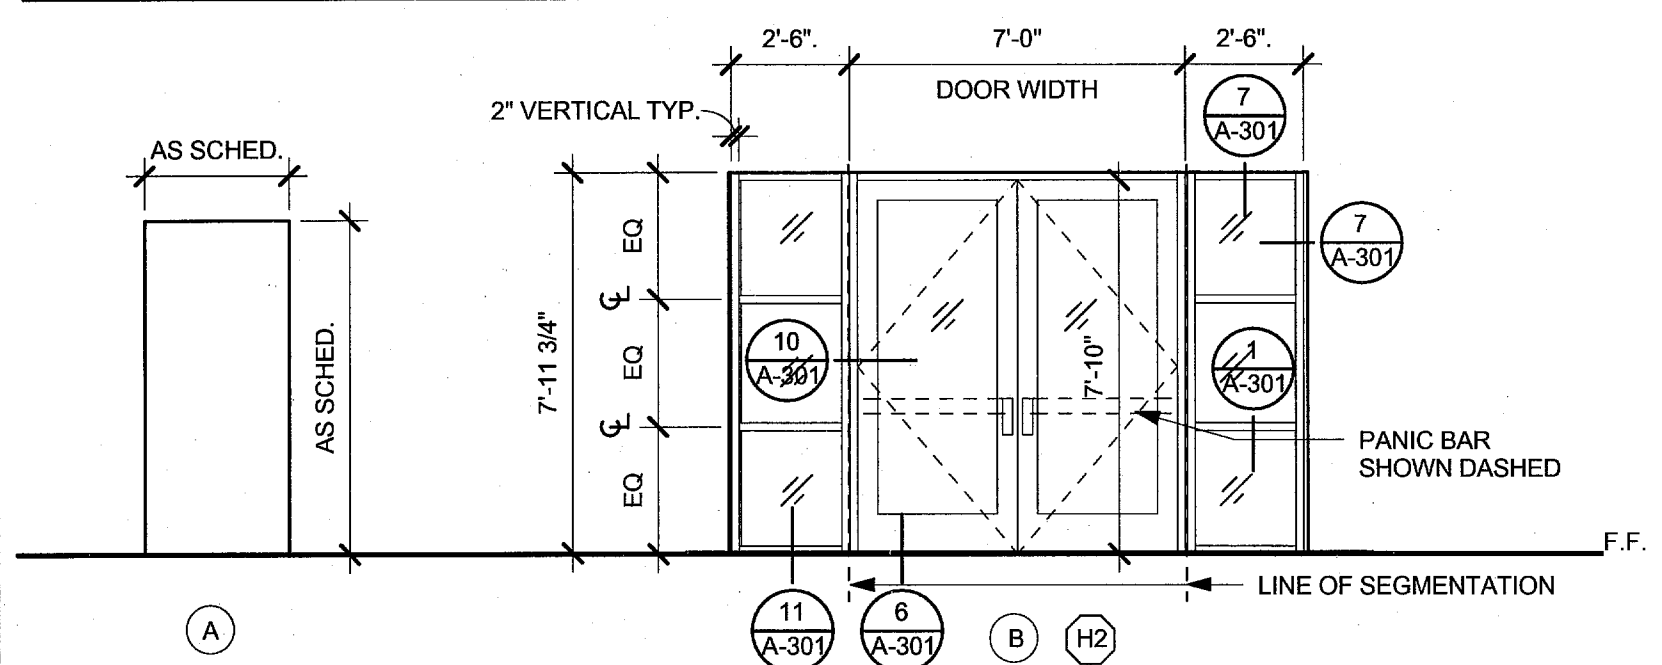


2 Schedule Door Type
1/4" = 1'-0"

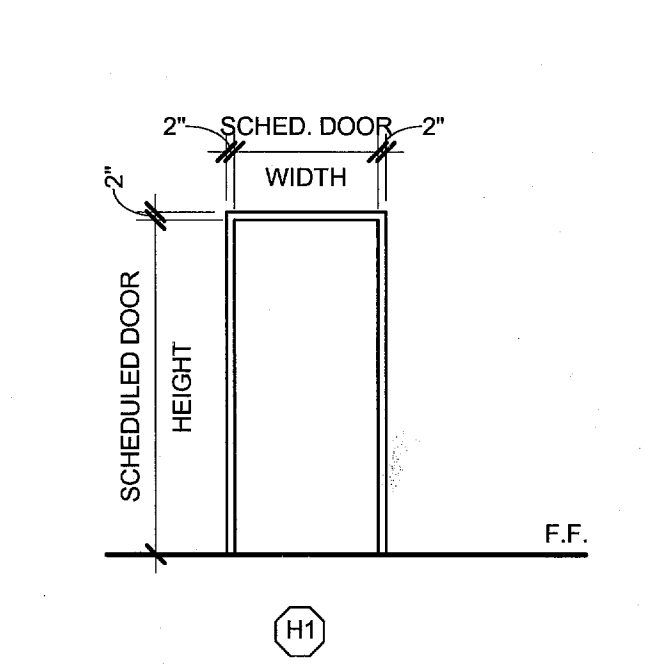


3 Hollow Metal Frame Type
1/4" = 1'-0"

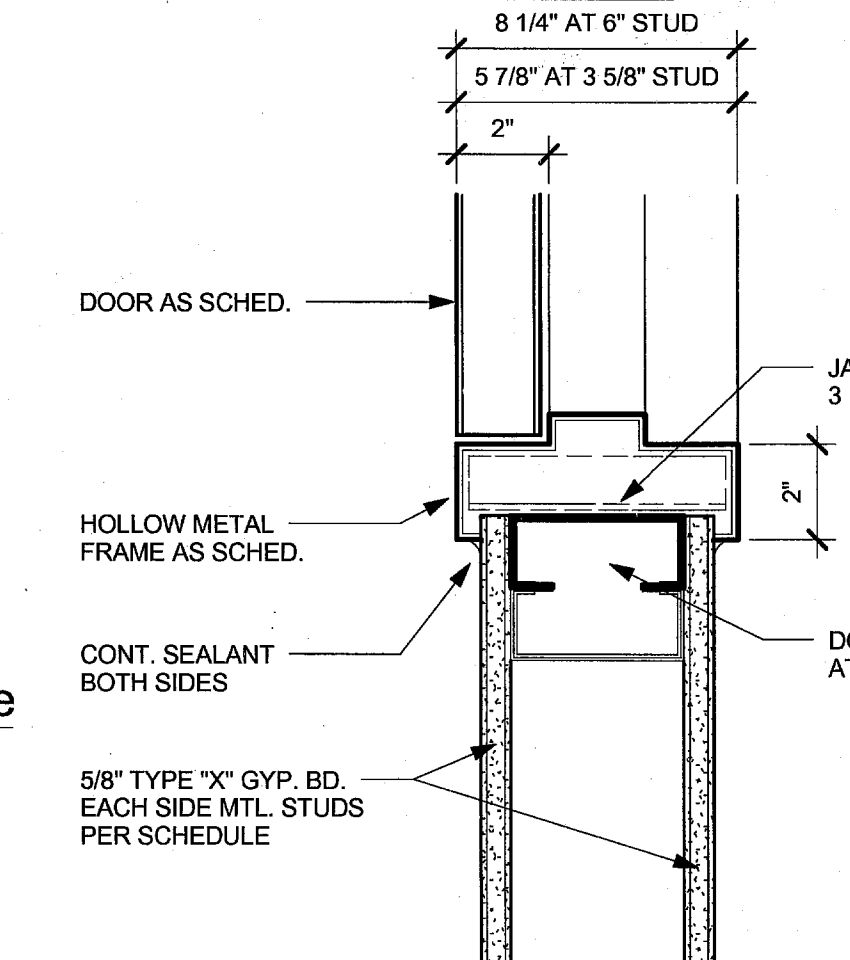


4 Int. H.M. Door Jamb at Metal Stud
3" = 1'-0"

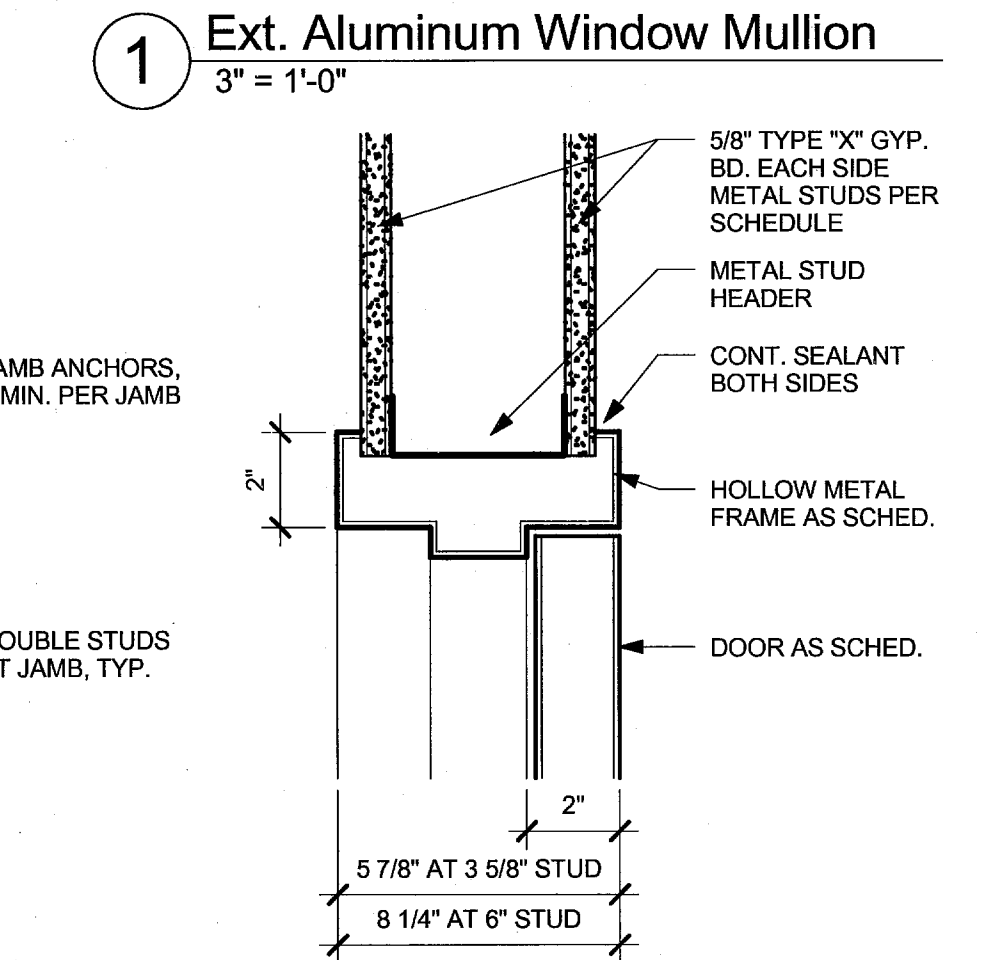


5 Ext. Aluminum Window Mullion
3" = 1'-0"

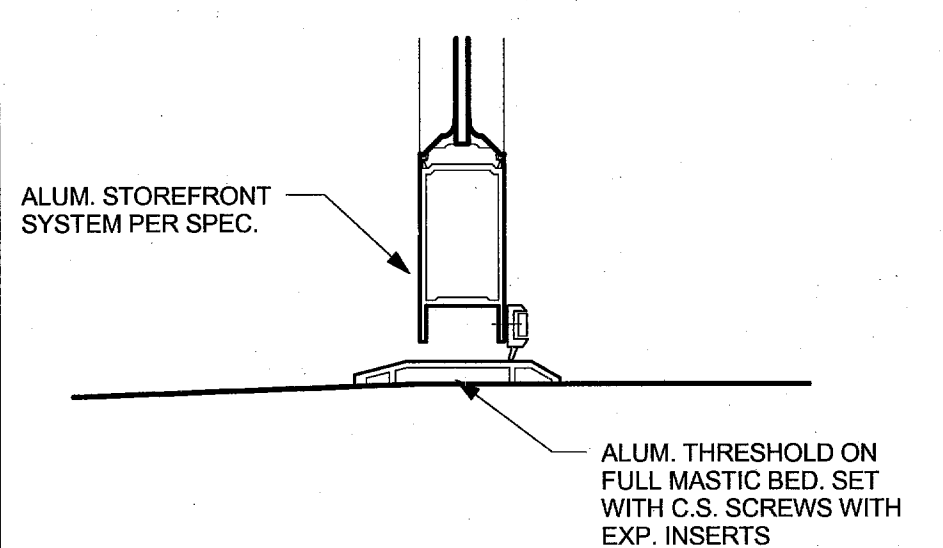


6 Ext. Alum. Door Sill
3" = 1'-0"

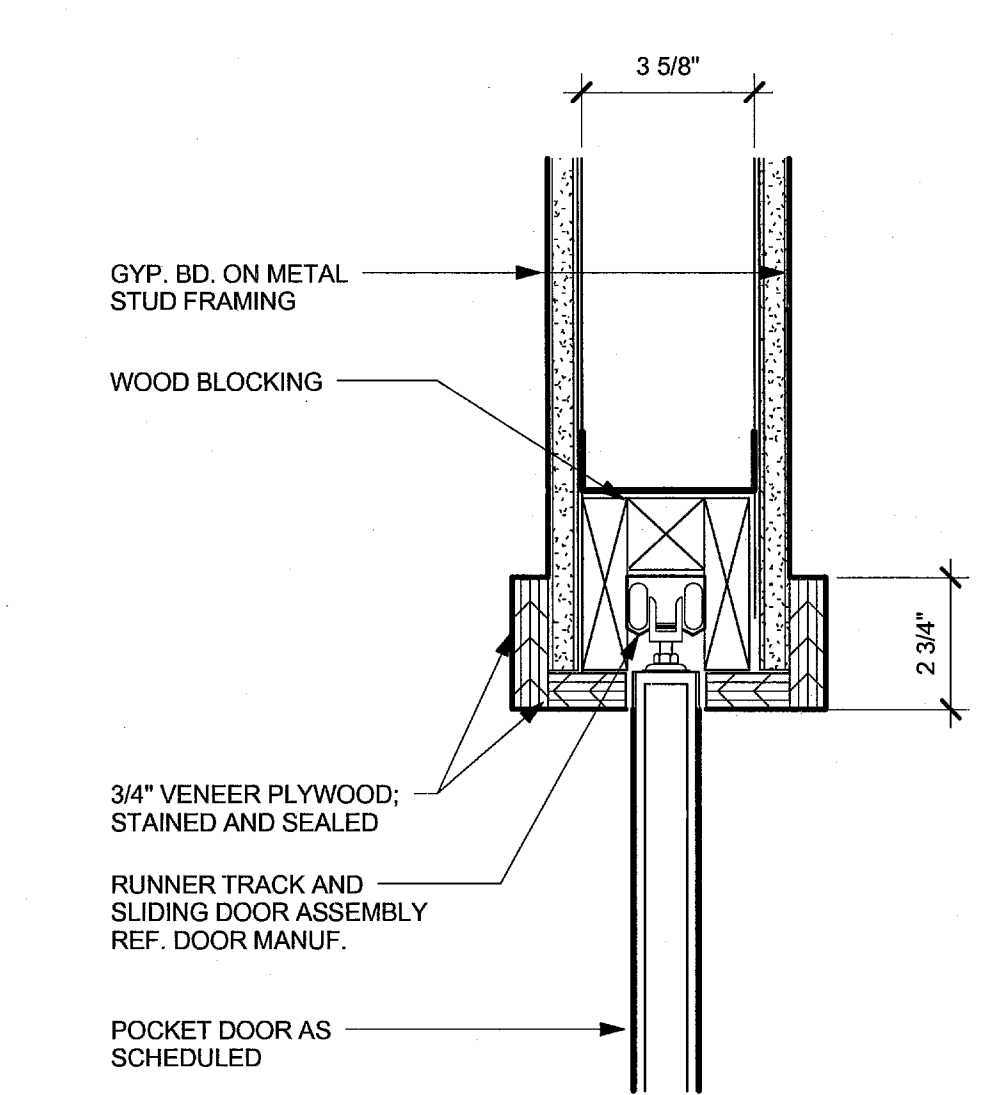


8 Pocket Door Head
3" = 1'-0"

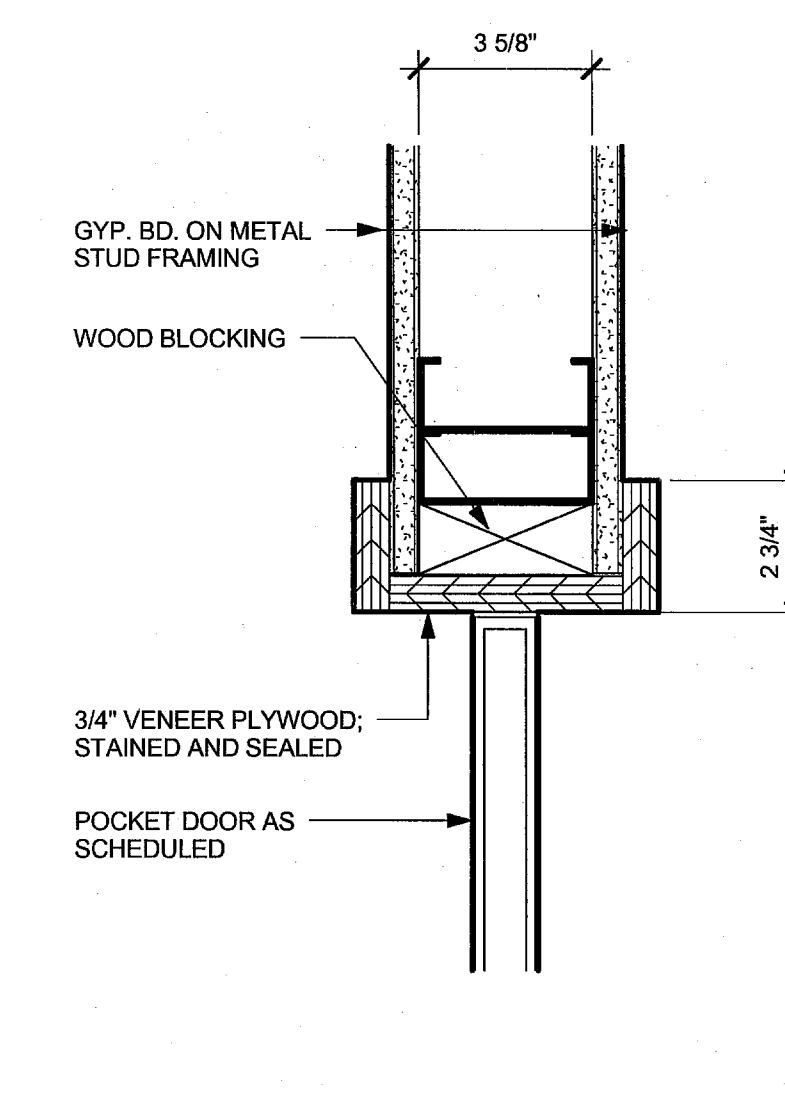


9 Pocket Door Jamb
3" = 1'-0"

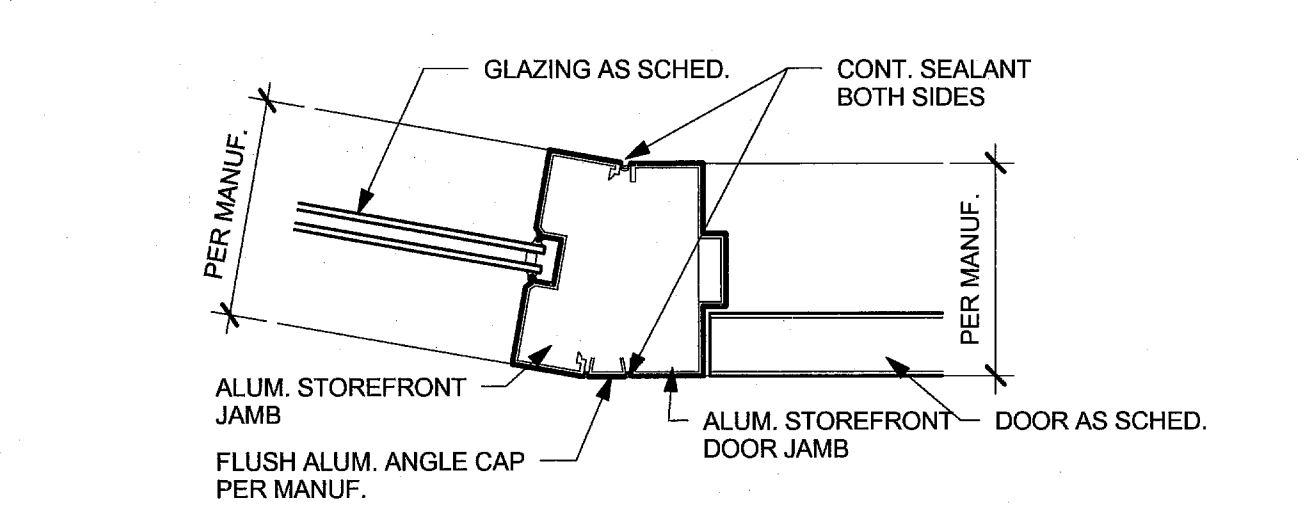


10 Ext. Alum. Angle Window Mullion
3" = 1'-0"

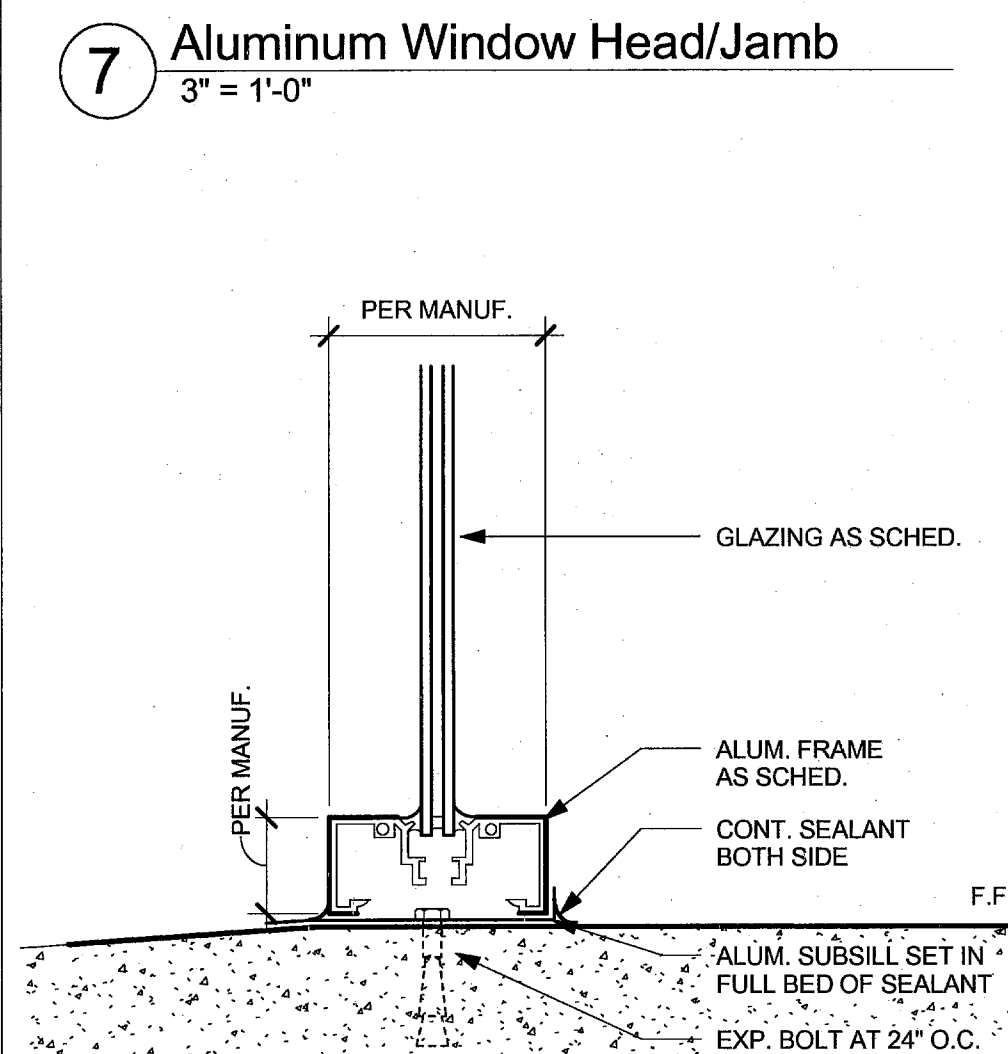


7 Aluminum Window Head/Jamb
3" = 1'-0"

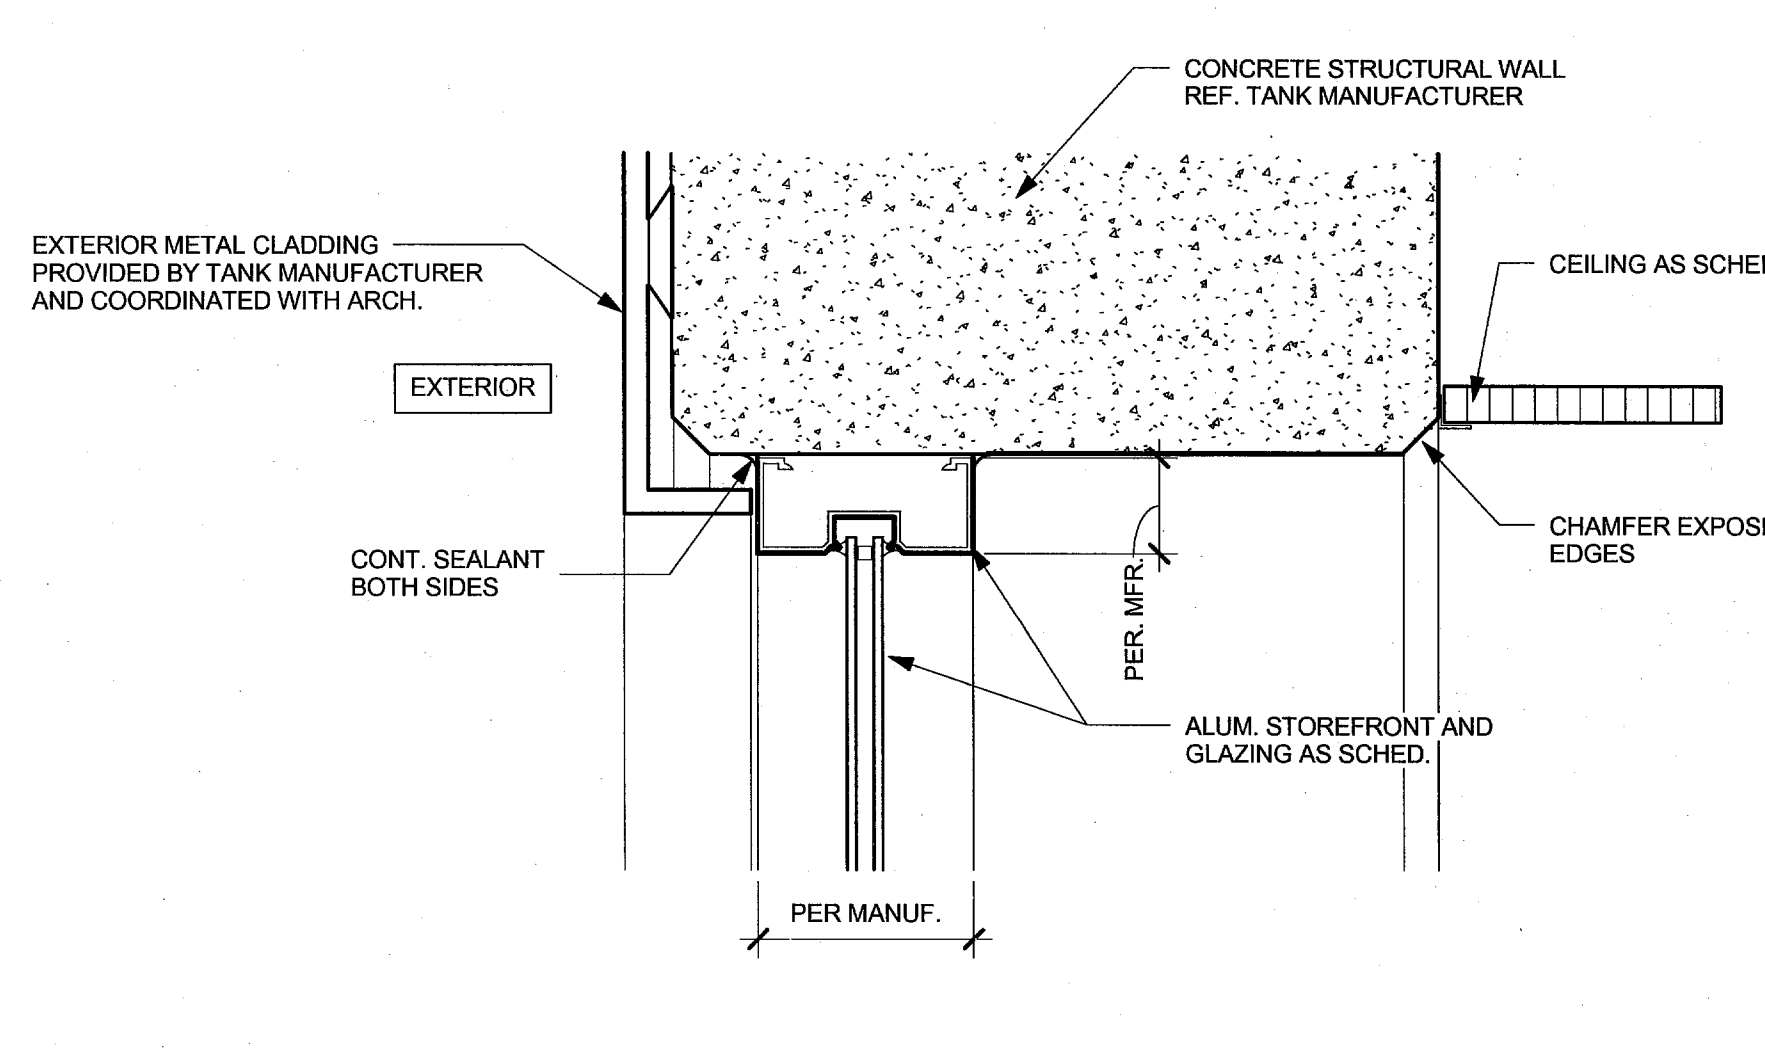

11 Ext. Aluminum Storefront Sill
3" = 1'-0"

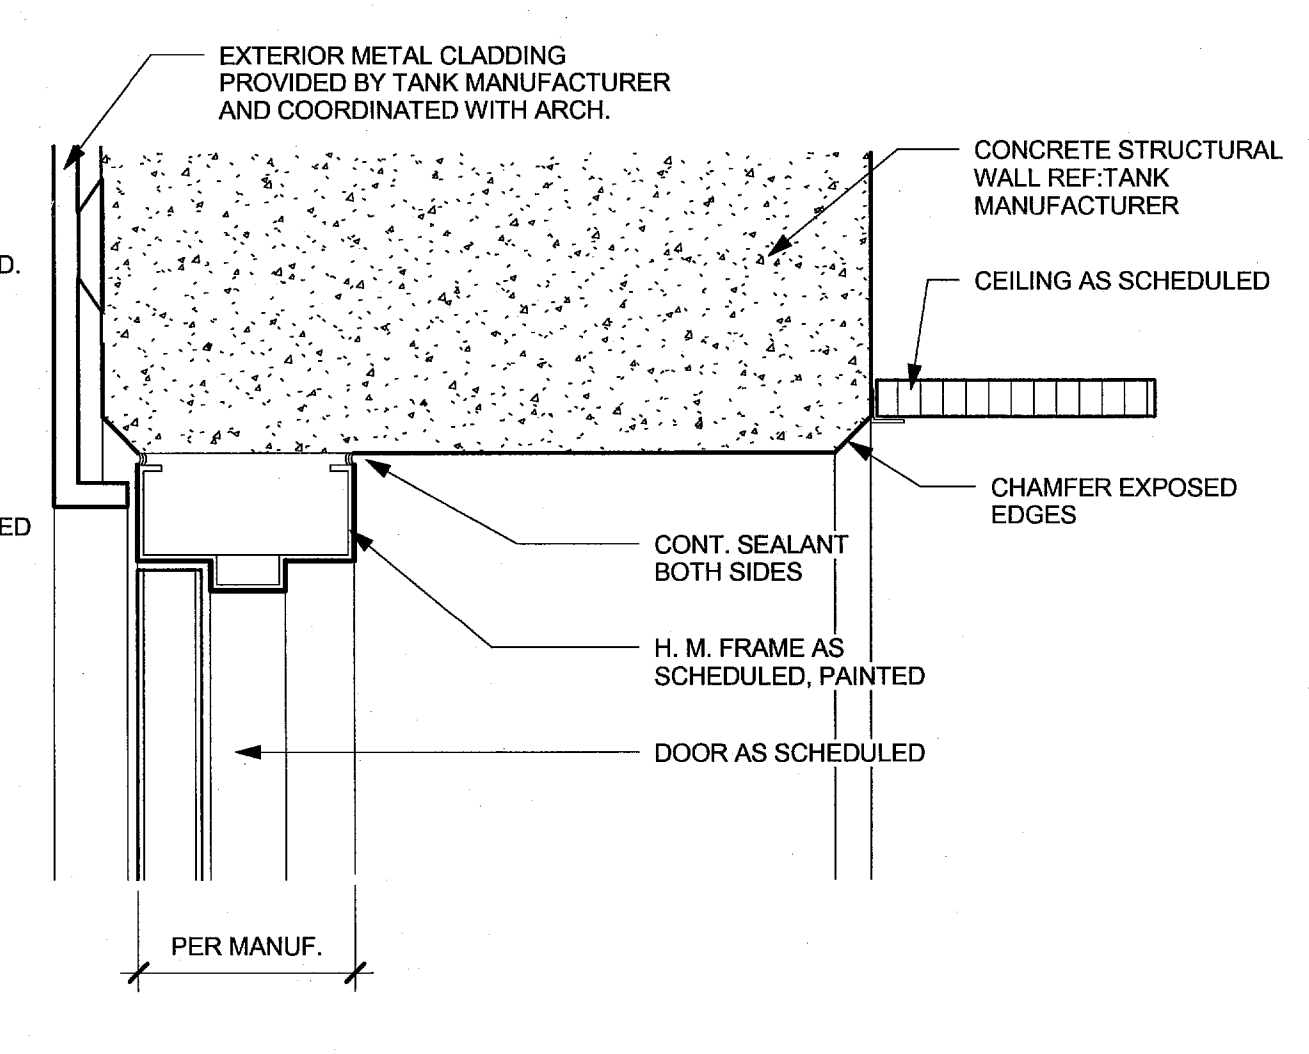


13 Ext. H.M. Door Head (Jamb Sim.) - Concrete
3" = 1'-0"

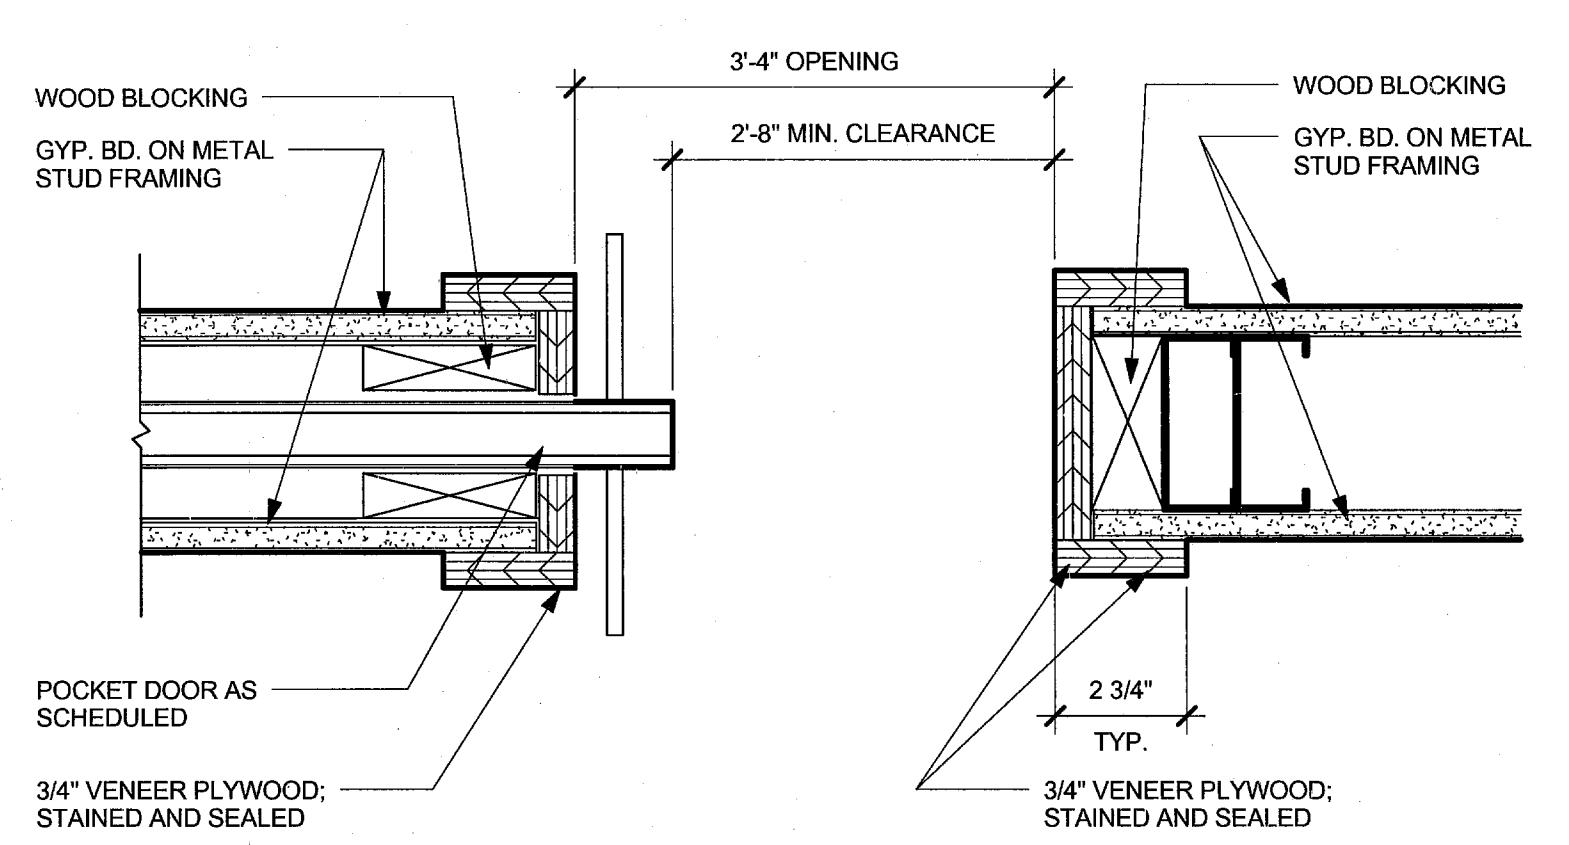

14 Pocket Door Closing Detail
3" = 1'-0"

PARTITION HEAD DETAIL SCHEDULE	
TYPE	DESCRIPTION
CN	BRACE TO STRUCTURE ABOVE AS REQUIRED LAY-IN CEILING ACOUSTICAL BATTLS WHERE SCHEDULED PARTITION AS SCHEDULED

PARTITION SCHEDULE			
TYPE	WALL THICKNESS	DESCRIPTION	U.L. DESIGN NUMBER WHERE SCHEDULED
A 3 5/8" STUDS	4 7/8"	1 LAYER OF 5/8" GYPSUM BOARD PARTITION TYPE A - 3 5/8" METAL STUDS AT 16" O.C.	U465 - 1HR
B 6" STUDS	7 1/4"	1 LAYER OF 5/8" GYPSUM BOARD PARTITION TYPE B - 6" METAL STUDS AT 16" O.C.	
F 3 5/8" STUDS	4 1/4"	METAL STUDS AT 16" O.C.	
G 6" STUDS	6 5/8"	2 LAYERS OF 5/8" GYPSUM BOARD	
X	5 7/8"	1" VERTICAL Z-FURRING @ 16" O.C. HORIZONTALLY TYPE 'X': EXTERIOR CONCRETE WALL 1 LAYER OF 5/8" GYPSUM BOARD 1" RIGID INSULATION WHERE SCHEDULED METAL STUDS AT 16" O.C.	

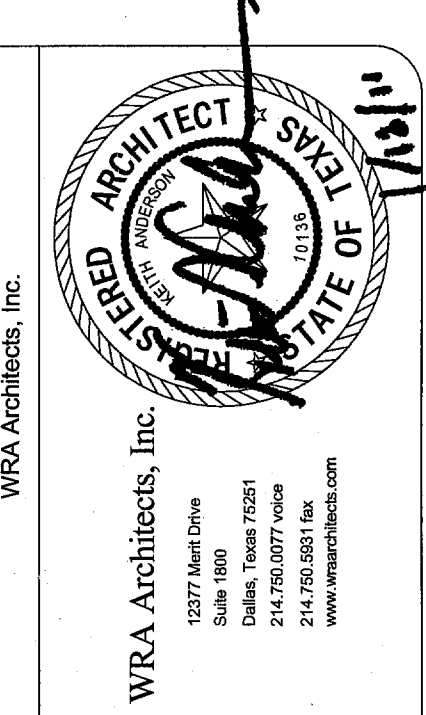

FRESE NICHOLS
2220 San Jacinto Blvd., Suite 330
Denton, Texas 76205
Phone - (840) 387-4600
Fax - (840) 387-4677
Web - www.frese.com

Town of Addison, Texas
SURVEYOR 1.5 MG EST
ARCHITECTURE
Door Schedules/ Details

NO.	DATE	ISSUE	BY	FILE NAME
ADD08499	01/18/11	DESIGNED	SMN	
		DRAWN	SMN	
		REVIEWED		
		CHECKED		