




1
OBSTRUCTION LIGHT
NOT TO SCALE

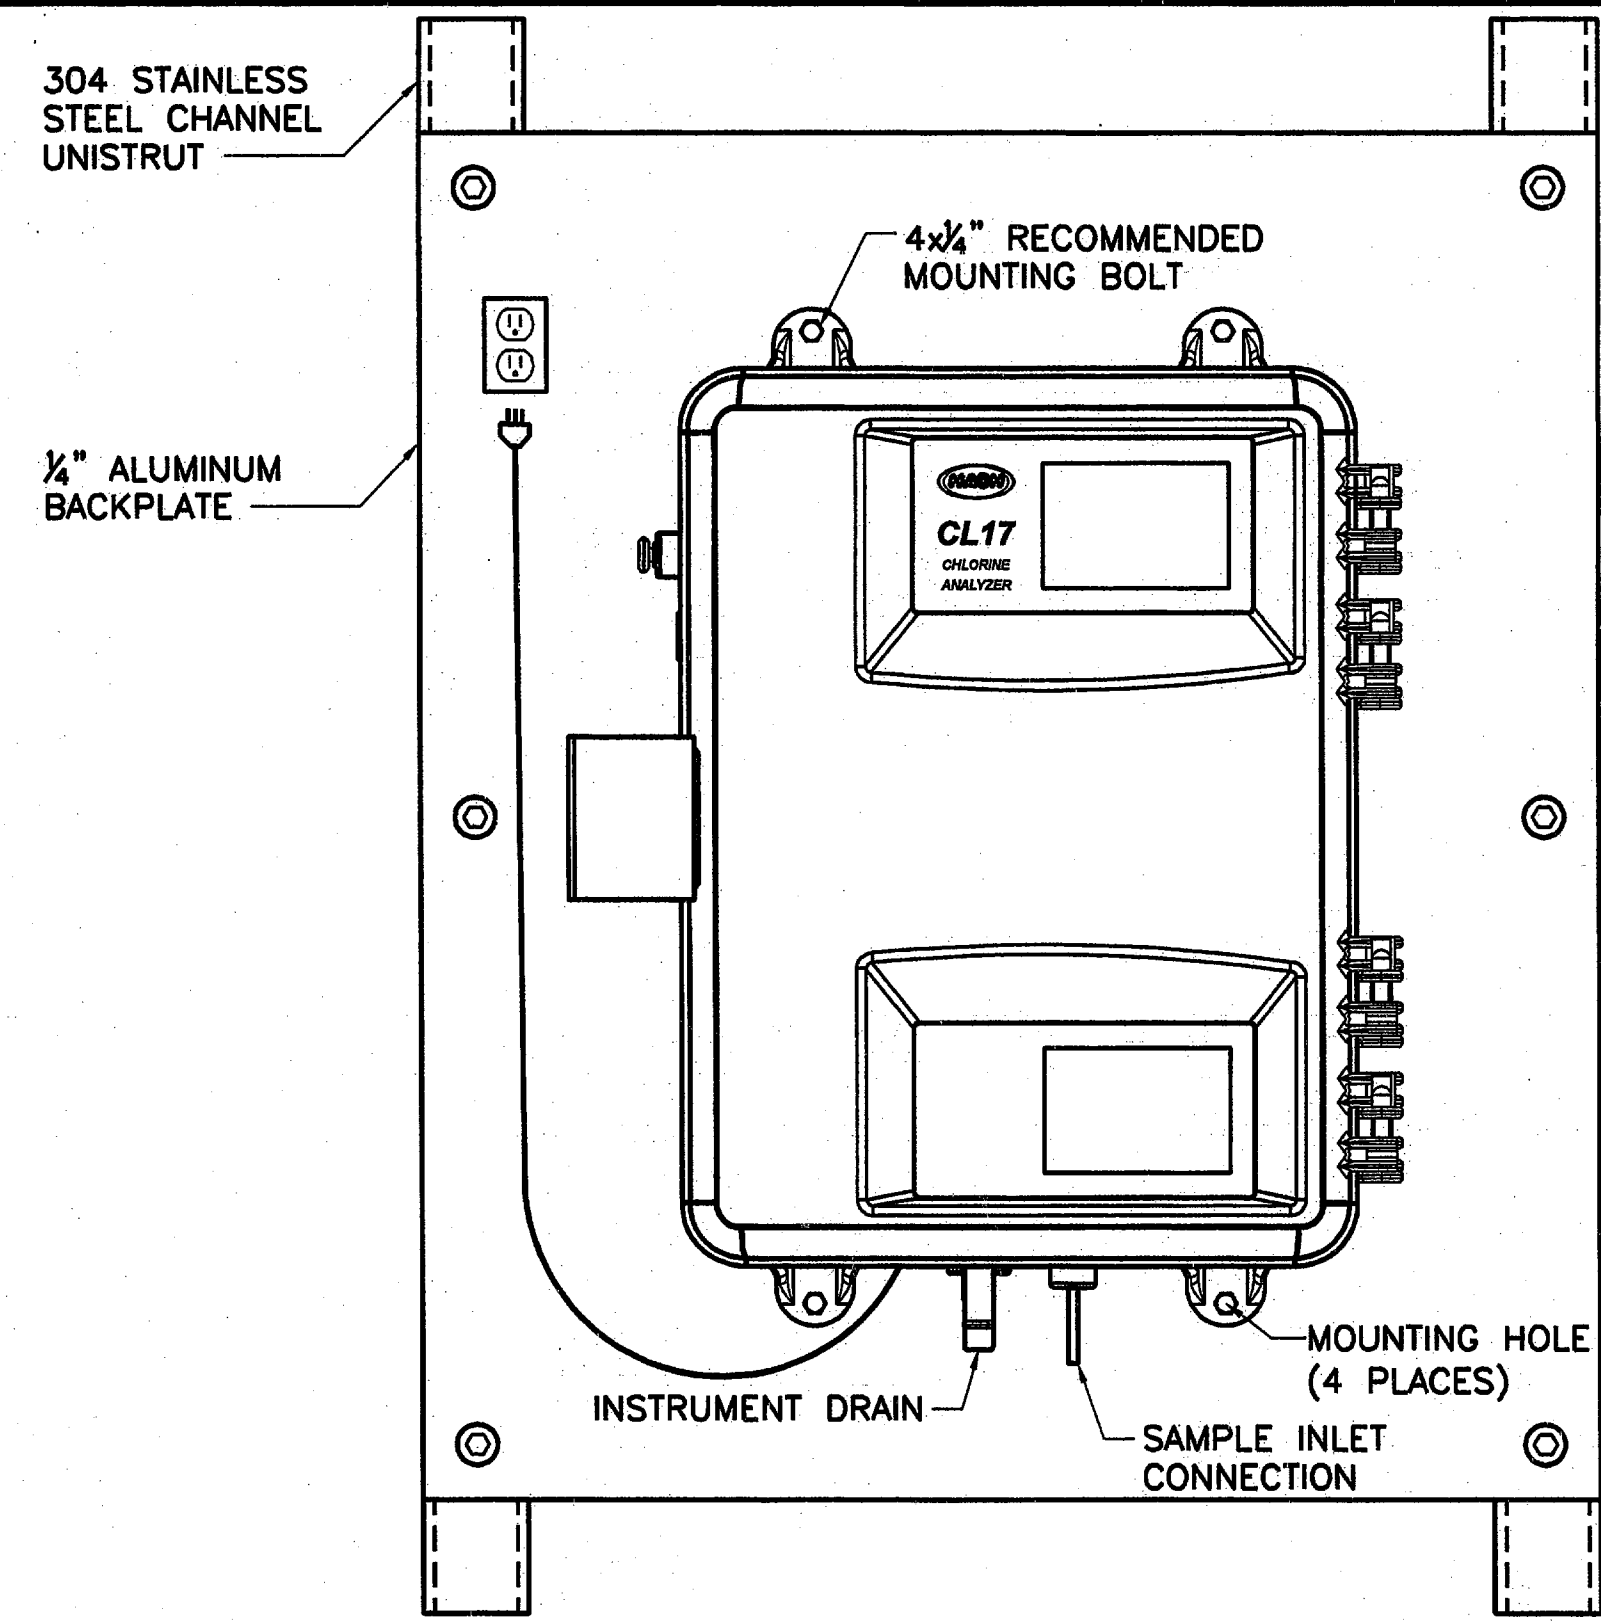

2
CHLORINE MONITOR MOUNTING DETAIL
NOT TO SCALE

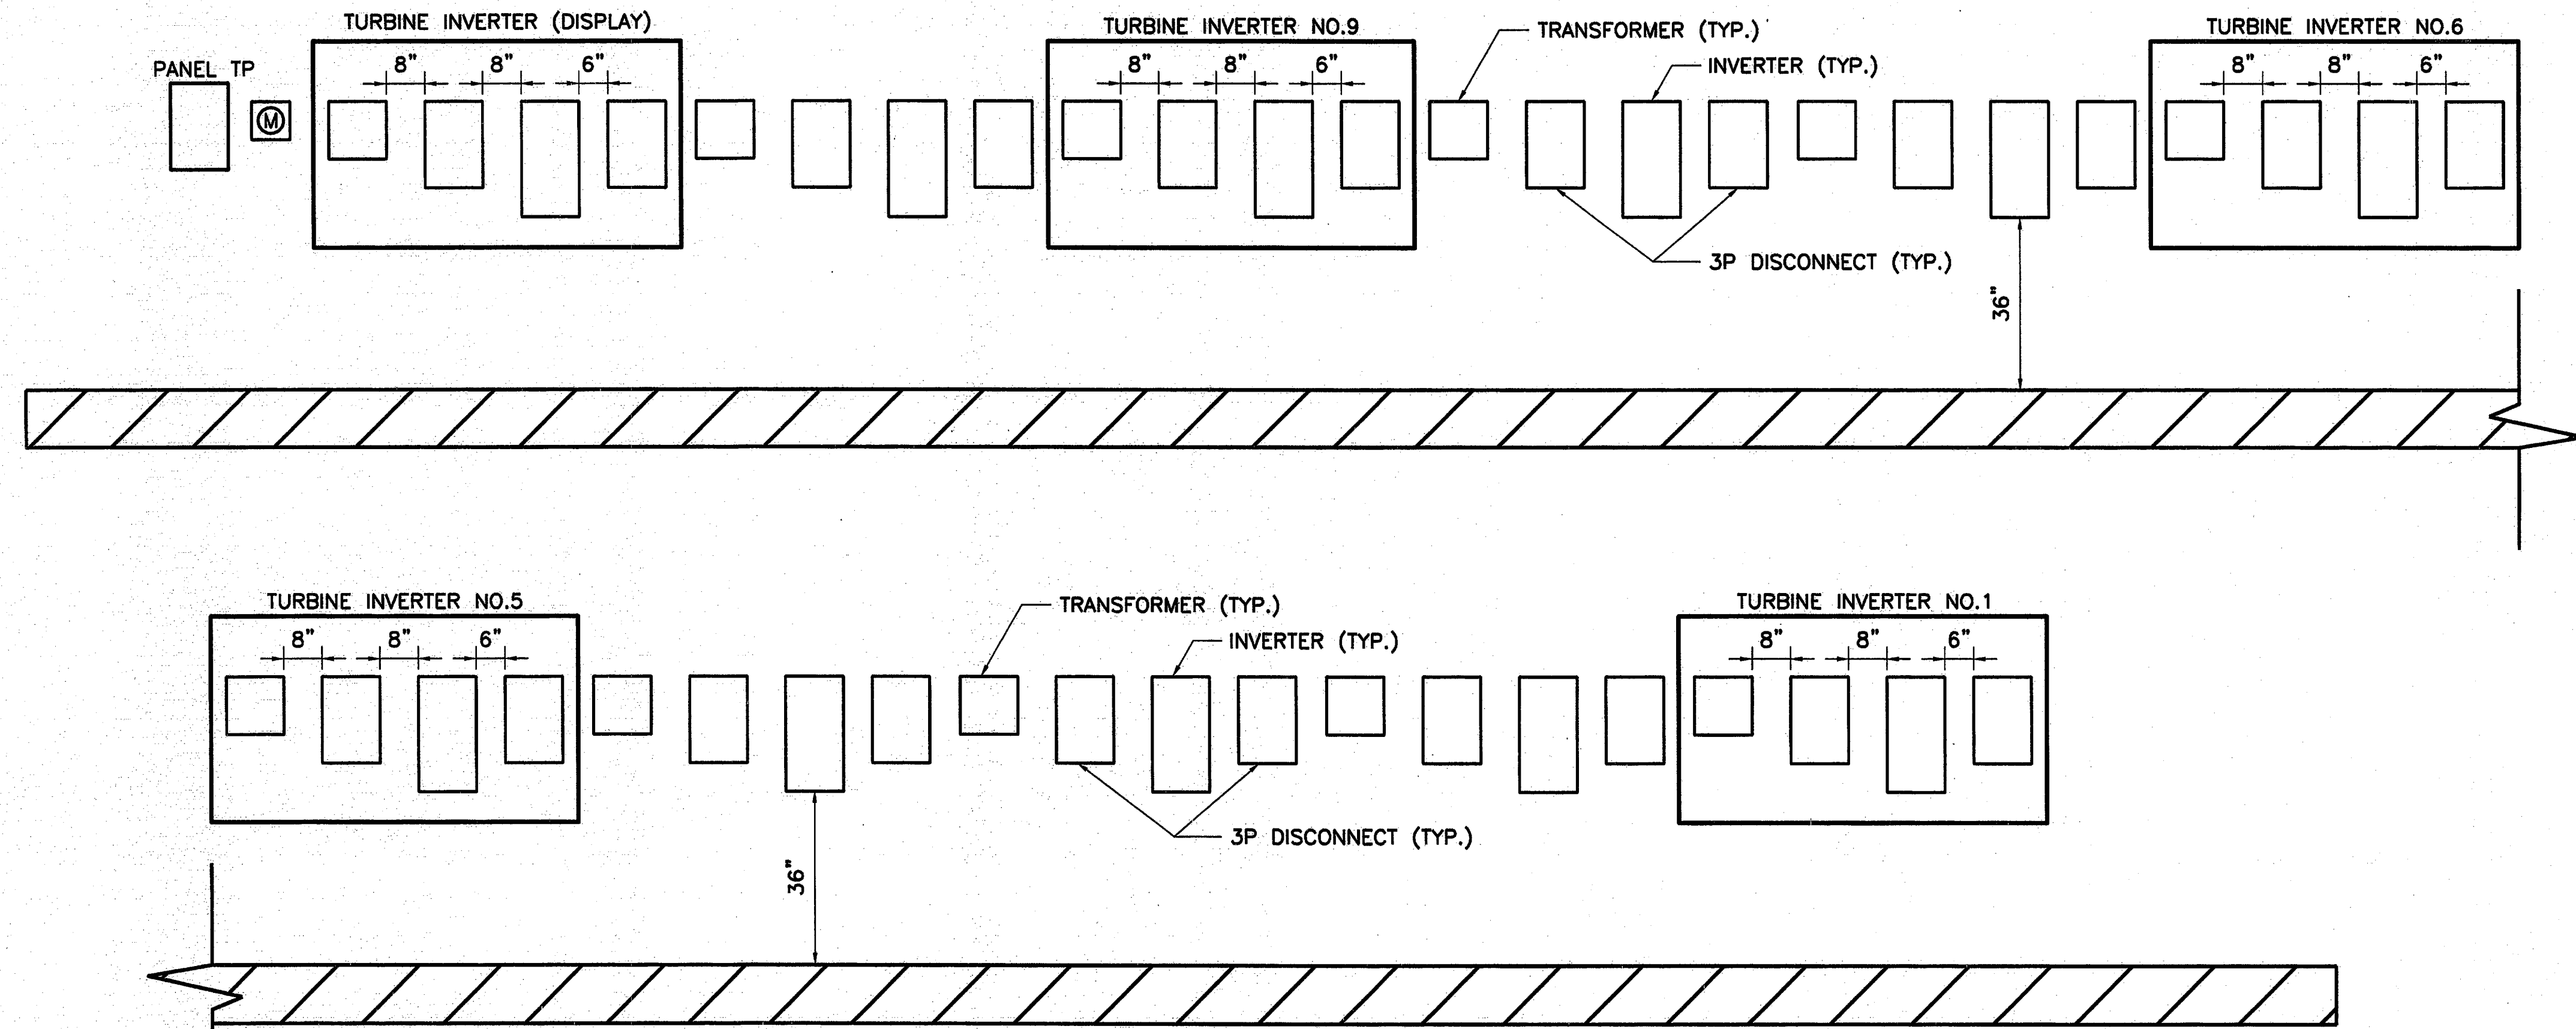

3
WIND TURBINE SYSTEM WALL EQUIPMENT LAYOUT
NOT TO SCALE

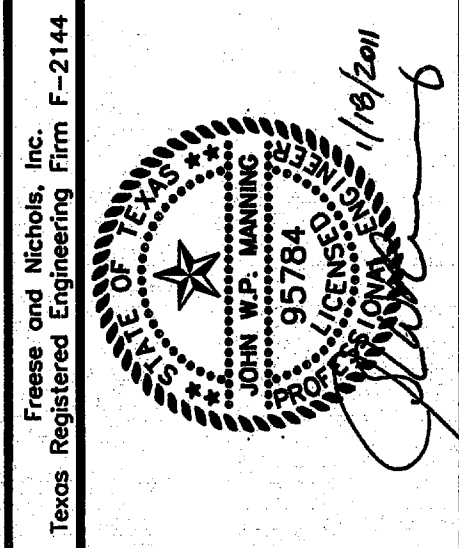

FRESE & NICHOLS
 2220 San Jacinto Blvd, Suite 330
 Denton, Texas 76205-7589
 Phone - (940) 387-4600
 Fax - (940) 387-4677

TOWN OF ADDISON, TEXAS
 SURVEYOR 1.5 MG EST
 ELECTRICAL
 DETAILS

NO. ISSUE	BY	DATE	F&N JOB NO.	ADD08459
			DATE	01/18/11
			DESIGNED	JWM
			DRAWN	JAF
			REVIEWED	
			CHECKED	JNH
			FILE NAME	EL-ADD-DT-MISCO2.dwg

VERIFY SCALE: Bar is one inch on original drawing. If not one inch on this sheet, adjust scale.

SHEET
F-9
 SEQ.

ACAD Rel 18.0s (LMS Tech) User: jwm
 [ADD08459] [DTMSRV2] N:\elec\EL-ADD-DT-MISCO2.dwg LAYOUT: EL-ADD-DT-MISCO2
 Jan 18, 2011 6:35pm PLOTS: 1 TWIST: CUALL\FRESE.COM
 REFERENCES: N:\elec\Boss\JWM-STAMP.dwg N:\Standard\348ORDER.DWG N:\UF\Boss\cv-uf-pl-inverter.dwg 95784.dwg