

STA 0+00 LINE "A"  
INSTALL 1-12" x 8"  
TAPPING SLEEVE  
& 8" GV

EXIST VALVE TO BE  
REMOVED & EXIST.  
LINE CAPPED AFTER  
NEW 8" COMPLETED

EX. 12" WATER

SAWCUT REMOVE  
& REPLACE EXIST.  
CONC.

CAUTION  
VERIFY EXIST. LINE  
LOCATION

SEE  
MATCH LINE  
SHT. 3  
STA. 3+25

STA. 2+80 INSTALL  
1-8" x 6" TEE, 30 LF 6" PVC  
1-6" GV, 1-8" GV  
REUSE EX. FH

STA. 1+20  
INSTALL 1-45° BEND


INSTALL 8" WATERLINE

STA. 2+60 INSTALL  
1-45° & 1-30° BENDS

EX WATERLINE TO  
REMAIN IN SERVICE  
UNTIL NEW LINE HAS  
BEEN COMPLETED

STA. 2+30 CONNECT EX  
SERVICE TO PROP. LINE  
UPON COMPLETION

GENERAL NOTES  
CONTRACTOR TO VERIFY STA.'S UPON  
ACTUAL LAYOUT OF THE PROJECT IN THE FIELD.  
CONTRACTOR TO CUT & PLUG EX WATERLINE  
AFTER NEW WATERLINE IS IN SERVICE

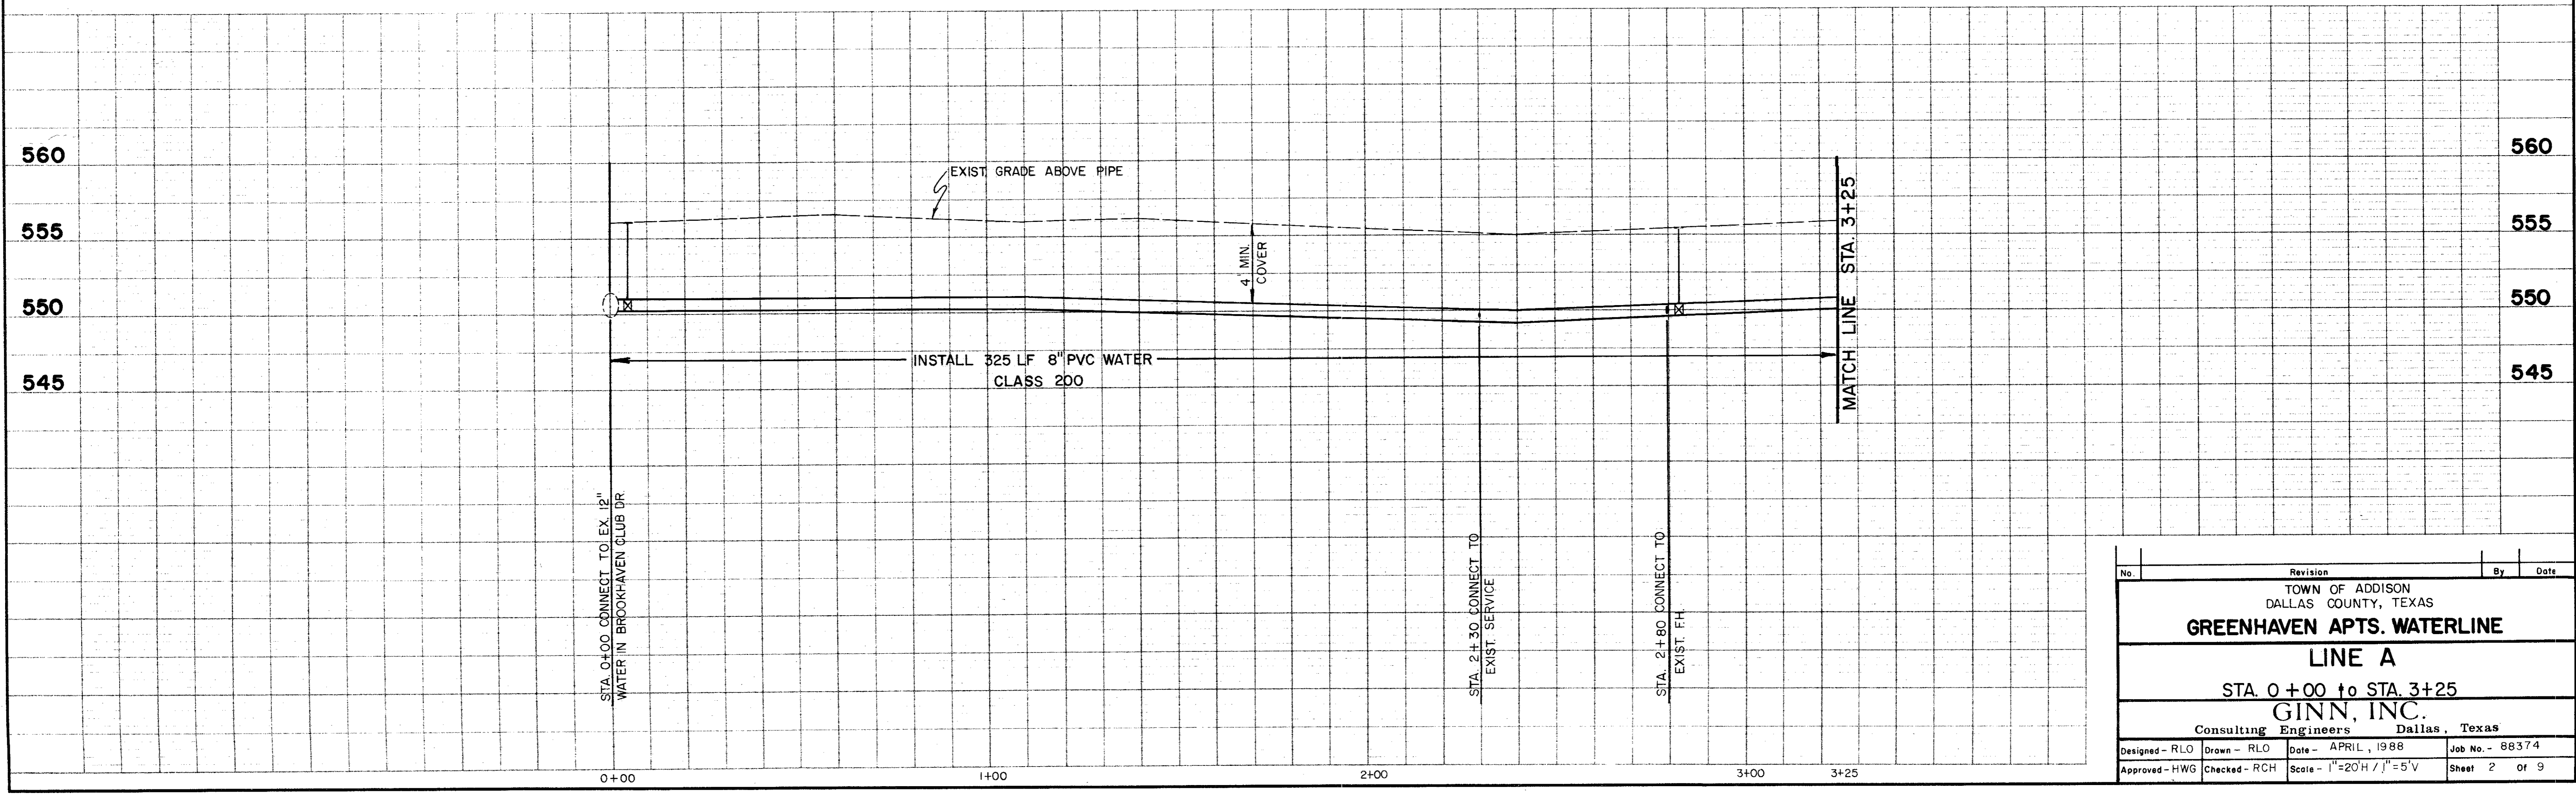

No.	Revision	By	Date
TOWN OF ADDISON DALLAS COUNTY, TEXAS			
<b>GREENHAVEN APTS. WATERLINE</b>			
<b>LINE A</b>			
STA. 0+00 to STA. 3+25			
<b>GINN, INC.</b>			
Consulting Engineers Dallas, Texas			
Designed - RLO	Drawn - RLO	Date - APRIL, 1988	Job No. - 88374
Approved - HWG	Checked - RCH	Scale - 1"=20'H / 1"=5'V	Sheet 2 of 9

TELETYPE POST