GENERAL NOTES

1. WATER MAINS TO BE CLASS 200 CAST IRON PIPE AND HAVE A MINIMUM COVER OF 4.0' BELOW FINISHED GRADES.
2. WATER AND SEWER SERVICES TO BE LOCATED AS SHOWN ON PLAN.
3. WATER METERS TO BE INSTALLED BY MECHANICAL CONTRACTOR.
4. CONTRACTOR WILL UNCOVER 8" WATER MAIN IN MARSH LANE PRIOR TO LAYING 6" SAN. SEW. IF ANY CONFLICT IS OBSERVED, CONTACT ENGR.
5.

Drawer 8
#21

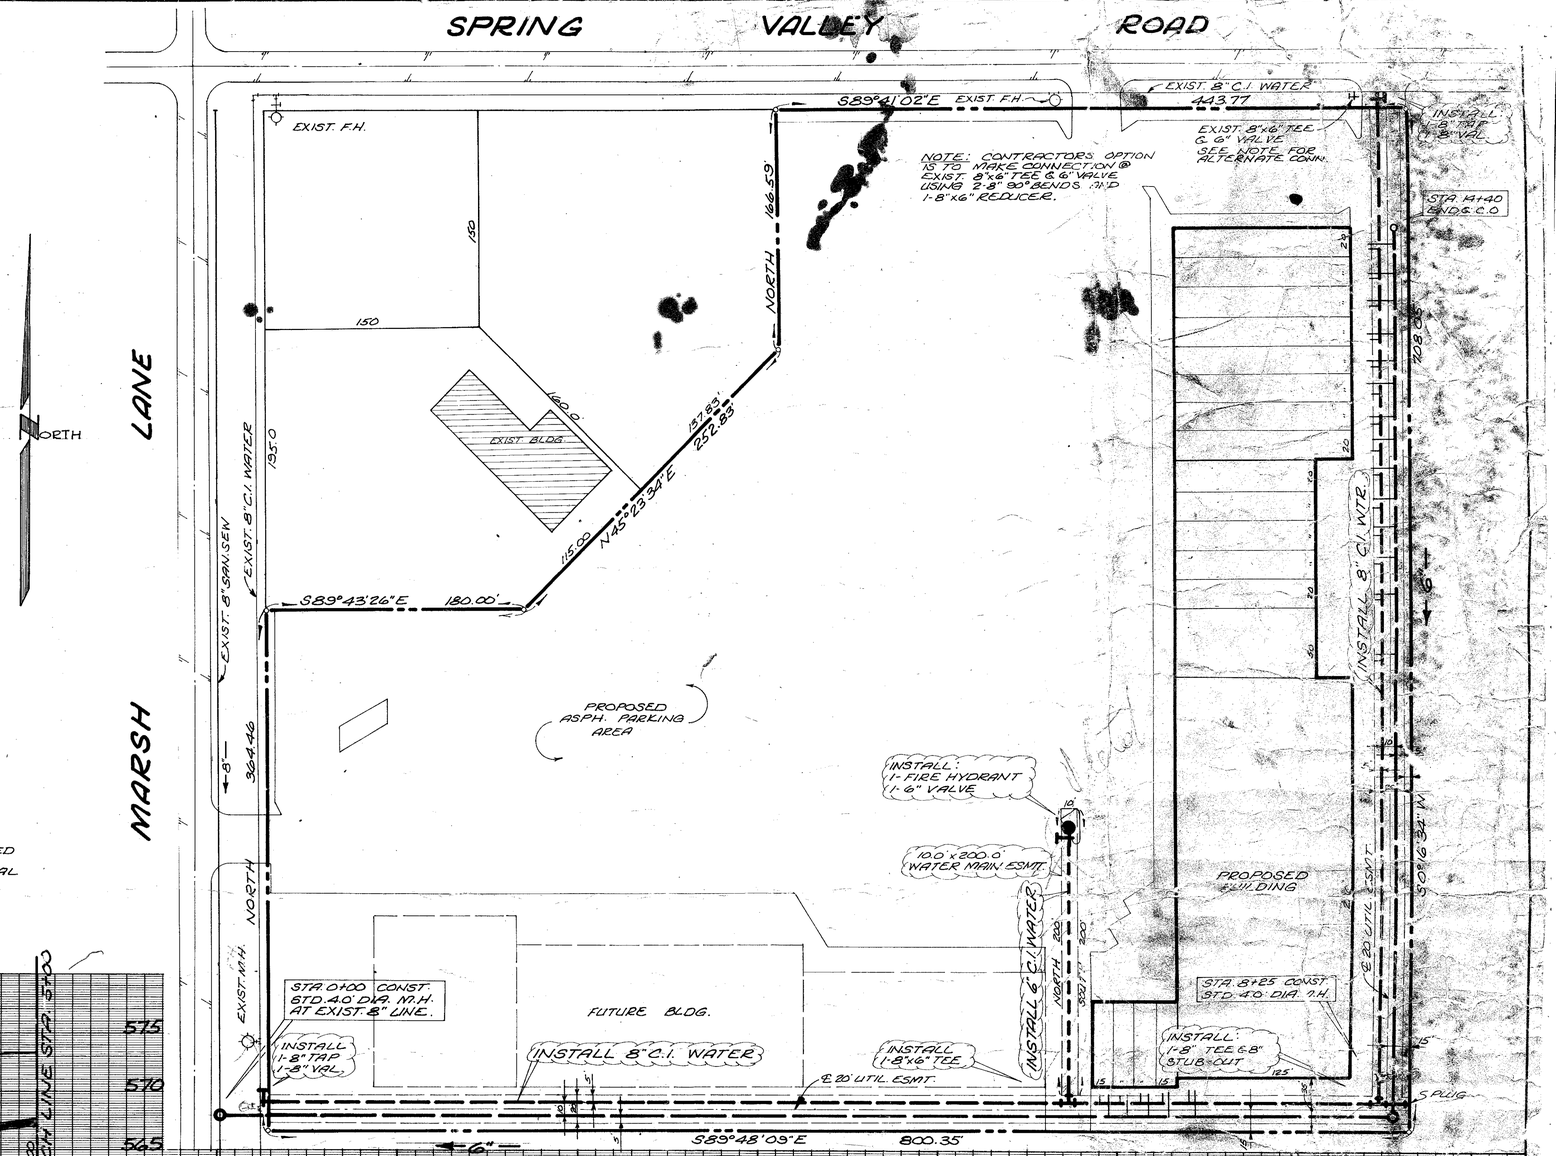

EMBEDMENT DETAIL

SCALE 1"=1.0'

INSTALL 1440 LIN. FT. 6" VIT. CLAY TILE SEW. PIPE EMBEDMENT AS SHOWN IN DETAIL

WATER & SAN. SEW. MAINS

GREENHAVEN VILLAGE

ROBERT S. FOLSOM - DEVELOPER

BILLY C. STEPHENSON & ASSOCIATES, ENGRS.

CITY OF ADDISON, TEXAS

DESIGN	DRAWN	DATE	SCALE	NOTES	FILE NO.
B.C.S.	J.A.	5-66	1"=100'	NOTED	C.H.