

PROPOSED WATER DISTRIBUTION PLAN  
1" = 50'


CITY OF ADDISON  
**APPROVED**  
 FOR CONSTRUCTION  
 BUILDING DEPARTMENT  
 DATE: 6-5-86  
 NOTE: CONTRACTOR IS HEREBY INSTRUCTED TO EXERCISE CARE IN MEETING OR EXCEEDING ALL REQUIREMENTS OF BOTH NATIONAL AND LOCAL CODES AND/OR ORDINANCES APPLICABLE TO HIS WORK. APPROVAL OF THESE DRAWINGS SHALL NOT BE CONSTRUED TO RELIEVE RESPONSIBILITY OR IMPLY VARIANCE TO SUCH CODES.

1. Water line location is indicative only, field stake and obtain approval of the Town of Addison and MND Inc.
2. Easement shall be prepared from field location after construction.
3. The Contractor shall be responsible for locating underground and overhead utilities (existing) from site investigation and Greenhill School records, etc.
4. Adapt and adjust lines as required, construct (sewer crossings, etc.) to standards acceptable to the Town of Addison, Tx.
5. All water mains shall have a minimum of four feet (4'-0") cover.
6. Locate fire hydrants, valve boxes, etc. to elevations and lateral dimensions established by MND Inc.
7. Topographic information shown on sheet 2 is for general information only, it has not been updated since 1977.
8. All construction materials, procedures, products, etc. shall be to standards acceptable to the Town of Addison, Tx., see accompanying fourteen sheets of requirements.


TOWN OF ADDISON, TEXAS  
**GREENHILL SCHOOL**

WATER DISTRIBUTION

JOE J. NAGLER, P.E. 2801 N. AKARD  
 DALLAS, TX. 871-7691  
 6-1-86

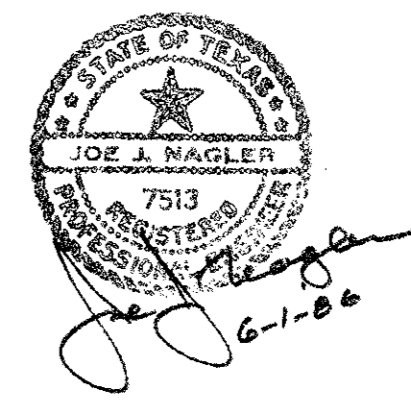

1 of 2

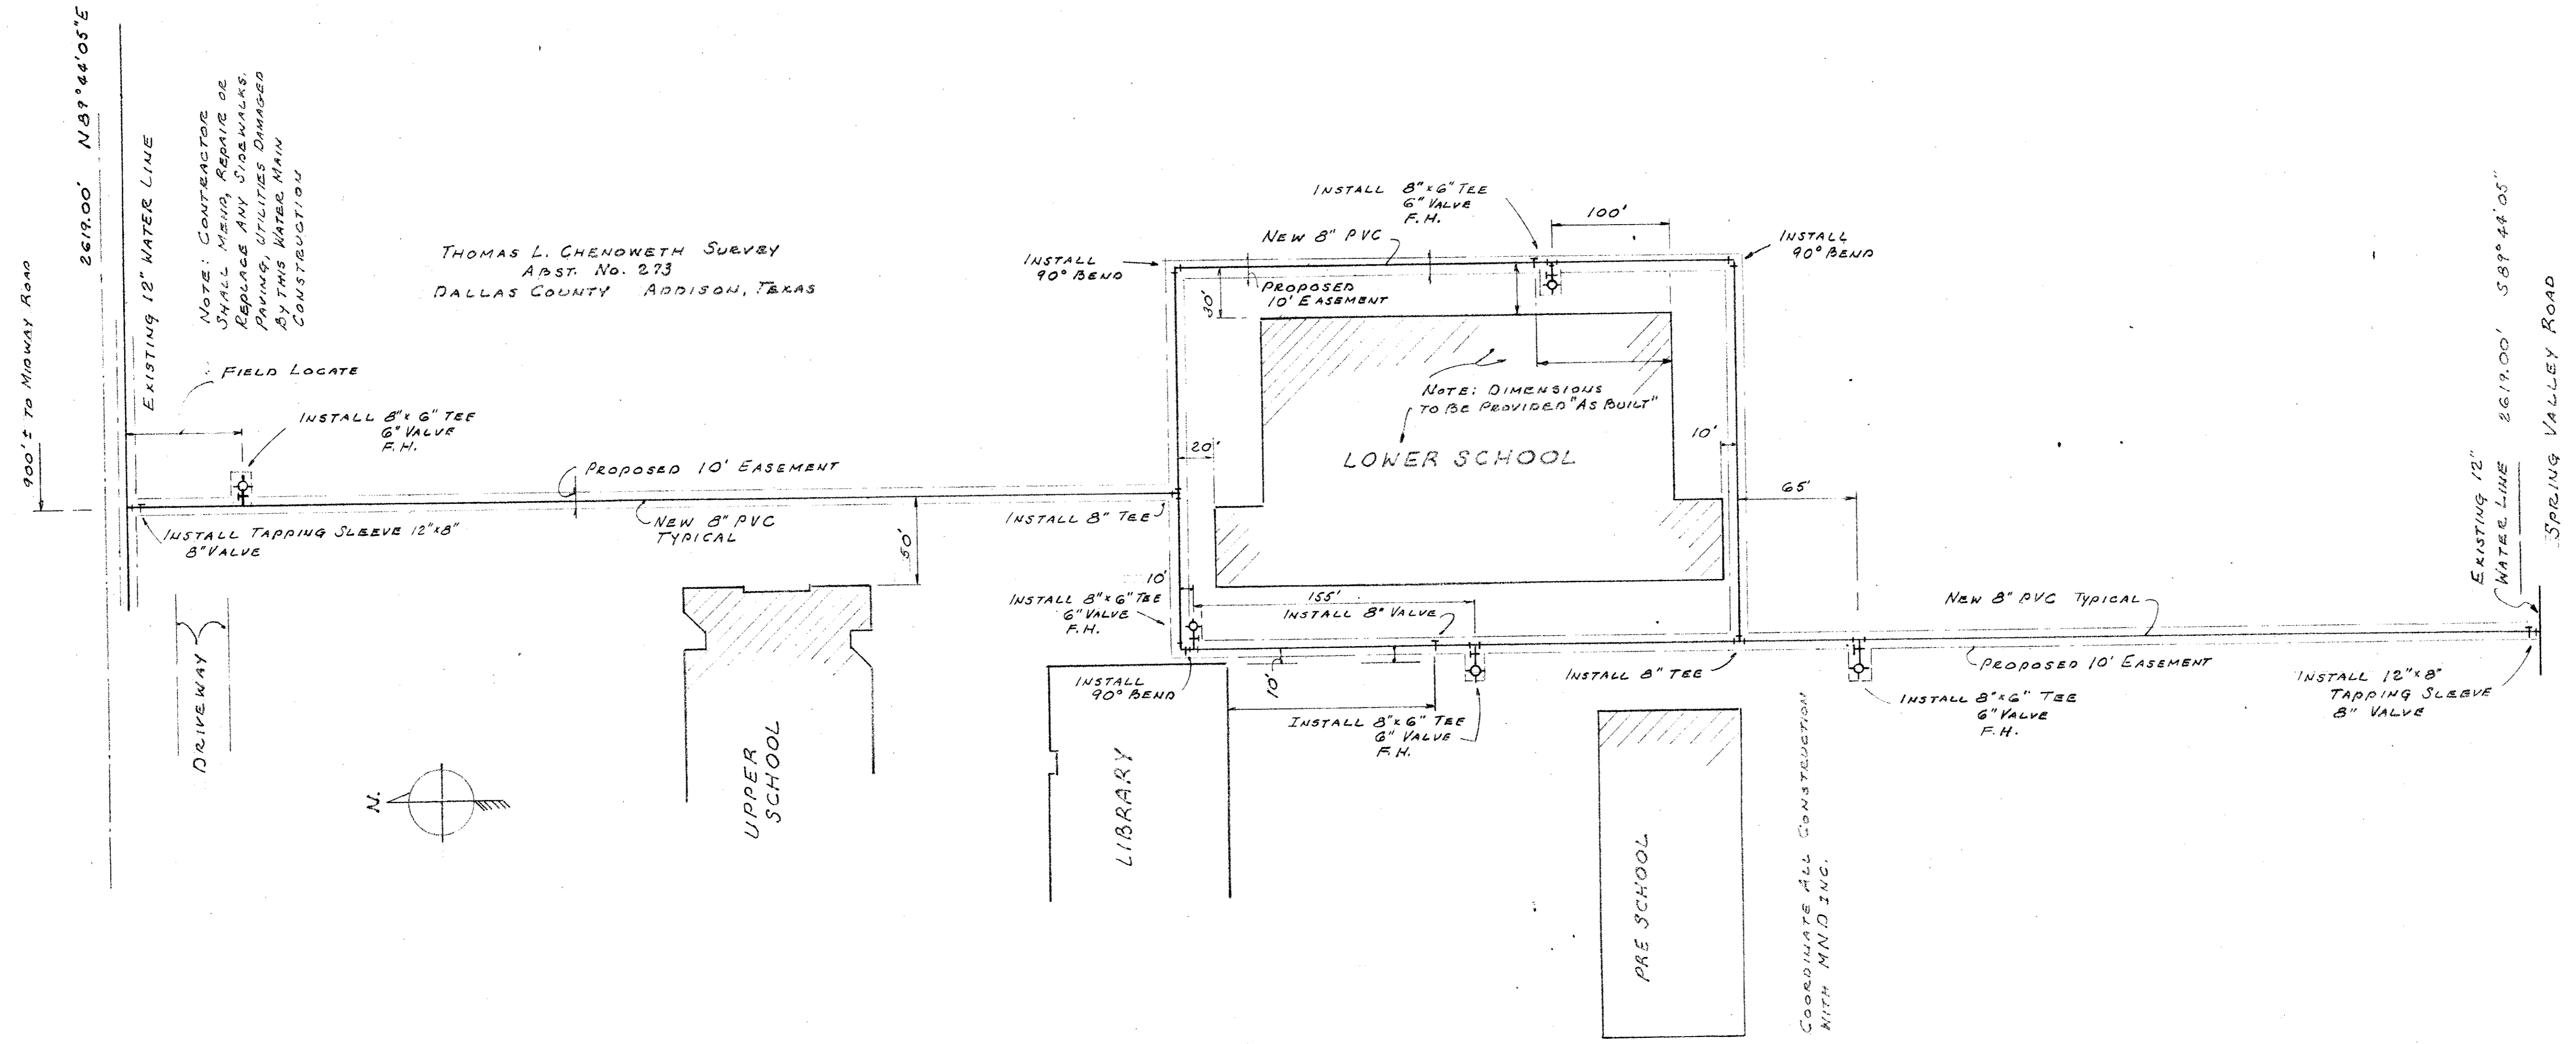

PROPOSED WATER DISTRIBUTION PLAN  
1" = 50'

CITY OF ADDISON  
**APPROVED**  
FOR CONSTRUCTION  
BUILDING DEPARTMENT  
6-1-86

DATE: 6-1-86  
NOTE: CONTRACTOR IS HEREBY INSTRUCTED TO EXERCISE CARE IN MEETING OR EXCEEDING ALL REQUIREMENTS OF BOTH NATIONAL AND LOCAL CODES AND/OR ORDINANCES APPLICABLE TO HIS WORK. APPROVAL OF THESE DRAWINGS SHALL NOT BE CONSTRUED TO RELIEVE RESPONSIBILITY OR IMPLY VARIANCE TO SUCH CODES.

1. Water line location is indicative only, field stake and obtain approval of the Town of Addison and MND Inc.
2. Easement shall be prepared from field location after construction.
3. The Contractor shall be responsible for locating underground and overhead utilities (existing) from site investigation and Greenhill School records, etc.
4. Adapt and adjust lines as required, construct (sewer crossings, etc.) to standards acceptable to the Town of Addison, Tx.
5. All water mains shall have a minimum of four feet (4'-0") cover.
6. locate fire hydrants, valve boxes, etc. to elevations and lateral dimensions established by MND Inc.
7. Topographic information shown on sheet 2 is for general information only, it has not been updated since 1977.
8. All construction materials, procedures, products, etc. shall be to standards acceptable to the Town of Addison, Tx., see accompanying fourteen sheets of requirements.

TOWN OF ADDISON, TEXAS  
**GREENHILL SCHOOL**

WATER DISTRIBUTION

JOE J. NAGLER, P.E. 2801 N. AKARD  
DALLAS, TX. 871-7691  
6-1-86

