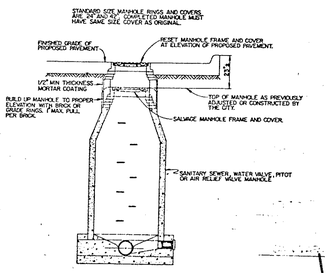

STANDARD BRICK OR PRE-CAST MANHOLE

NO SCALE



FOUR GRATE INLET



SECTION D-D



SECTION A-A

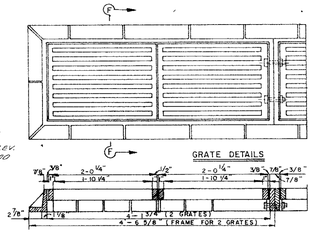

NOTE: ALL REINFORCING BAR LAPS AND EXTENSIONS SHALL BE 36 BAR DIAMETER UNLESS NOTED OTHERWISE.



SECTION F-F

NOTE: ALL CONSTRUCTION MATERIAL AND METHODS WILL COMPLY WITH CITY OF ADDISON, TEXAS STANDARDS.

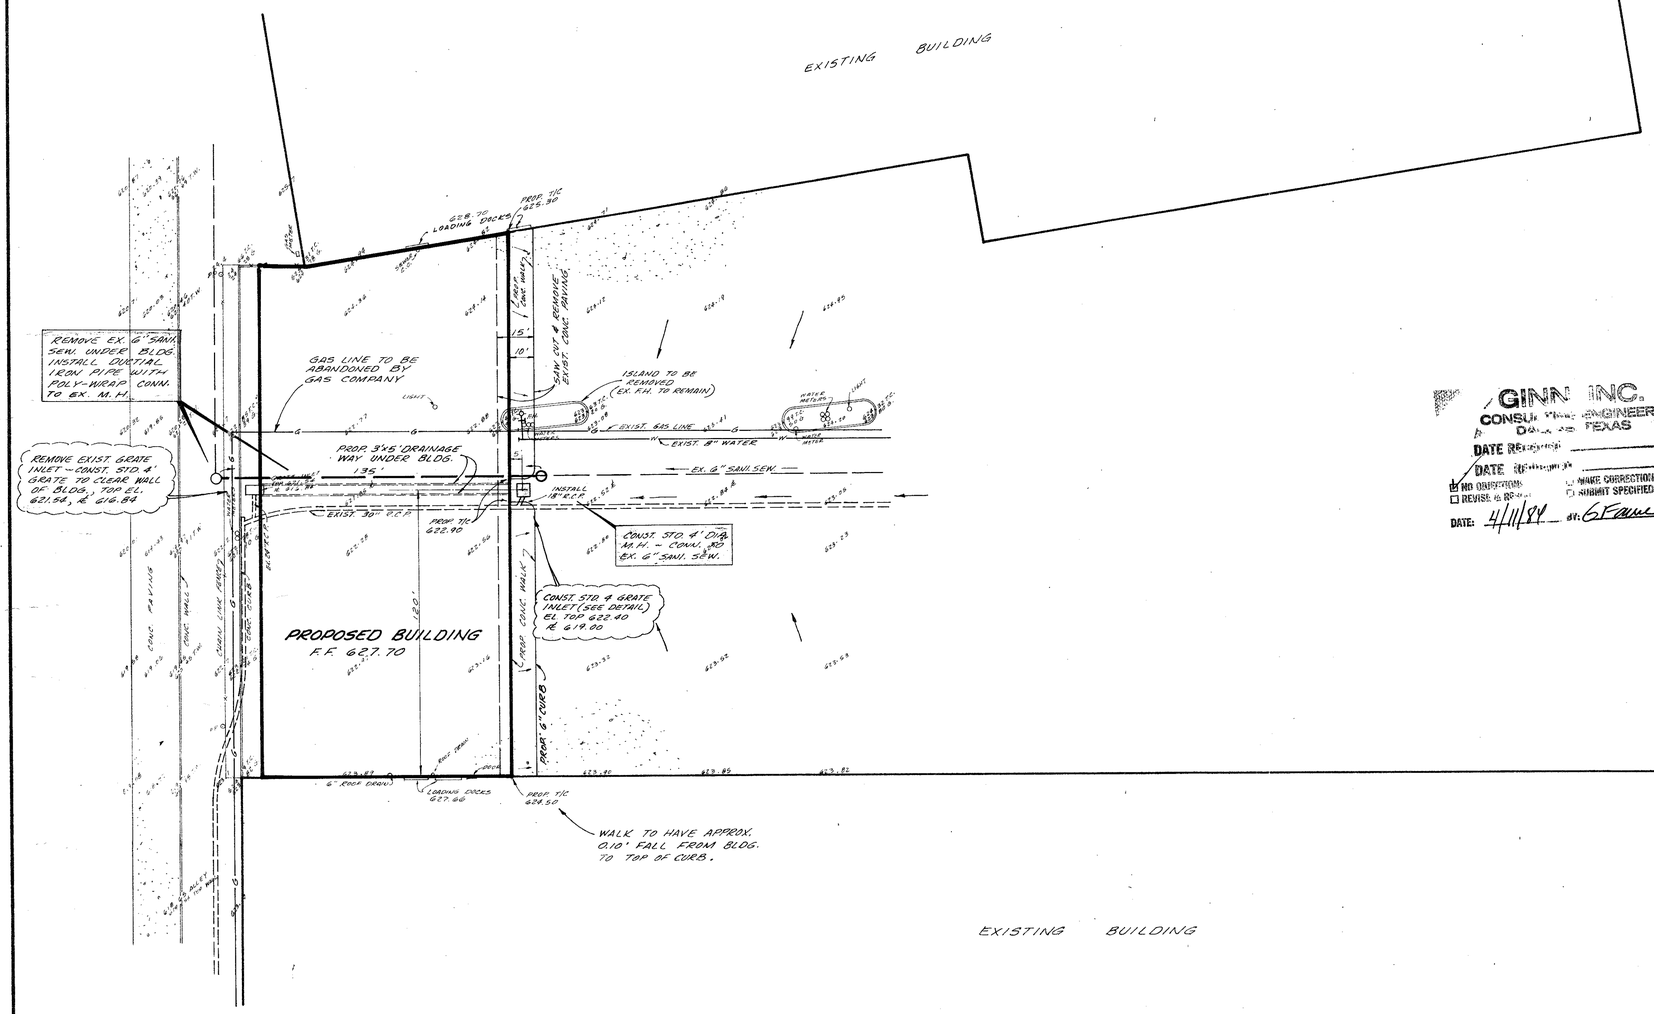

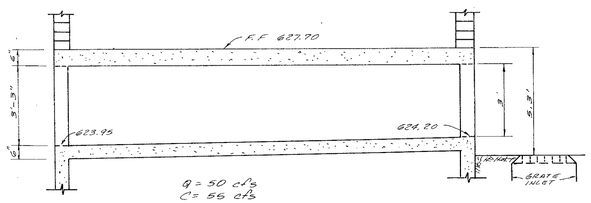

DRAINAGE WAY DETAIL

NOT TO SCALE



BENCH MARK: "D" cut on conc. curb at island located approx. 115' East of prop. bldg. Elev. 624.32

BENCH MARK: "D" cut on concrete curb center of radius at southwest corner of Belt Line and Inwood Road, west of Railroad. Elev. 632.11

GINN INC. CONSULTING ENGINEERS DALLAS, TEXAS
DATE RECEIVED
DATE RECEIVED
☑ NO OBJECTIONS ☐ MAKE CORRECTIONS NOTED
☐ REVISE & RESUBMIT ☐ SUBMIT SPECIFIED ITEMS
DATE: 4/11/84 BY: G.F. Ginn

STATE OF TEXAS
DAN M. DOWDEY
21433
REGISTERED PROFESSIONAL ENGINEER

GRADING, DRAINAGE & UTIL PLAN

TUESDAY MORNING SITE

CITY OF ADDISON

DALLAS COUNTY, TEXAS

THREADGILL - DOWDEY and ASSOCIATES
CONSULTING ENGINEERS DALLAS, TEXAS

DESIGN	DRAWN	CHECKED	DATE	SCALE	JOB	SHEET
A.R.W.	R.E.	D.M.D.	3/6/84	1"=30'	9192	1