

J.R. & Jack Maxfield Prop.

Edwin H Harrison Prop.

Exxon Oil Co. Station

8" CAST IRON CEMENT LINED WATER LINE

1-8"x6" M.J. TEE  
1-6" G.V. W/ VALVE BOX  
1-6" FIRE HYDRANT

WET CONNECTION

1-8" TAPPING SLEEVE W/ VALVE  
1-8" M.J. 90° BEND

1-8"x6" M.J. TEE  
1-6" G.V. W/ VALVE BOX  
1-6" M.J. BLIND CAP

COTTON BELT R.R.

COTTON BELT R.R.

Frances D. Truman Prop.

Golf Driving Range

Jos. S. Miller Prop.

8" CAST IRON CEMENT LINED WATER LINE

1-8"x6" M.J. TEE  
1-6" G.V. W/ VALVE BOX  
1-6" FIRE HYDRANT

REPLACE BASE & SURFACE  
SALVAGE & RELAY R.C.P.

1-8"x6" M.J. TEE  
1-6" G.V. W/ VALVE BOX  
1-6" M.J. BLIND CAP

INWOOD ROAD

CITY OF DALLAS 42" R.C. WATER MAIN

Railroad R.O.W.

1-8"x2" M.J. TEE  
1-6" G.V. W/ VALVE BOX  
1-2" METER W/ METER BOX

COTTON BELT R.R.


1-8"x2" M.J. TEE  
1-2" G.V. W/ VALVE BOX  
1-2" METER W/ METER BOX

1-8"x6" M.J. TEE  
1-6" G.V. W/ VALVE BOX  
1-6" M.J. BLIND CAP

Railroad R.O.W.

Property Line

NOTE TO CONTRACTOR:  
ALL PIPE EMBEDMENT SHALL BE CLASS 2 ON THIS PROJECT.

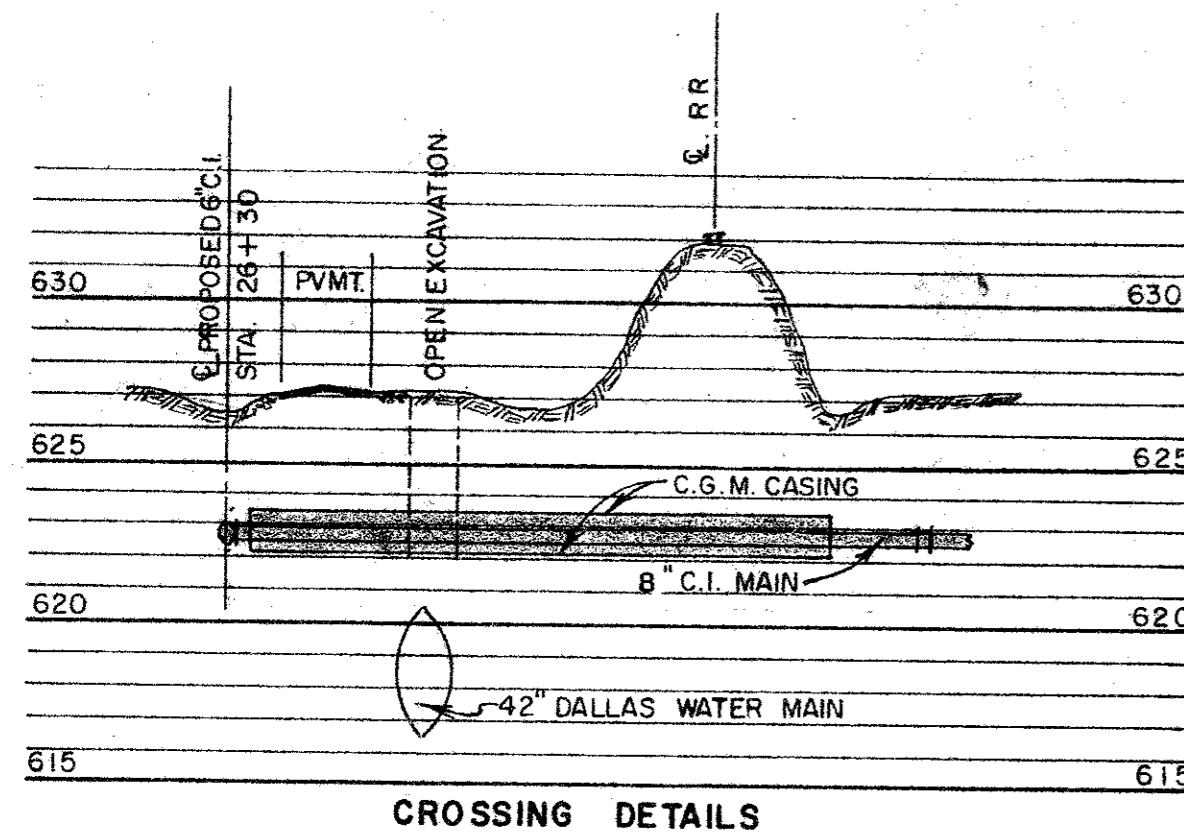

CROSSING DETAILS

1-8" M.J. TEE  
1-8" M.J. BIND CAP

1-8" G.V. W/ VALVE BOX

BORE & ENCASE 120 L.F.  
8" C.I. M.J. PIPE IN 18"  
CORRUGATED GALVANIZED  
METAL PIPE CASING.

1-8"x6" M.J. TEE  
1-6" G.V. W/ VALVE BOX  
1-6" M.J. BLIND CAP

1-8" 22 1/2° BEND

DEFLECT PIPE AT JOINTS  
SO AS TO PARALLEL  
FENCE.

MATCH LINE STA. 28+50 SHEET 2

CITY OF ADDISON  
WATER SYSTEM IMPROVEMENTS

Scale: 1" = 40'

Date: May, 1973

Drawn: R.C.K.

Approved: R.C.K.

Sheet No. 1

DISTRIBUTION SYSTEM

14