


UNIT A3
ALTERNATE E


8 FLOOR FRAMING PLAN
S2.02 SCALE: 1/8"=1'-0"

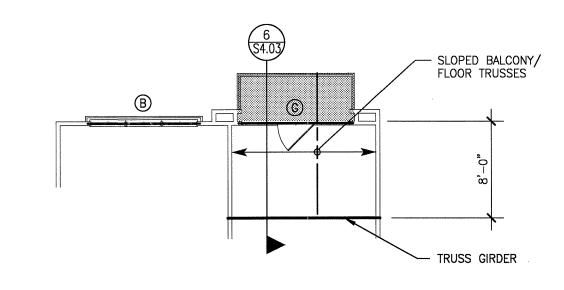

UNIT A3
ALTERNATE D


7 FLOOR FRAMING PLAN

S2.02 SCALE: 1/8"=1'-0"

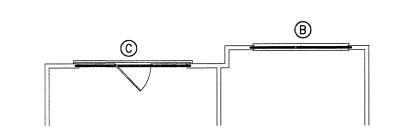

UNIT A3
ALTERNATE 3

6 FLOOR FRAMING PLAN
S2.02 FOR ADD'L INFO. NOT NOTED

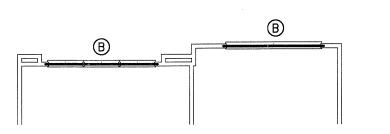


UNIT A3
ALTERNATE 2

5 FLOOR FRAMING PLAN
S2.02 FOR ADD'L INFO. NOT NOTED


UNIT A3
ALTERNATE 1

FLOOR FRAMING PLAN
S2.02 SCALE: 1/8"=1'-0"

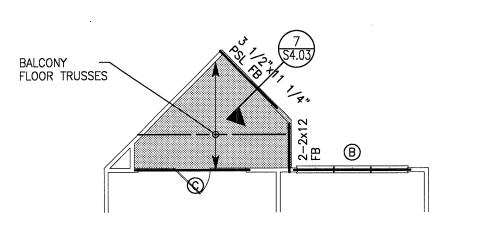

UNIT A3
PARTIAL 3
FLOOR FRAMING PLAN

S2.02 SCALE: 1/8"=1'-0"

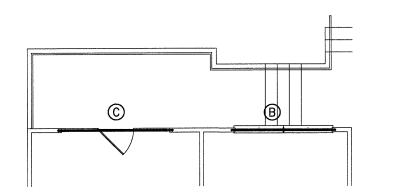


UNIT A3
PARTIAL 2

S2.02 SCALE: 1/8"=1'-0"

NOTE: REF. 1/S2.02 FOR ADD'L INFO. NOT NOTED

NOTE: REF. 1/S2.02 FOR ADD'L INFO. NOT NOTED

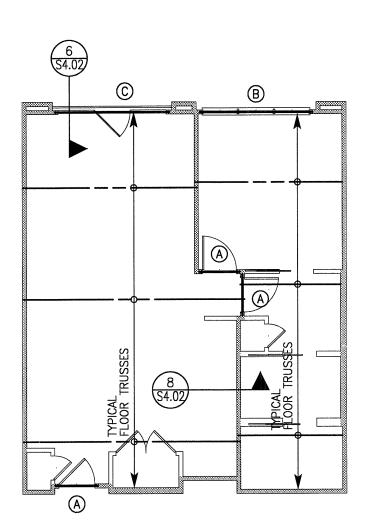

UNIT A3

1 FLOOR FRAMING PLAN

S2.02 SCALE: 1/8"=1'-0"

FRAMING PLAN(S) ARE ONLY FOR TRUSS SUPPORT—STRUCTURE AND GENERAL LAYOUT OF FRAMING. TRUSS MANUFACTURER IS RESPONSIBLE FOR ACTUAL TRUSS LAYOUT AND PROFILES AND SHALL SUBMIT SHOP DRAWINGS OF ALL TRUSS LAYOUT AND PROFILES PER THE SPECIFICATIONS.

HEADER SCHEDULE			
MARK	SIZE	STUD/COLUMN AT LEVEL 1	STUD/COLUMN AT LEVELS 2,3,4
A	2-2x8	3-2x STUDS	2-2x STUDS
B	2-2x10	3-2x STUDS	2-2x STUDS
©	2-2x12	3-2x STUDS	2-2x STUDS
0	3-2x8	4-2x STUDS	3-2x STUDS
Ē	3-2x10	4-2x STUDS	3-2x STUDS
F	3-2x12	4-2x STUDS	3-2x STUDS
©	3 1/2"x9 1/4" PSL	4-2x STUDS	3-2x STUDS
\oplus	3 1/2"x11 1/4" PSL	5-2x STUDS	4-2x STUDS
9	3 1/2"x14" PSL	5-2x STUDS	4-2x STUDS
K	3 1/2"x16" PSL	6-2x STUDS	5-2x STUDS

NOTES

 INDICATES NUMBER OF FULL HEIGHT STUDS REQUIRED AT EACH END OF HEADER.

2. REF. TYPICAL WALL OPENING ELEVATIONS FOR NUMBER OF REQUIRED TRIM STUDS.




PLAN NOTES:

- 1. REFER TO SHEETS \$1.01 THRU \$1.03 FOR STRUCTURAL NOTES AND SCHEDULES.
- 2. REFER TO SHEETS S4.01 THRU S4.04 FOR TYPICAL FRAMING DETAILS.
- 3. T/SHEATHING = TOP OF FLOOR SHEATHING ELEVATION. REFER TO ARCHITECTURAL DRAWINGS FOR T/SHEATHING ELEVATIONS. ALL LEVELS TO BE CONSTRUCTED WITH 9'-1 PLATE HEIGHTS, UNLESS NOTED OTHERWISE.
- 4. COORDINATE FLOOR DEPRESSIONS, DROPS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS.
- 5. ALL HORIZONTAL FRAMING LUMBER SHALL BE KILN-DRIED #2 SOUTHERN PINE, UNLESS NOTED OTHERWISE. ALL OTHER LUMBER SPECIES AND GRADES MUST BE APPROVED IN WRITING BY THE ENGINEER.
- 6. TYPICAL FLOOR TRUSSES SHALL BE 18" DEEP AT 24" O.C., UNLESS NOTED OTHERWISE. PROVIDE TRUSS BRIDGING IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- 7. BALCONY TRUSSES SHALL BE 15" DEEP AT 24" O.C., UNLESS NOTED OTHERWISE. PROVIDE TRUSS BRIDGING IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- 8. SLOPED BALCONY TRUSSES SHALL BE AT 24" O.C. WITH A MINIMUM DEPTH OF 15" AT THE EXTERIOR AND SHALL HAVE A SLOPED TOP CHORD, UNLESS NOTED OTHERWISE. REFER TO SECTIONS AND DETAILS FOR ADDITIONAL INFORMATION. PROVIDE TRUSS BRIDGING IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- 9. ALL WOOD BEAMS ARE LOAD BEARING HEADERS, UNLESS NOTED OTHERWISE.

 (DB = DROP BEAM, FB = FLUSH BEAM). REFER TO SCHEDULES FOR SUPPORT REQUIREMENTS AT HEADERS AND BEAMS.
- 10. ALL WALLS SHOWN ARE BELOW THIS LEVEL, UNLESS NOTED OTHERWISE.
- 11. INDICATES ASSUMED INTERIOR LOAD BEARING WALLS BELOW THIS LEVEL.
 ALL EXTERIOR WALLS SHALL BE LOAD BEARING.
- 12. XXXXXXXX INDICATES ASSUMED INTERIOR LOAD BEARING WALLS ABOVE THIS LEVEL.
- 13. INDICATES LIGHT WEIGHT CONCRETE TOPPING AT BALCONIES AND CORRIDORS.

 CONCRETE TOPPING SHALL BE REINFORCED WITH NYLON AR GLASS FIBER REINFORCEMENT

 (OR APPROVED SUBSTITUTE) IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- 14. POST/STUD COLUMNS SHALL BE CONTINUOUS TO FOUNDATION. CONNECT WOOD BEAMS AND COLUMNS WITH SIMPSON TYPE "ACE" POST CAPS OR APPROVED SUBSTITUTE.

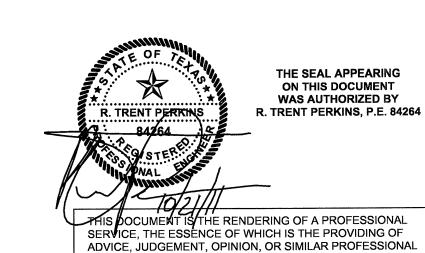



PARKIN - PERKINS - OLSEN CONSULTING ENGINEERING, INC.

9330 LBJ Freeway Suite 1055
Dallas, Texas 75243
Tel 214.221.2220 Fax 214.221.2252
Project No. 39155
Registration No. F-1479

IN ADDISON, TEXAS

LOFT APARTMENTS IN A

NSTRUCTION ISSUE 10-17-2011



4144 N. Central Expy., Suite 855 Dallas, TX 75204 214.520.8878 bgoarchitects.com

DATE

08-05-2011

PROJECT 11129

11129
SHEET NUMBER

S2.02