General Notes:
1. Pipe For Sanitary Sewer Gravity Main Shall Be PVC, SDR #35.
2. Pipe For Force Main Shall Be PVC Class 150, SDR #18.
3. A Plastic Coated #12 Copper Wire Shall Be Buried In Trench For Locating Pipe.
4. The Contractor Shall Investigate Soils Conditions Prior To Bidding.
5. The Contractor Shall Verify The Location Of All Existing Utilities Prior To Start Of Construction.

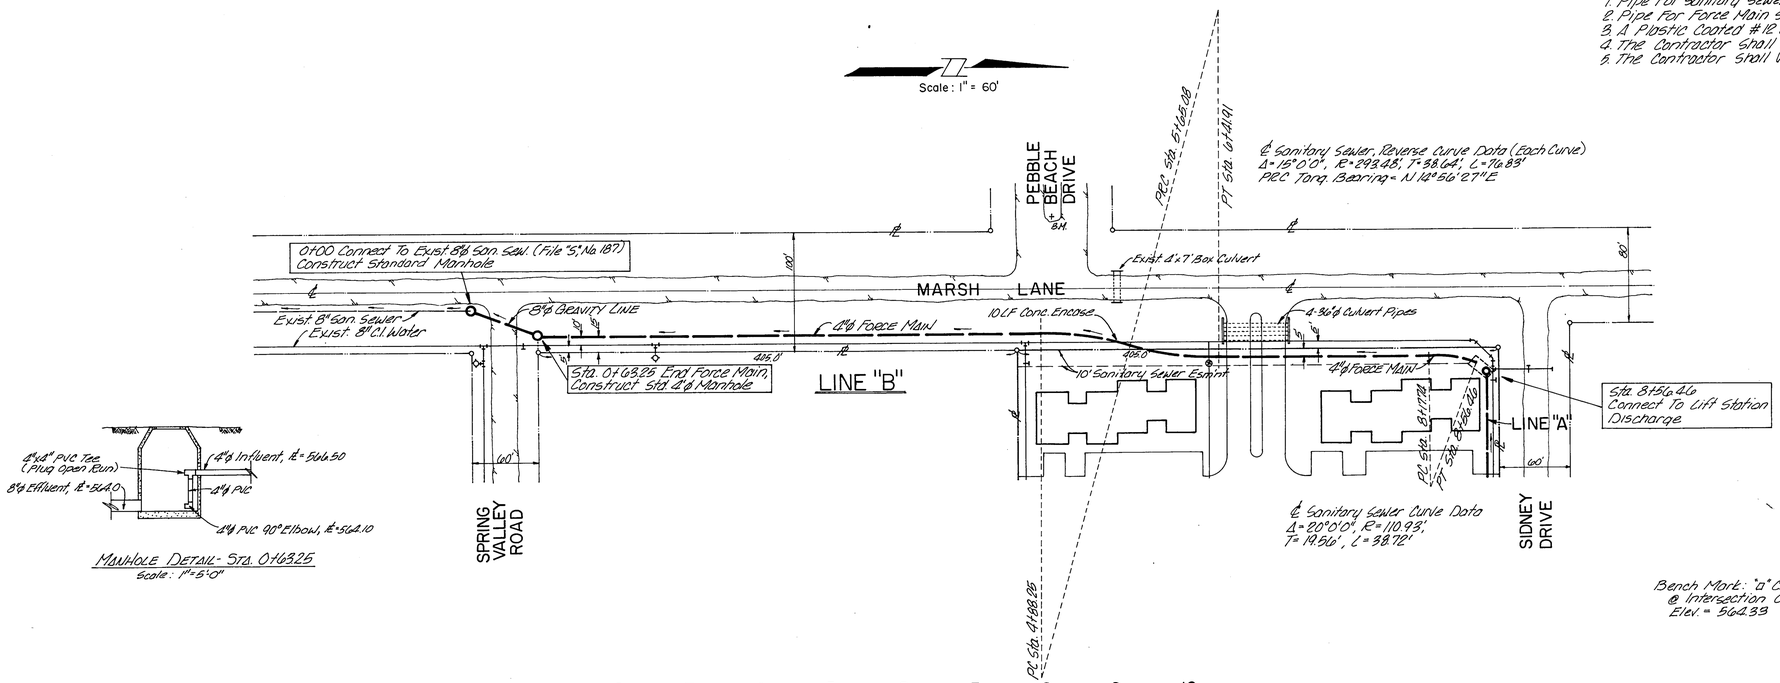

4A
4
Replaces Sheet 4 of 4 Dated Mar. 1976

OFF-SITE SANITARY SEWER

MARSH LANE PROJECT

ADDISON TEXAS

C 1975 | APRIL, 1976

REVISIONS
Complete Revision of Sht. 4.
Rev. From 0+00 To 0+63.25 4-27-76
Rev. Location Air Rel. V. 4-28-76

DONALD E. DAVIS CONSULTING ENGINEERS
3000 McKinney Ave./Dallas, Texas 75204

PLAN NOTE BOOK No. — SURVEYED — PLOTTED — ALIGNMENT CHECKED — RT. OF WAY CHECKED — BY — DATE

PROFILE NOTE BOOK No. — SURVEYED — PLOTTED — GRADES CHECKED — B. M.'s NOTED — STRUCTURE NOTATIONS CHECKED — BY — DATE

K+E PLATE 1, PLAN-PROFILE KEUFFEL & ESSER CO.