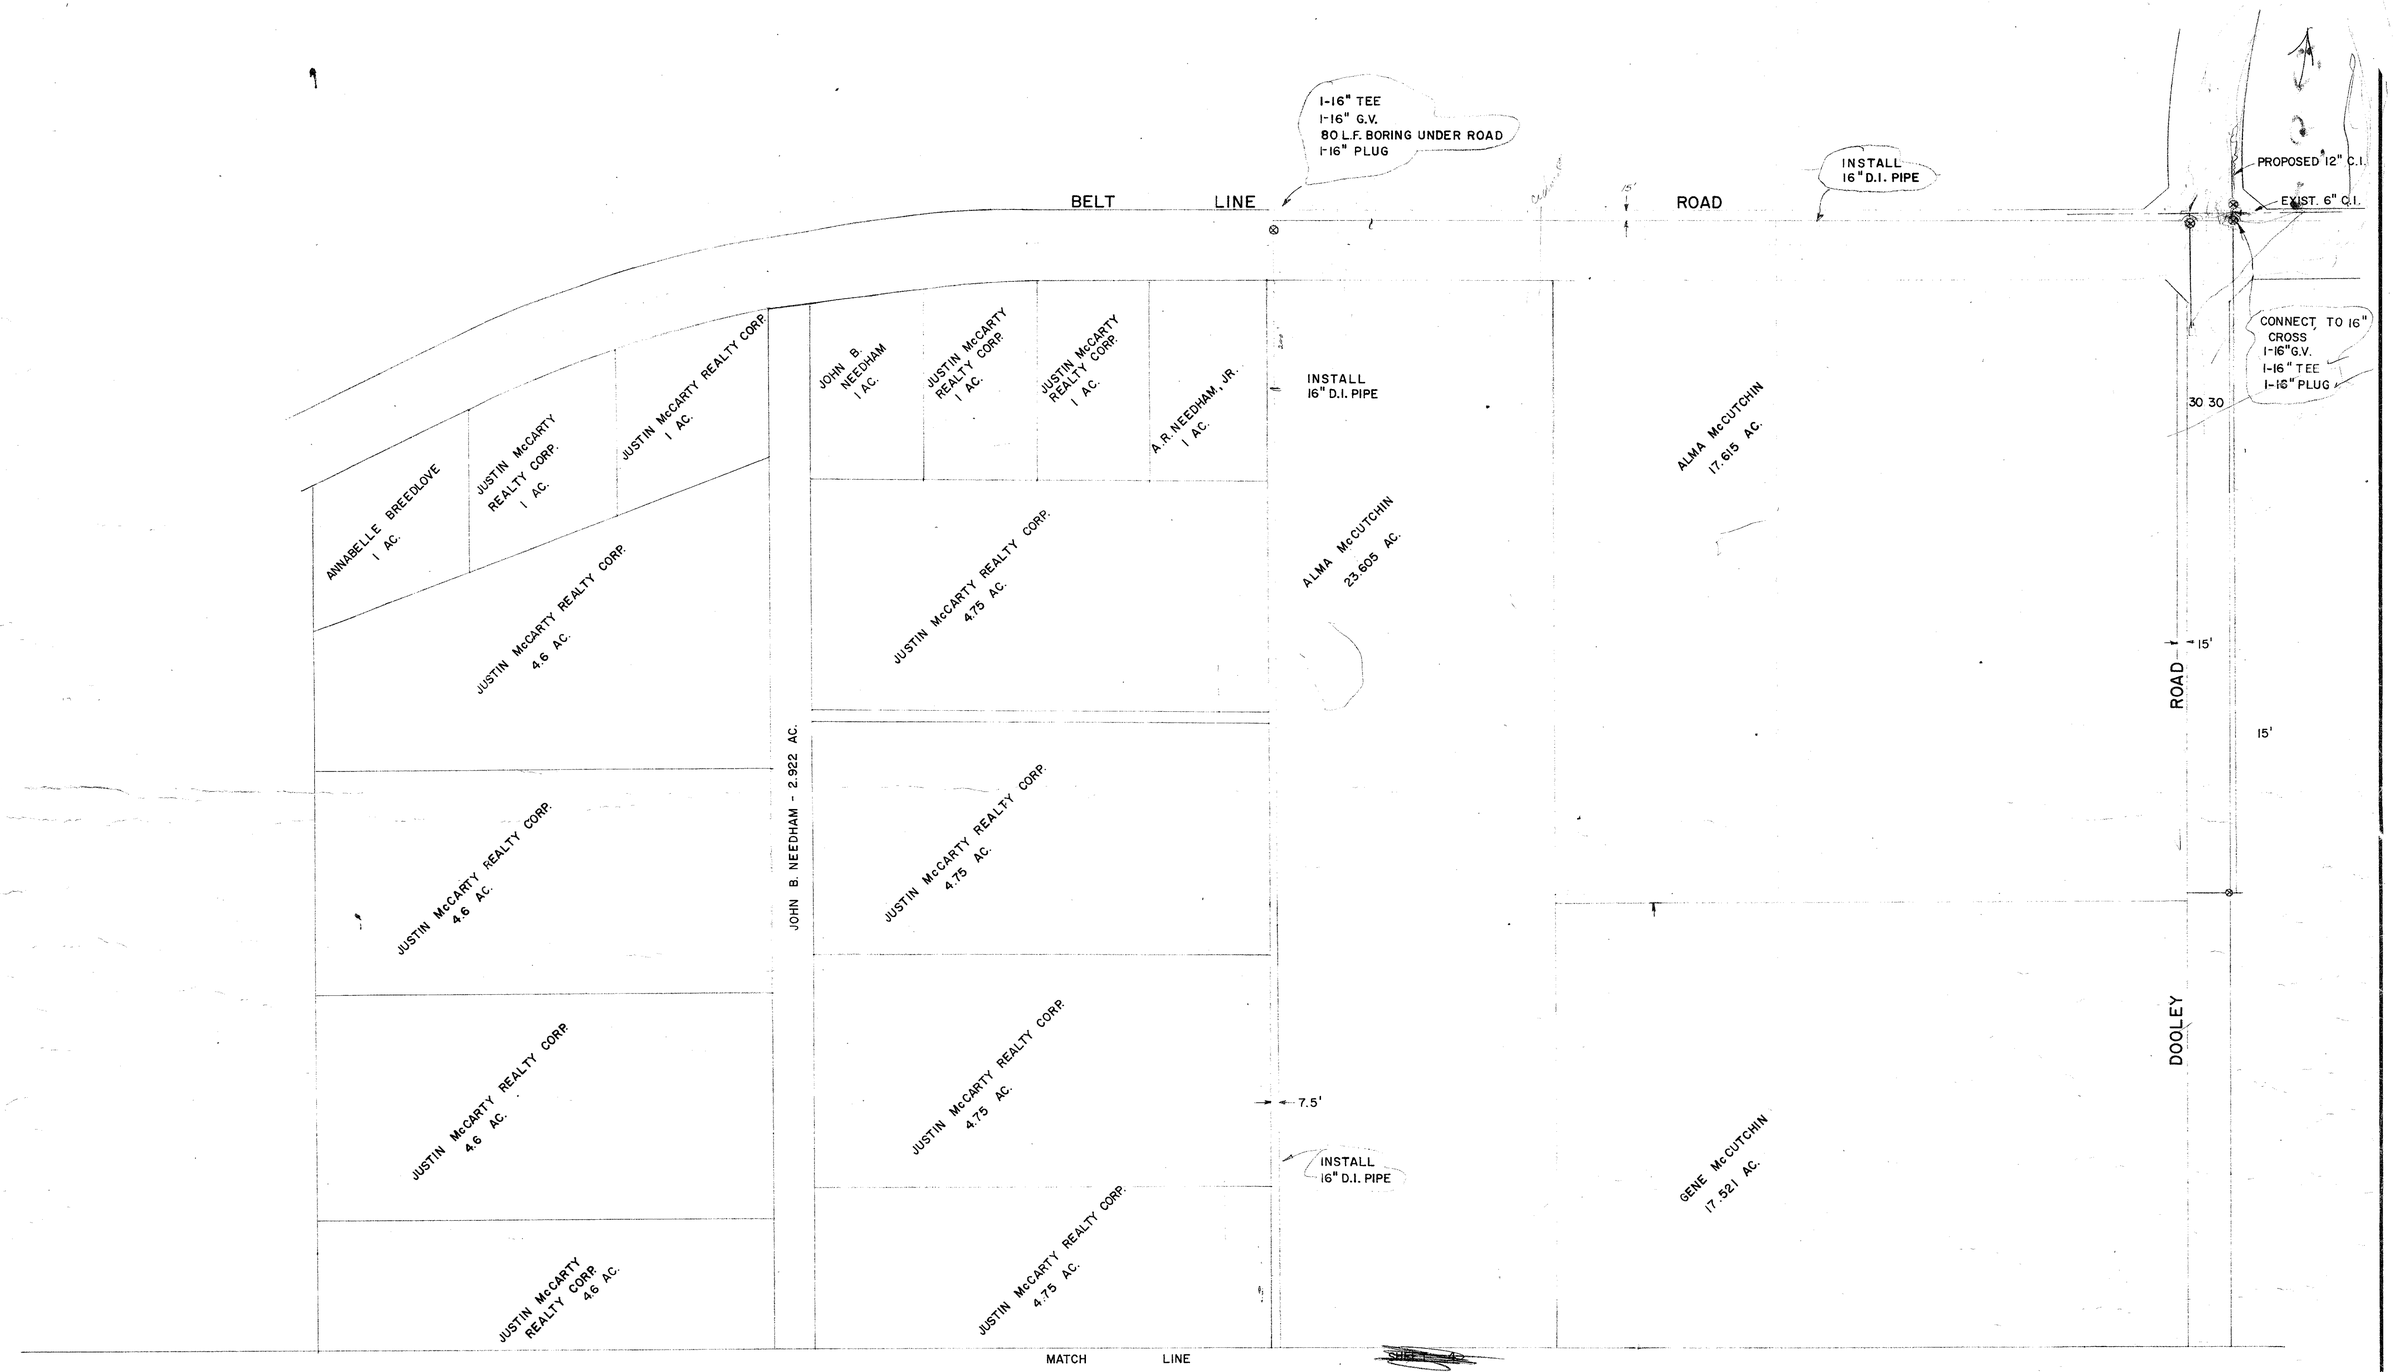

QUANTITIES	CONTRACT	
5,100	L.F.	12" C.I. PIPE
80	L.F.	FOR MACHINE BORE FOR 16" D.I. PIPE
2	EA.	WET CONNECTION TO EXIST. WATER MAIN
5	EA.	12" G.V.
80	S.Y.	ASPHALTIC CONCRETE PAVEMENT
3.6	TON	CAST IRON FITTINGS
18	L.F.	8" C.I. PIPE
3	E.A.	16" G.V.
3,050	L.F.	16" D.I. PIPE

CONTRACT "B"

ADDISON, TEXAS

WATER SYSTEM IMPROVEMENTS

Rieve & Wischmeyer, Inc.
CONSULTING ENGINEERS
DALLAS, TEXAS

DESIGNED:
APPROVED: E.M.R.
DATE: JULY 1971
JOB NO.
SHEET NO. 3 of 5
SCALE: 1"=100'