



3 WATER METER PIT DETAIL
NO SCALE

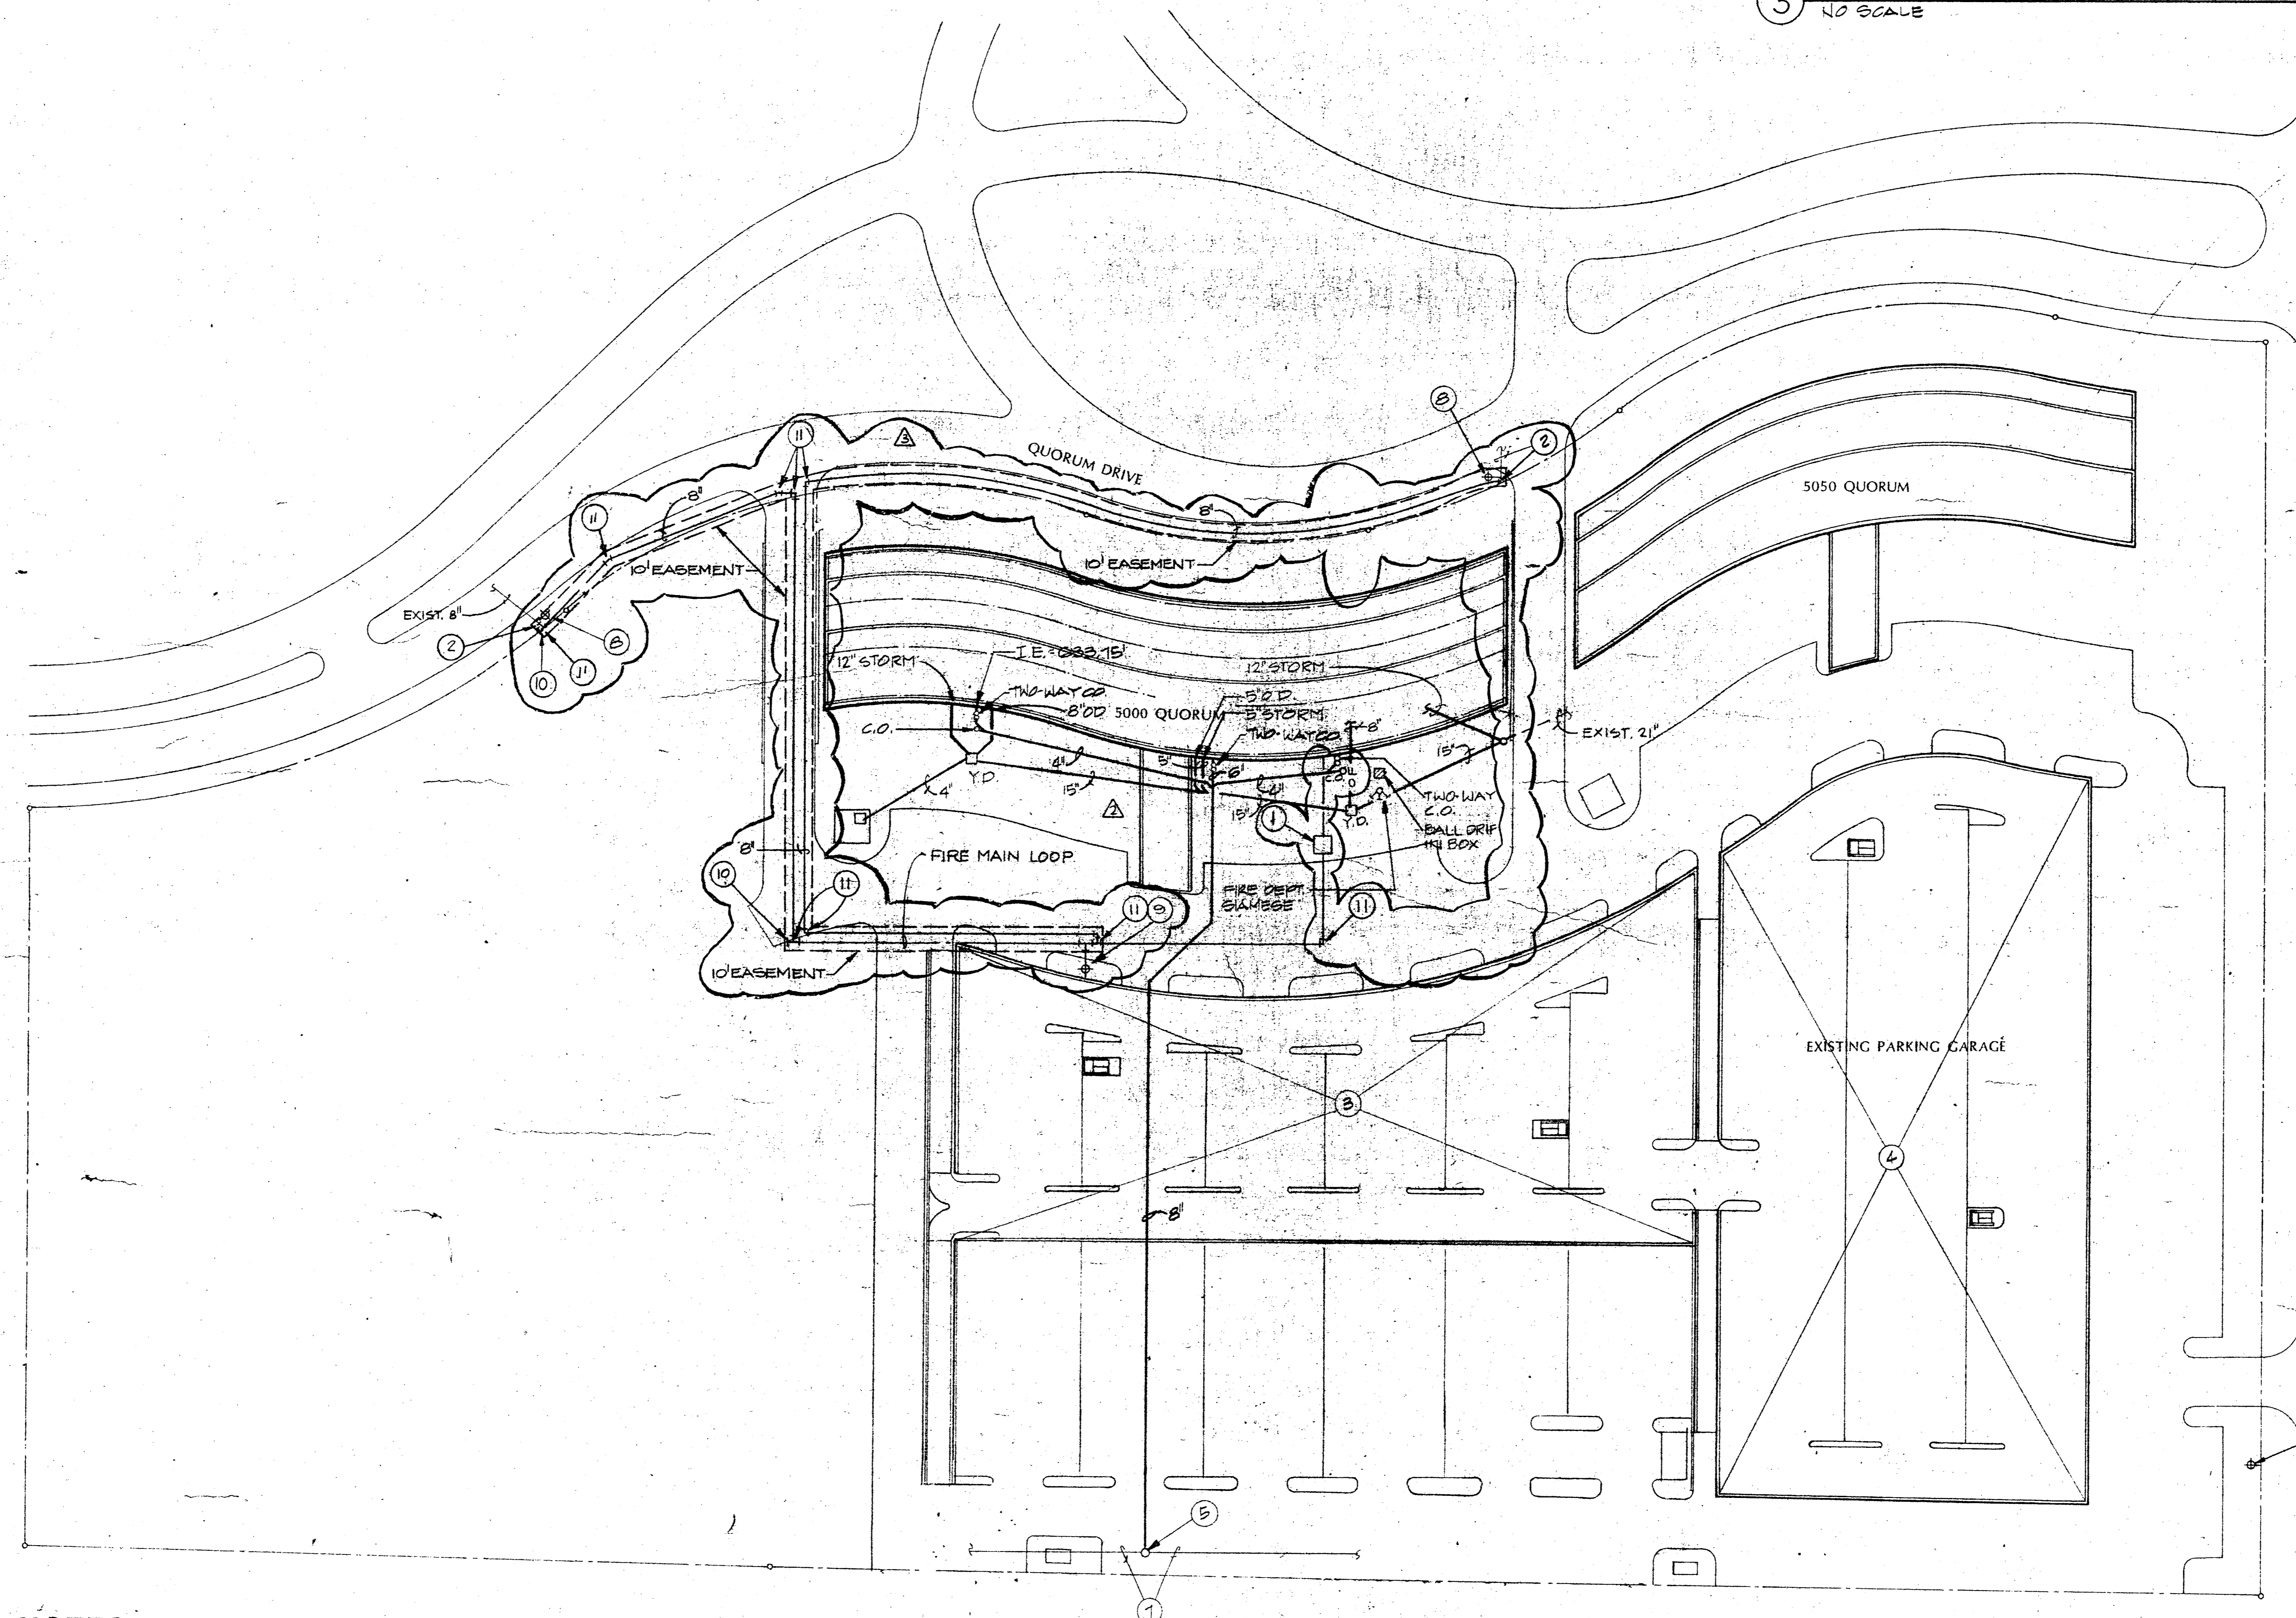


NOTES:


- 1 6" F.M. COMPOUND (FIRE & DOMESTIC COLD WATER) METER WITH 6" BY PASS IN CONC. PIT - PER CITY OF ADDISON STANDARDS.
- 2 EXIST. 8" C.W. W/8" C.W. TAP. VERIFY EXACT LOCATION. CONN NEW 8" C.W. AS SHOWN.
- 3 FOR NEW PARKING GARAGE FIRE PROTECTION REF: SHEETS B/S.2-1 & B/S.2-2.
- 4 FOR EXISTING PARKING GARAGE, CONTRACTOR SHALL PROVIDE A DRY STANDPIPE SYSTEM. THE SYSTEM SHALL CONSIST OF (2) SIAMESE CONNECTIONS AND (3) 2 1/2" FIRE DEPT. VALVES ON EACH LEVEL. LOCATE (1) SIAMESE CONNECTION AT QUORUM DRIVE ENTRANCE AND (1) AT DALLAS PARKWAY ENTRANCE WITHIN THE CONFINES OF THE EXISTING PARKING GARAGE. LOCATE (2) 2 1/2" FIRE DEPT. VALVE IN BOTH STAIRWAYS AT EACH LEVEL. THE THIRD VALVE SHALL BE LOCATED WHERE THE REMAINING AREA SHALL BE COVERED WITH 100' OF HOSE AND 30' OF SPOUT.
- 5 EXIST. SANITARY SEWER MANHOLE I.E. # 623.83'. CONNECT NEW 8" SANITARY INTO EXIST. 8" TAP AT I.E. # 628.42'.
- 6 FOR STORM SEWER REF: A/S.2-1
- 7 EXIST. 12" SANITARY SEWER.
- 8 EXIST. FIRE HYDRANT
- 9 NEW 6" PIPE HYDRANT W/VALVE.
- 10 NEW 8" TAP CAPPED FOR FUTURE USE.
- 11 PROVIDE THRUST BLOCK AS SHOWN.

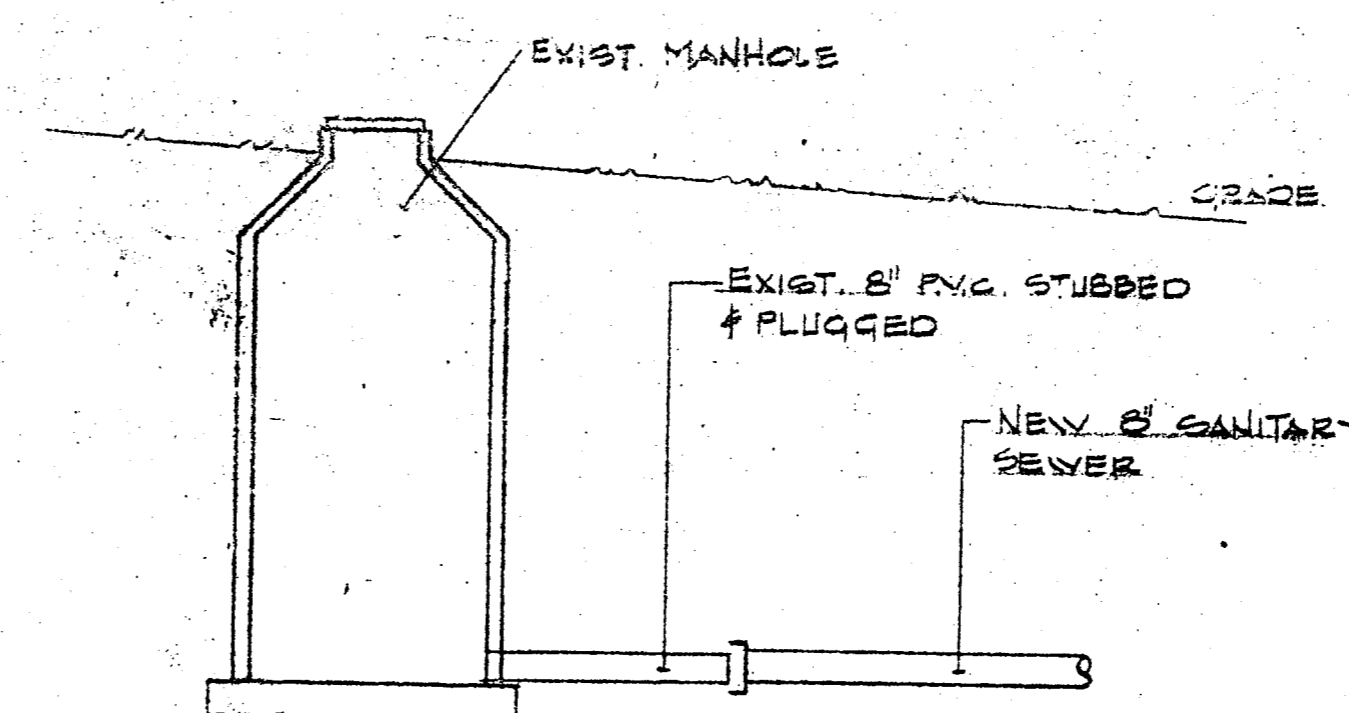

2 SANITARY SEWER CONNECTION
NO SCALE



SITE UTILITIES - MECHANICAL

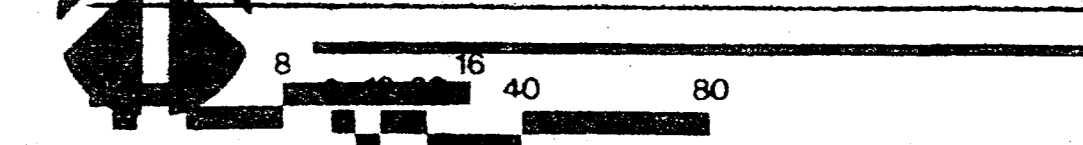

Quorum Partners Hollmuth, Obata & Kassabaum, Inc. Ellison & Tanner, Inc. Purdy-McGuire, Inc.	Owner Architect Structural Engineers Mech./Elec. Engineers	<h1 style="margin: 0;">QUORUM OFFICE BUILDING # 2</h1>	REVISIONS A 12-28-85	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 5%;">SB</td> <td style="width: 5%;">T</td> <td style="width: 40%;">Job Number 3195001</td> <td style="width: 40%;">Detail</td> </tr> <tr> <td>M-2</td> <td></td> <td></td> <td style="text-align: center;">5.1-2</td> </tr> </table>	SB	T	Job Number 3195001	Detail	M-2			5.1-2
SB	T	Job Number 3195001	Detail									
M-2			5.1-2									