



- GENERAL NOTES**
1. WATER LINES SHALL BE LOCATED A MINIMUM OF 48" DEPTH EXCEPT WHERE NOTED.
 2. 6" GATE VALVES SHALL BE INSTALLED WITH ALL FIRE HYDRANTS.
 3. ALL FIRE HYDRANTS SHALL BE LOCATED 1.5 FEET INSIDE R.O.W.
 4. ALL STORM DRAIN CURB INLETS SHALL BE RECESSED AND STANDARD 10" INLETS.
 5. ALL MATERIALS AND WORKMANSHIP TO CONFORM TO CITY OF ADDISON STANDARDS.
 6. WATER MAIN TO BE AT THE FOLLOWING DEPTH BETWEEN THE LISTED STATIONS.
 - 1) 7+20 TO 7+30 6FT. TO E. AT STORM DRAIN.
 - 2) 27+40 8" CROSSING 8 FT. TO E. AT STORM DRAIN.
 - 3) 29+90 8" CROSSING 8.5 FT. TO E. AT STORM DRAIN.
 - 4) 35+20 TO 35+70 11 FT. TO E.
 - 5) 12" CROSSING AT FACTORY 8 FT. TO E. AT STORM DRAIN.
 - 6) 12" CROSSING AT FACTORY 8 FT. TO E. AT STORM DRAIN.
 7. ALL 8" SANITARY SEWER STUBS TO BE LAID ON A 1% GRADE.

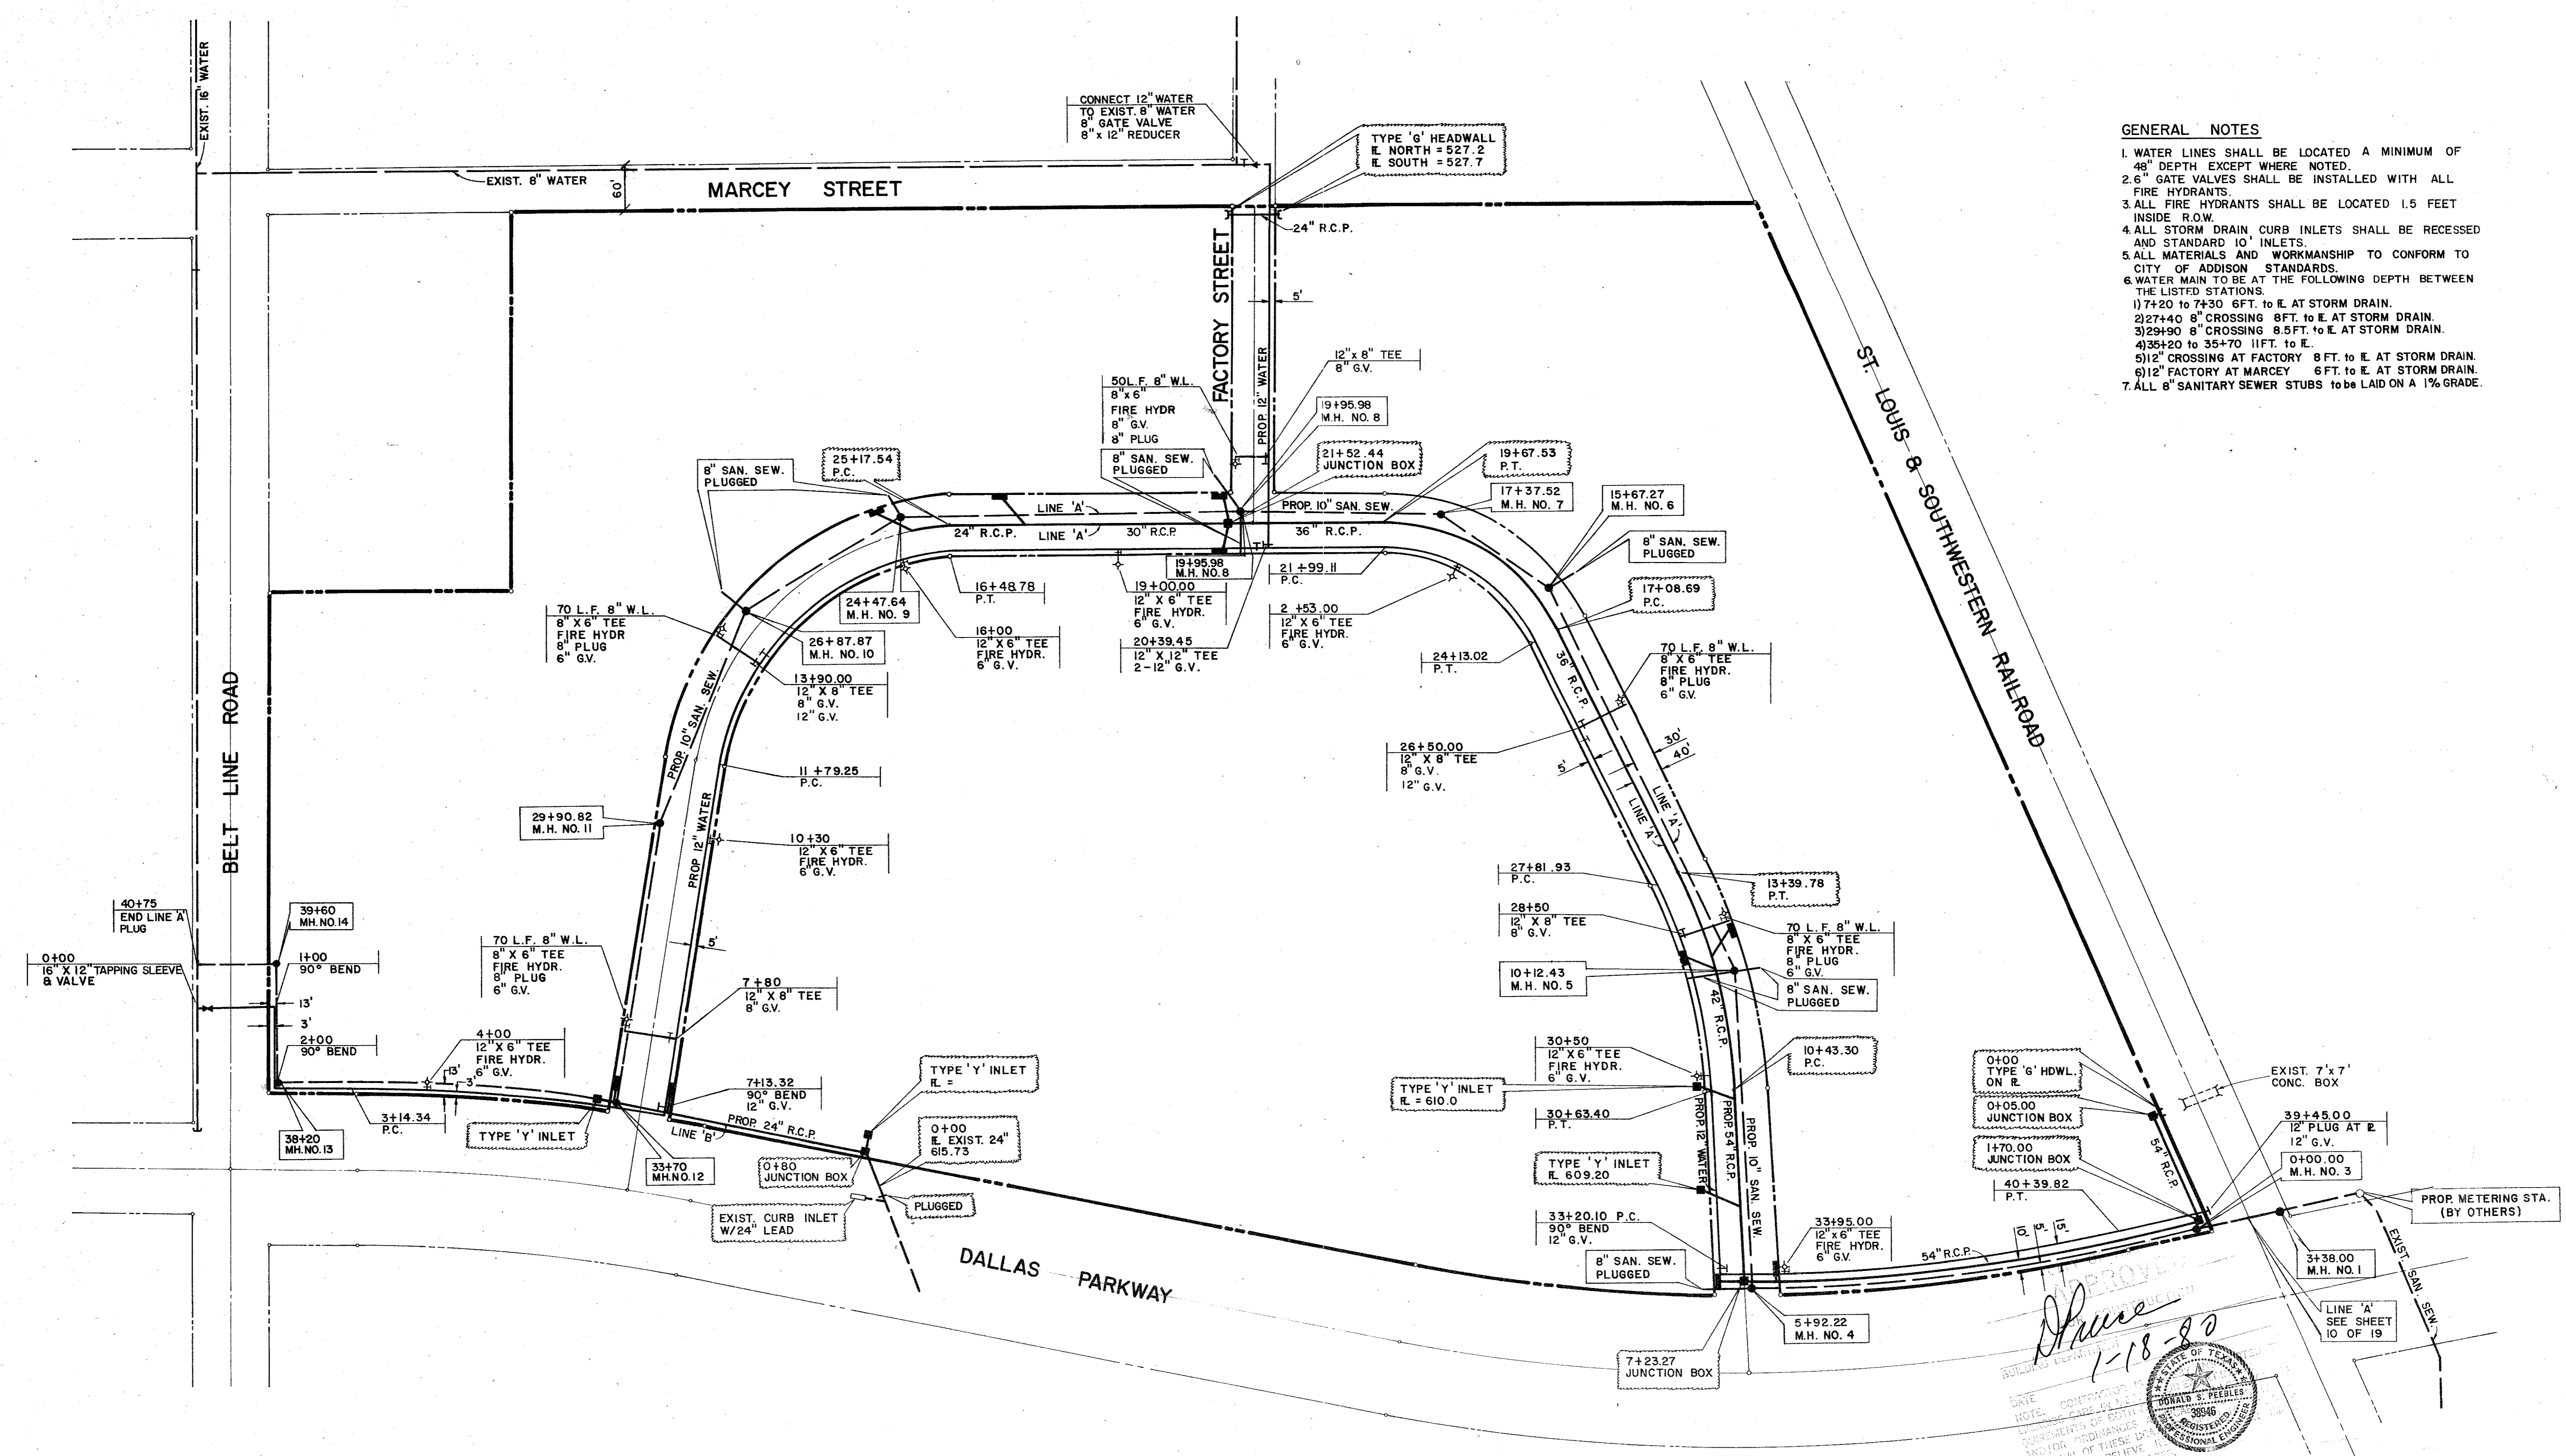

DATE: 1-18-80
 CONTRACTOR: DONALD S. PEEBLES
 REGISTERED PROFESSIONAL ENGINEER
 NO. 38946
 STATE OF TEXAS

UTILITY SITE PLAN
QUORUM NORTH
CITY OF ADDISON, TEXAS

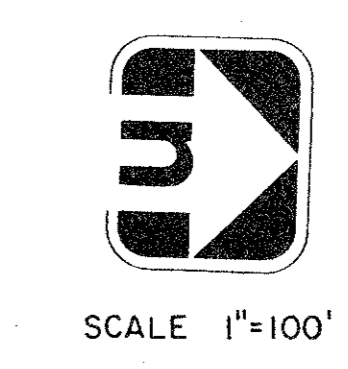

SCALE 1"=100'

Graham Associates, Inc.
 CONSULTING ENGINEERS & PLANNERS