



1-1 VALET DRIVE LANE W/MONOLITHIC CURB

SCALE: N.T.S

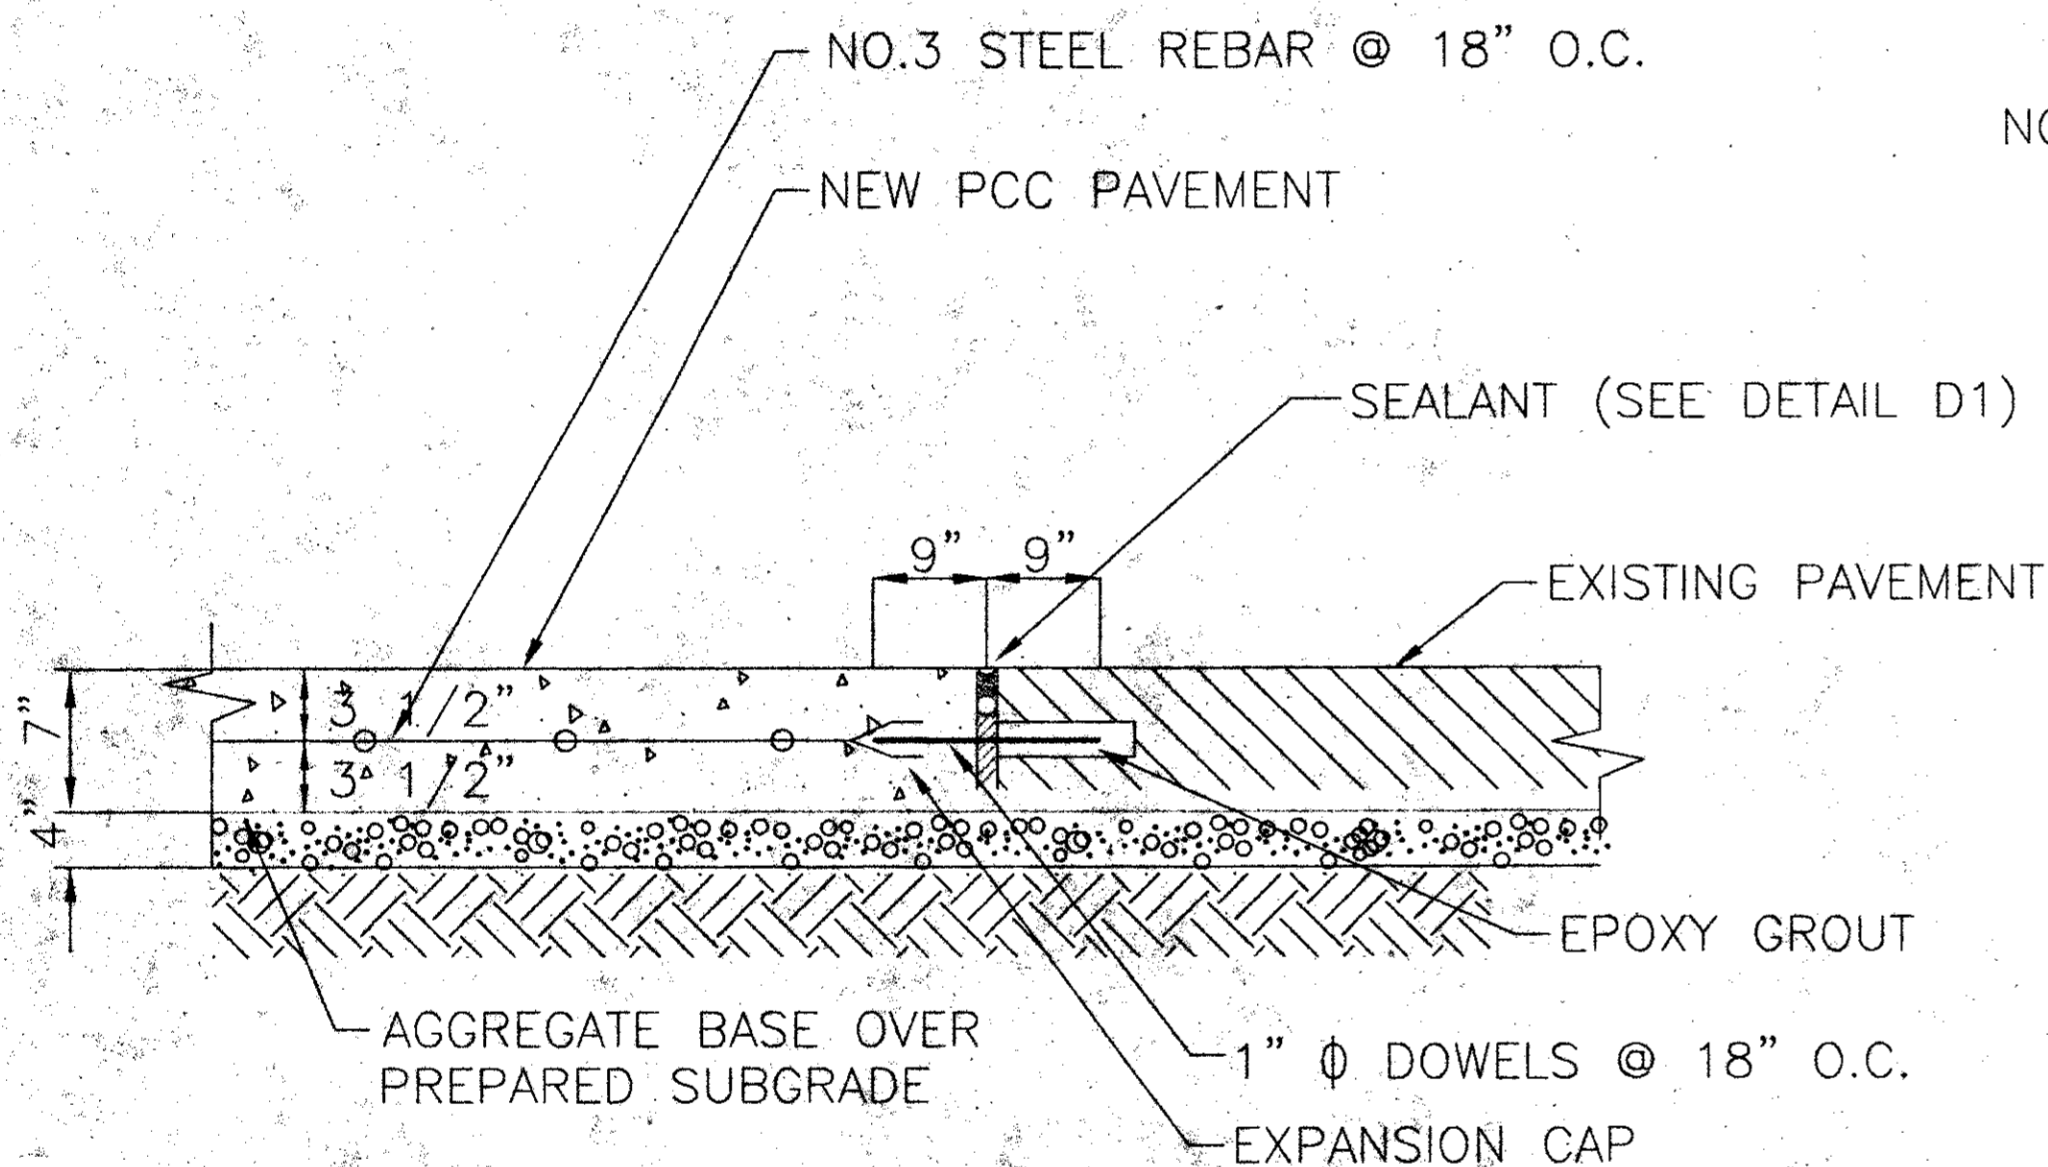


2-2 VALET DROP-OFF AREA AT EXISTING PAVEMENT

SCALE: N.T.S

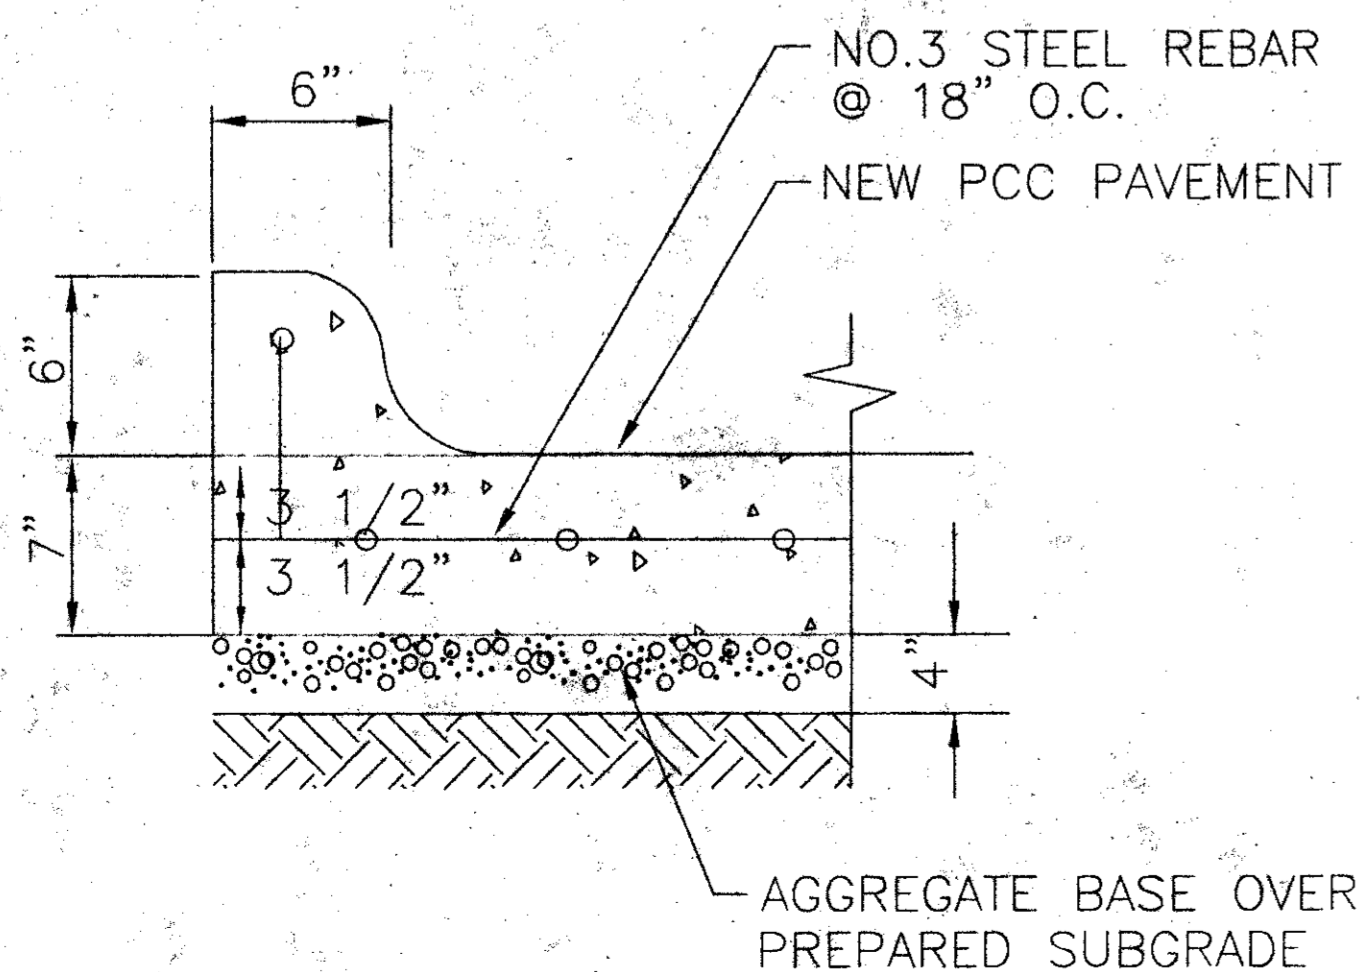


3-3 VALET DROP-OFF AREA W/MONOLITHIC CURB

SCALE: N.T.S

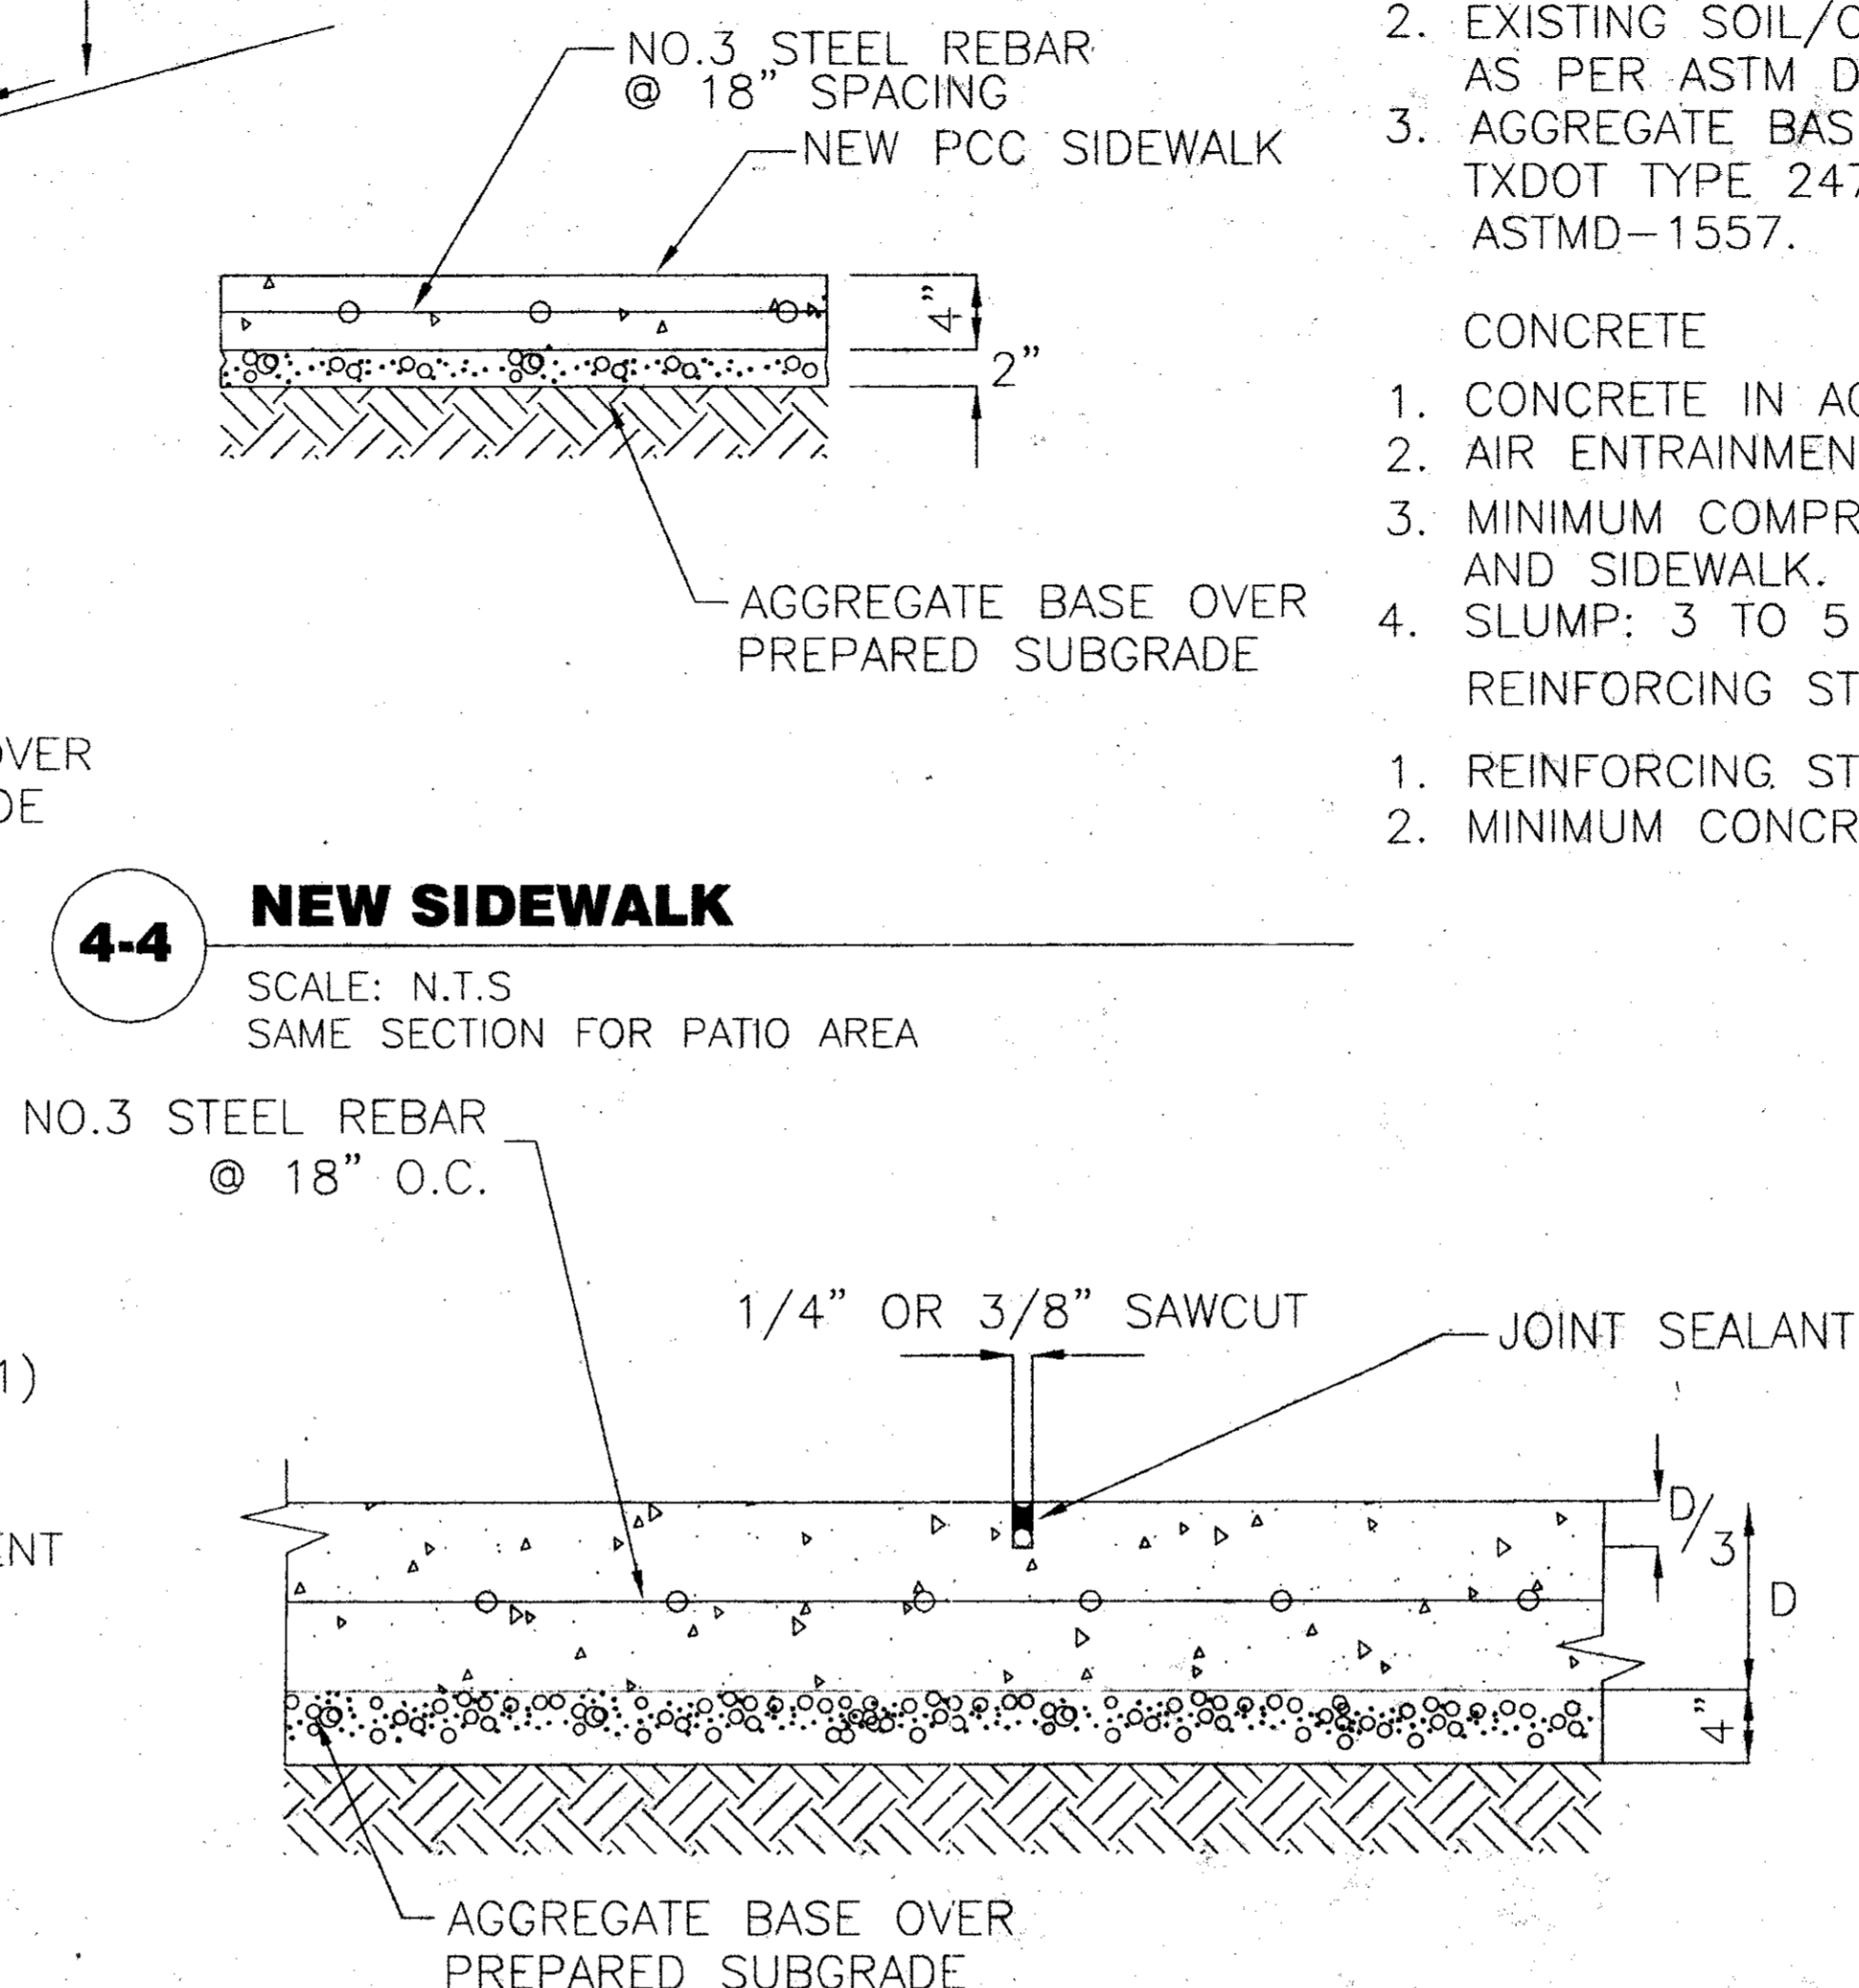


4-4 NEW SIDEWALK

SCALE: N.T.S
SAME SECTION FOR PATIO AREA

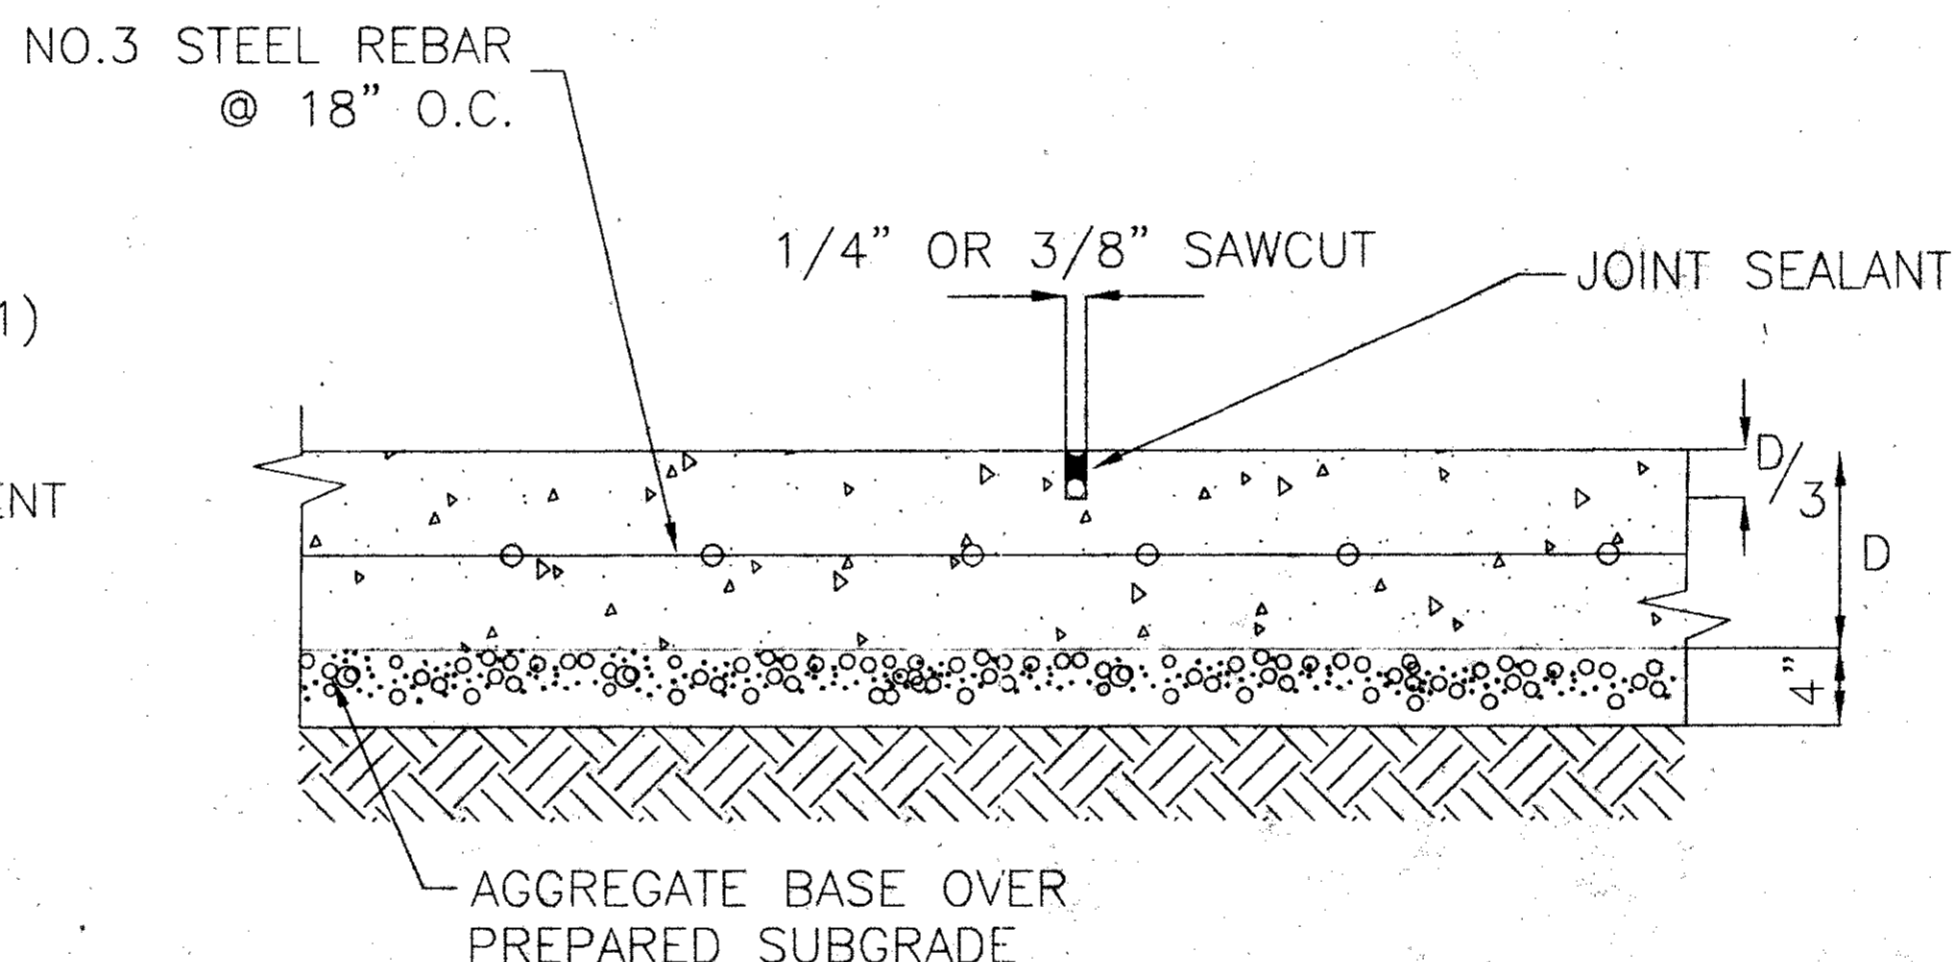

5-5 SAWCUT JOINTS

SCALE: N.T.S
NOTE: SAWCUT WITHIN 12 TO 24 HOURS

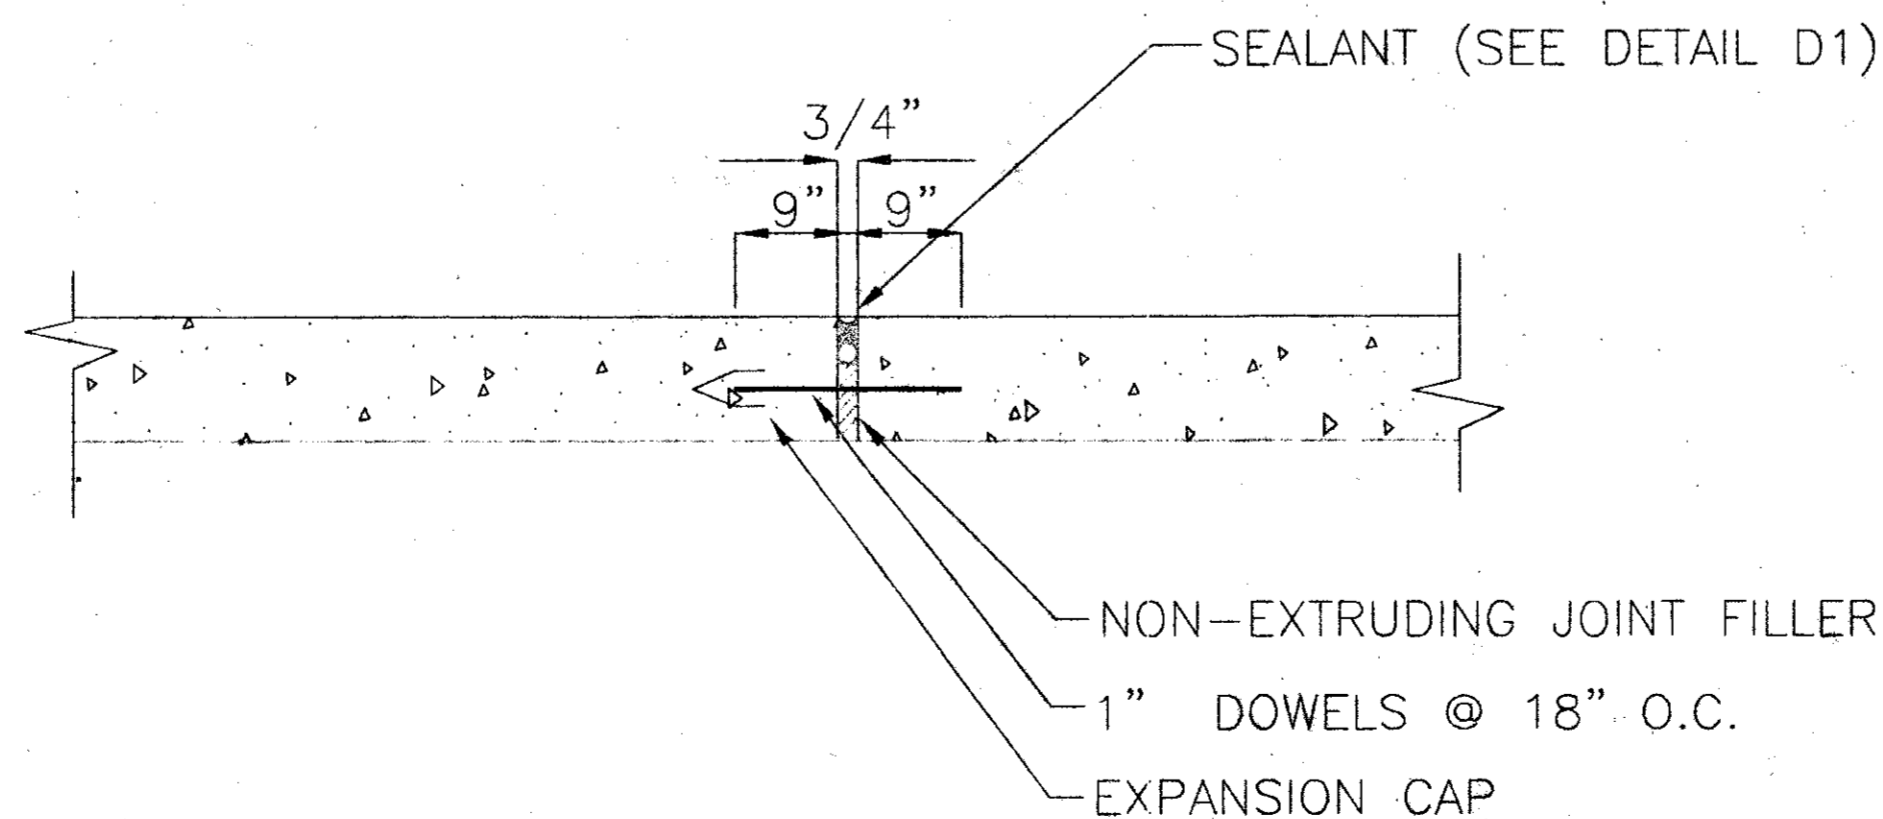

6-6 EXPANSION JOINTS

SCALE: N.T.S
NOTE: (SAME DETAIL FOR SIDEWALK EXCEPT NO DOWELS)

SPECIFICATIONS


1. CLEAR AND GRUB WITHIN GRADING LIMITS.
2. EXISTING SOIL/OR FILL SHALL BE COMPACTED TO 95% OF THE SOIL MAXIMUM DRY DENSITY AS PER ASTM D-698.
3. AGGREGATE BASE, SHALL BE TYPE I BASE MATERIAL, IN ACCORDANCE WITH TXDOT TYPE 247 SPECIFICATIONS, COMPACTED TO 98% MAXIMUM DRY DENSITY AS PER ASTM D-1557.

CONCRETE

1. CONCRETE IN ACCORDANCE WITH TXDOT ITEM 42 SPECIFICATIONS
2. AIR ENTRAINMENT SHALL BE 5%.
3. MINIMUM COMPRESSIVE STRENGTH: 28 DAY, 4000 PSI, AVERAGE 2 CYLINDERS FOR DRIVEWAY AND SIDEWALK.
4. SLUMP: 3 TO 5 INCHES.

REINFORCING STEEL

1. REINFORCING STEEL SHALL CONFORM TO ASTM A615-GRADE 60.
2. MINIMUM CONCRETE COVER: 3"

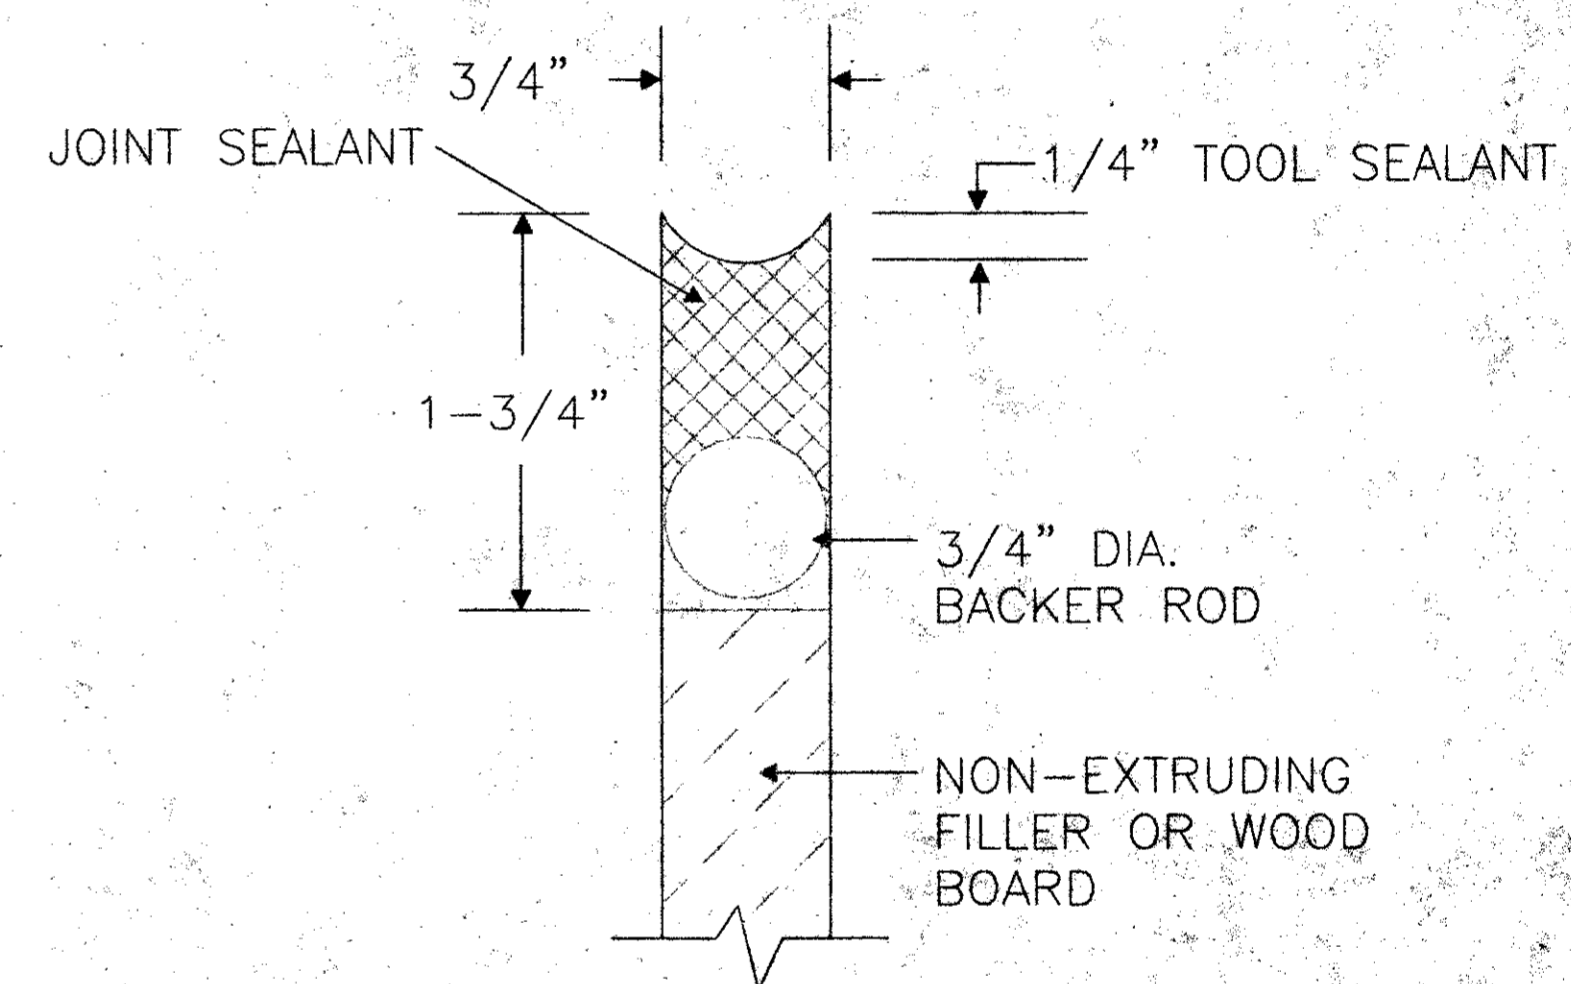

D-1 DETAIL D1

SCALE: N.T.S


APPROVED BY CITY OF ADDISON



LAW ENGINEERING AND ENVIRONMENTAL SERVICES, INC.
1655 WESTGROVE, SUITE 100
ADDISON, TEXAS 75001
469-828-4100 FAX 469-828-4110

NO.	DESCRIPTION	DATE
JZ	FILENAME	
PB	SCALE	
PB	SHOWN	
PB	DATE	05/08/02

APPROVED BY LAW ENGINEERING

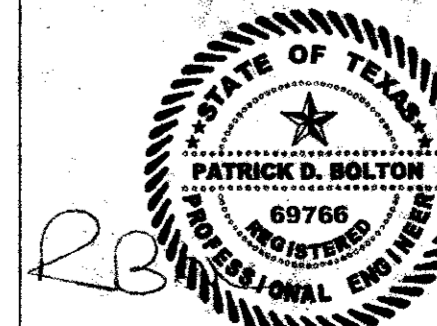

PAVING DETAILS

FRANK'S
INTERNATIONAL STEAKHOUSE

LAW PROJECT NO:
60300-2-7798-02-602
SHEET NO.

C-5