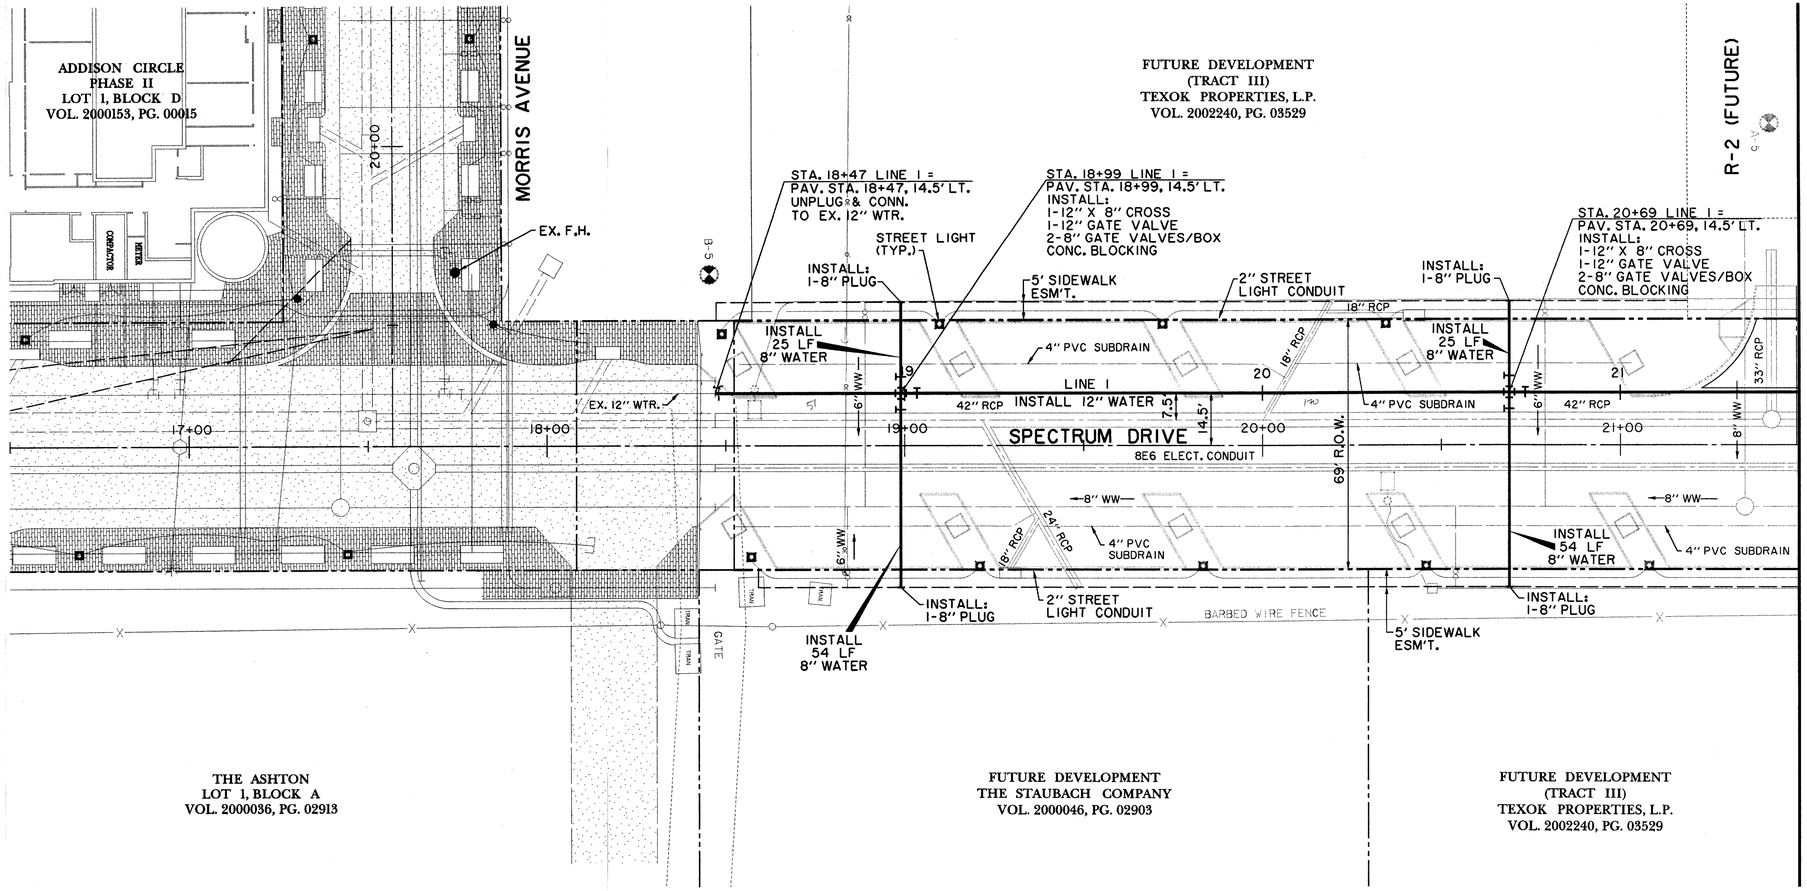

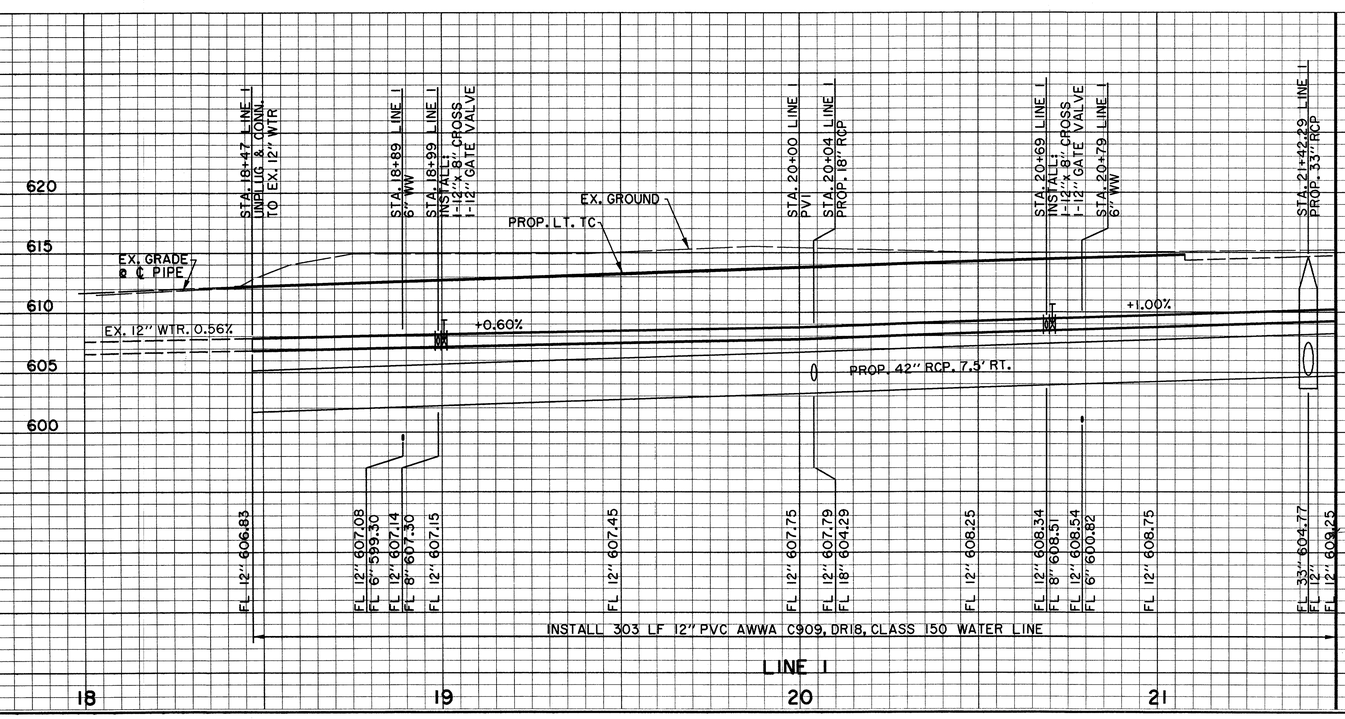



NOTES:

1. METERS, METER CANS, VAULTS AND BACKFLOW PREVENTION ASSEMBLIES TO BE INSTALLED AND TESTED PER TOWN OF ADDISON GENERAL REQUIREMENTS.
2. INCLUDE "LOCATOR WIRE" ON ALL PLASTIC WATER MAINS.
3. ALL FITTINGS SHALL BE ANCHORED BY FLANGE, RESTRAINING GLAND OR ANCHOR COUPLING.

BENCHMARKS:

"□" CUT SOUTHWEST CORNER OF CURB INLET, WEST SIDE OF SPECTRUM DRIVE, ±30' NORTH OF MORRIS AVENUE. ELEV. 611.84

"□" CUT ON TOP EAST END OF CURB INLET ON NORTH SIDE OF MORRIS AVENUE AND ±150' EAST OF QUORUM DRIVE CENTERLINE. ELEV. 616.39

STATE OF TEXAS
DAVID E. MEYERS
81512
REGISTERED PROFESSIONAL ENGINEER
12/30/03
1/5/04

DATE	DESCRIPTION	REF NO.
1/05/04	ISSUED FOR CONSTRUCTION	
11/07/03	ISSUED FOR BID	

WATER PLAN & PROFILE
LINE 1 - SPECTRUM DRIVE

SPECTRUM DRIVE EXTENSION

TOWN OF ADDISON, TEXAS

Huitt - Zollars, Inc.
3131 Mckinney Ave., Suite 600, Dallas, TX 75204
Phone (214) 871-3311/Fax (214) 871-0757

DESIGN	DRAWN	APPR.	SCALE	DATE	PROJECT NO.	NO.
HZI	HZI	DEM	H: 1"=20' V: 1"=6'	NOV 2003	01-3220-01	28

h:\proj\01322001\dgn\322001UW03.DGN

PRF ROTATION=0.000000
PLTBLK=0.000000
RWIL 3220UWMPLDGN, I-7.8,10,12,15,17,18,21-24,29-31,34,38,42-48,65PWL,A3220UWD800.DGN, 63
BORDER, 3220UWD800.DGN, 2,5,10,14,15,20,36,41,57-62
$40TPRL 3220UTPRLDGN, 1-10,15-18,20-22,24-45,47-62
$40WRITA, 3220UWRITADGN, 1-63
$40WRITA, 3220UWRITADGN, 1,4,20,33,49
h:\proj\01322001\dgn\3220UW03.DGN
1:\DGN\3220UW03.DGN
Tue Dec 30 15:48:24 2003
USER:DLEE
C:\PROGRAM FILES\BENTLEY\MICROSTATION\DGN\3220UWMPLDGN
DGNLIB
no ref levels*, no ref models*, no ref levels*
no ref levels*, no ref models*, no ref levels*